

Appendix F: Hydrology and Hydraulic Analysis and Preliminary WQMP

THIS PAGE INTENTIONALLY LEFT BLANK

F.1 - Hydrology and Hydraulic Analysis

THIS PAGE INTENTIONALLY LEFT BLANK

PRELIMINARY

HYDROLOGY AND HYDRAULIC ANALYSIS

For:
**In-N-Out Burger at
18181 Imperial Hwy
City of Yorba Linda, CA**

**CUP 2019-05
DR 2019-04**

Prepared for:
In-N-Out Burger
13502 Hamburger Lane
Baldwin Park, CA 91706



Prepared by:
Joseph C. Truxaw & Associates, Inc.
Civil Engineers & Land Surveyors
265 S. Anita Drive, Suite 111
Orange, CA 92868
(714) 935-0265

Prepared on: January 21, 2019
Revised on: April 14, 2020



TABLE OF CONTENTS	Page
1.0 PROJECT DESCRIPTION	2
2.0 HYDROLOGY ANALYSIS	5
2.1 EXISTING CONDITION	5
2.2 PROPOSED CONDITION	6
2.3 ADVANCED ENGINEERING SOFTWARE (AES) CALCULATIONS.....	10
3.0 HYDRAULICS ANALYSIS.....	11
4.0 APPENDIX “A”.....	19
4.1 REFERENCE MAPS	20
4.2 VCINITY MAP.....	21
5.0 HYDROLOGY MAPS	22
5.1 HYDROLOGY MAP(EXISTING CONDITION).....	23
5.2 HYDROLOGY MAP (PROPOSED CONDITION).....	24

In-N-Out Burger
18181 Imperial Hwy

City of Yorba Linda, County of Orange, California

1.0 PROJECT DESCRIPTION

The subject property is located at 18181 Imperial Highway in the city of Yorba Linda, CA. The existing condition consists of the Yorba Linda Library, associated parking areas, and a dirt lot with soil remediation equipment. The site is bounded by three streets: Imperial Hwy to the south and west, Lemon Dr. to the north and Olinda St. to the east. There is a grade difference from the southeast corner of the site to the northwest corner by approximately 16'. The low point of the site is in the north east corner where a catch basin is located in Lemon Dr.

1.1 PURPOSE

The purpose of this report is to provide a technical analysis of the existing and proposed drainage patterns of the subject site.

1.2 EXISTING SITE CONDITION

Due to the significant grade difference the library parking areas are separated by a retaining wall. The higher parking area is located nearest to the corner of Olinda St. and Imperial Highway and drains away from the building towards Imperial where the runoff is collected by a grated inlet. The grated inlet discharges runoff to the lower parking lot through a storm drain pipe connecting the drainage from the higher elevation parking area to the lower parking area. The remainder of the lower parking area flows northwest where the runoff enters an under sidewalk drain and discharges into Lemon Dr. The runoff is picked up by the curb & gutter in Lemon Dr. and conveyed to the catch basin at the low point and enters the municipal storm drain system. The dirt lot west of the library sheets flows to the low point and enters Lemon Dr. and discharged at the low point.

1.3 PROPOSED SITE CONDITION

The proposed development will raze the existing library building, asphalt, curbs, v-gutters, landscape, etc. and significant grading will be performed to accommodate the In-N-Out building location which will be along Imperial Hwy. Multiple retaining walls will be built to make up the grade difference across the site and a storm drain system will be placed to direct runoff to the low point of the site. This project is required to comply with Low Impact Development standards to treat stormwater runoff, so a bio-retention basin is proposed at the northwest corner of the site where all the stormwater runoff from impervious surfaces will discharge. The proposed grading divides the site into eight drainage sub-areas. Six sub-areas will consist of new impervious surfaces which will collect runoff into

In-N-Out Burger
18181 Imperial Hwy

City of Yorba Linda, County of Orange, California

a corresponding grated inlet and convey runoff to the bio-retention basin. The other two areas are made up of landscape only and can be considered self-treating areas. One of these areas is the basin itself, and the other area is a landscaped area between the drive-thru and Imperial Hwy that will discharge into Imperial Hwy.

1.4 METHODOLOGY

The total existing and proposed runoff from the site will be computed using the Advanced Engineering Software (AES) program which utilizes the information given by the Orange County Hydrology Manual, related to Soil Classification and 2-Year and 25-Year 24-Hour Isohyet. The soil type in the area of the subject site was found to be 'Type D'.

In-N-Out Burger
18181 Imperial Hwy

City of Yorba Linda, County of Orange, California

TOTAL DISCHARGE SUMMARY

Existing Condition

DRAINAGE AREA	2-YR PEAK FLOW RATE (cfs)	25-YR PEAK FLOW RATE (cfs)
A	0.60	1.29
B	2.00	4.28
C	0.44	0.93
E	0.08	0.18
TOTAL*	3.12	6.68

**Because Node 401 is linked to Node 200 (grate inlet from Area D discharges to Area B) the AES program was used to link the areas together during the computations so that area B is an addition to the initial sub-area. The runoff values therefore reflect runoff from both Area D & B.*

Proposed Condition

DRAINAGE AREA	2-YR (PEAK FLOW RATE (cfs)	25-YR (PEAK FLOW RATE (cfs)
A	0.63	1.35
B	0.55	1.18
C	0.61	1.30
D	0.22	0.46
E	0.18	0.38
F	0.09	0.19
STA-1	0.22	0.49
STA-2	0.26	0.58
TOTAL	2.76	5.93

2.0 HYDROLOGY ANALYSIS

2.1 EXISTING CONDITION

The time of concentration was computed using the Advanced Engineering Software (AES) program

The discharge Q was computed using the Rational Method Formula.

Node 100 to Node 101 (Area A)

Area = 0.43 acres

$$L = 573 \text{ ft.} \quad s = \frac{385.06 - 379.41}{184} = 0.0307$$

$Q_2 = 0.60 \text{ cfs.}$	$Q_{25} = 1.29 \text{ cfs.}$
$T_c = 5.00 \text{ min.}$	$T_c = 5.00 \text{ min.}$
$I = 2.264 \text{ in/hr.}$	$I = 4.824 \text{ in/hr.}$

Node 400 to Node 401 (Area D)

Area = 1.00 acres

$$L = 274 \text{ ft.} \quad s = \frac{388.28 - 379.72}{274} = 0.0312$$

$Q_2 = 2.00 \text{ cfs.}$	$Q_{25} = 4.28 \text{ cfs.}$
$T_c = 5.00 \text{ min.}$	$T_c = 5.00 \text{ min.}$
$I = 2.264 \text{ in/hr.}$	$I = 4.824 \text{ in/hr.}$

Node 200 to Node 201 (Area B)

**Because Node 401 is linked to Node 200 (grate inlet from Area D discharges to Area B) the AES program was used to link the areas together during the computations so that area B is an addition to the initial sub-area. The runoff values therefore reflect runoff from both Area D & B.*

Area = 0.209 acres

$$L = 82 \text{ ft.} \quad s = \frac{68.53 - 67.33}{82} = 0.0146$$

In-N-Out Burger
18181 Imperial Hwy

City of Yorba Linda, County of Orange, California

Node 300 to Node 301 (Area C)

Area = 0.22 acres

$$L = 9 \text{ ft.} \quad s = \frac{391.60 - 390.90}{9} = 0.0778$$

$$Q_2 = 0.44 \text{ cfs.}$$

$$Q_{25} = 0.93 \text{ cfs.}$$

$$T_c = 5.00 \text{ min.}$$

$$T_c = 5.00 \text{ min.}$$

$$I = 2.264 \text{ in/hr.}$$

$$I = 4.824 \text{ in/hr.}$$

Node 500 to Node 501 (Area E)

Area = 0.04 acres

$$L = 30 \text{ ft.} \quad s = \frac{391.30 - 390.65}{30} = 0.0217$$

$$Q_2 = 0.08 \text{ cfs.}$$

$$Q_{25} = 0.18 \text{ cfs.}$$

$$T_c = 5.00 \text{ min.}$$

$$T_c = 5.00 \text{ min.}$$

$$I = 2.264 \text{ in/hr.}$$

$$I = 4.824 \text{ in/hr.}$$

Burn Factor. The site is paved, no Burn Factor is calculated.

2.2 PROPOSED CONDITION

The time of concentration was computed using the Advanced Engineering Software (AES) program

The discharge Q was computed using the Rational Method Formula.

Node 100 to Node 101 (Area A)

Area = 0.43 acres

$$L = 573 \text{ ft} \quad s = 0.0187$$

$$Q_2 = 0.63 \text{ cfs.}$$

$$Q_{25} = 1.35 \text{ cfs.}$$

$$T_c = 8.55 \text{ min.}$$

$$T_c = 8.55 \text{ min.}$$

$$I = 1.66 \text{ in/hr.}$$

$$I = 3.56 \text{ in/hr.}$$

In-N-Out Burger
18181 Imperial Hwy

City of Yorba Linda, County of Orange, California

Node 200 to Node 201 (Area B)

Area = 0.27 acres

L = 157 ft. s = 0.0458

Q₂ = 0.55 cfs.

T_c = 5.00 min.

I = 2.26 in/hr.

Q₂₅ = 1.18 cfs.

T_c = 5.00 min.

I = 4.82 in/hr.

Node 300 to Node 301 (Area C)

Area = 0.30 acres

L = 217 ft. s = 0.0443

Q₂ = 0.61 cfs.

T_c = 5.00 min.

I = 2.26 in/hr.

Q₂₅ = 1.30 cfs.

T_c = 5.00 min.

I = 4.82 in/hr.

Node 400 to Node 401 (Area D)

Area = 0.11 acres

L = 107 ft. s = 0.0401

Q₂ = 0.22 cfs.

T_c = 5.00 min.

I = 2.26 in/hr.

Q₂₅ = 0.46 cfs.

T_c = 5.00 min.

I = 4.82 in/hr.

Node 500 to Node 501 (Area E)

Area = 0.09 acres

L = 62 ft. s = 0.0460

Q₂ = 0.18 cfs.

T_c = 5.00 min.

I = 2.26 in/hr.

Q₂₅ = 0.38 cfs.

T_c = 5.00 min.

I = 4.82 in/hr.

Node 100 to Node 601 (Area F)

Area = 0.06 acres

L = 67 ft. s = 0.0072

Q₂ = 0.09 cfs.

T_c = 6.97 min.

I = 1.87 in/hr.

Q₂₅ = 0.19 cfs.

T_c = 6.97 min.

I = 4.00 in/hr.

Node 700 to Node 701 (STA-1)

Area = 0.12 acres

L = 71 ft. s = 0.0856

Q₂ = 0.22 cfs.

T_c = 5.00 min.

I = 2.26 in/hr.

Q₂₅ = 0.49 cfs.

T_c = 5.00 min.

I = 4.82 in/hr.

In-N-Out Burger
18181 Imperial Hwy

City of Yorba Linda, County of Orange, California

Node 800 to Node 801 (STA-2)

Area = 0.15 acres

L = 47 ft. s = 0.0085

Q₂ = 0.26 cfs.

Q₂₅ = 0.58 cfs.

T_c = 5.85 min.

T_c = 5.85 min.

I = 2.07 in/hr.

I = 4.42 in/hr.

Burn Factor. The site is paved, no Burn Factor is calculated.

In-N-Out Burger
18181 Imperial Hwy

City of Yorba Linda, County of Orange, California

TOTAL SITE RUNOFF DISCHARGE

EXISTING

$$Q_2 = 0.60 + 2.00 + 0.44 + 0.08 = \mathbf{3.12 \text{ cfs}}$$

$$Q_{25} = 1.29 + 4.28 + 0.93 + 0.18 = \mathbf{6.68 \text{ cfs}}$$

PROPOSED

$$Q_2 = 0.63 + 0.55 + 0.61 + 0.22 + 0.18 + 0.09 + 0.22 + 0.26 = \mathbf{2.76 \text{ cfs}}$$

$$Q_{25} = 1.35 + 1.18 + 1.30 + 0.46 + 0.38 + 0.19 + 0.49 + 0.58 = \mathbf{5.93 \text{ cfs}}$$

$$Q_2 (\text{EXISTING}) - Q_2 (\text{PROPOSED})$$

$$3.12 \text{ cfs} - 2.76 \text{ cfs} = 0.36 \text{ cfs} \Rightarrow \mathbf{\text{DECREASE OF 0.36 cfs } [-11.5\%]}$$

$$Q_{25} (\text{EXISTING}) - Q_{25} (\text{PROPOSED})$$

$$6.68 \text{ cfs} - 5.93 \text{ cfs} = 0.75 \text{ cfs} \Rightarrow \mathbf{\text{DECREASE OF 0.75 cfs } [-11.2\%]}$$

VOLUME, TIME OF CONCENTRATION AND PEAK FLOW DATA

The South Orange County Technical Guidance Manual

	EXISTING CONDITION	PROPOSED CONDITION	PROPOSED – ADJUSTED T _c
TIME OF CONCENTRATION (min.)	5.00	8.55	5.25
VOLUME (ac-ft)	0.2654	0.2593	0.2592
Q (cfs)	2.69	1.97	2.56

The proposed condition shows an increase in the Time of Concentration of 3.55 min. (+71%), but shows a decrease in volume and peak flowrate. Because of the increase in Time of Concentration this **does** constitute a Hydrologic Condition of Concern (HCOC) and therefore the site is required to meet **hydromodification** demands. However, following the Orange County Hydrology Manual by creating a small area unit hydrograph using the max allowable Time of Concentration (predevelopment T_c * 1.05) provides a runoff volume that is less than the volume given for the time of concentration at 8.55 min. Therefore, there is no additional volume to retain.

In-N-Out Burger

18181 Imperial Hwy

City of Yorba Linda, County of Orange, California

2.3 ADVANCED ENGINEERING SOFTWARE (AES) CALCULATIONS

RATIONAL METHOD HYDROLOGY COMPUTER PROGRAM PACKAGE
(Reference: 1986 ORANGE COUNTY HYDROLOGY CRITERION)
(c) Copyright 1983-2012 Advanced Engineering Software (aes)
Ver. 18.2 Release Date: 05/08/2012 License ID 1537

***** DESCRIPTION OF STUDY *****

* IN-N-OUT 18181 IMPERIAL HWY *
* 2-PRE HYDROLOGY ANALYSIS *
* *

FILE NAME: PRE18021.DAT
TIME/DATE OF STUDY: 12:59 12/17/2018

=====

USER SPECIFIED HYDROLOGY AND HYDRAULIC MODEL INFORMATION:

=====

--*TIME-OF-CONCENTRATION MODEL*--

USER SPECIFIED STORM EVENT(YEAR) = 2.00
SPECIFIED MINIMUM PIPE SIZE(INCH) = 12.00
SPECIFIED PERCENT OF GRADIENTS(DECIMAL) TO USE FOR FRICTION SLOPE = 0.01
DATA BANK RAINFALL USED
ANTECEDENT MOISTURE CONDITION (AMC) I ASSUMED FOR RATIONAL METHOD

USER-DEFINED STREET-SECTIONS FOR COUPLED PIPEFLOW AND STREETFLOW MODEL

NO.	HALF- WIDTH (FT)	CROWN TO CROSSFALL (FT)	STREET-CROSSFALL: IN- / OUT-/PARK- SIDE / SIDE/ WAY	CURB HEIGHT (FT)	GUTTER-GEOMETRIES: WIDTH LIP (FT) (FT)	HIKE (FT)	MANNING FACTOR (n)
1	30.0	20.0	0.018/0.018/0.020	0.67	2.00 0.0312	0.167	0.0150

GLOBAL STREET FLOW-DEPTH CONSTRAINTS:

1. Relative Flow-Depth = 0.00 FEET
as (Maximum Allowable Street Flow Depth) - (Top-of-Curb)
2. (Depth)*(Velocity) Constraint = 6.0 (FT*FT/S)

*SIZE PIPE WITH A FLOW CAPACITY GREATER THAN
OR EQUAL TO THE UPSTREAM TRIBUTARY PIPE.*

*USER-SPECIFIED MINIMUM TOPOGRAPHIC SLOPE ADJUSTMENT NOT SELECTED

FLOW PROCESS FROM NODE 100.00 TO NODE 101.00 IS CODE = 21

>>>>RATIONAL METHOD INITIAL SUBAREA ANALYSIS<<<<<
>>USE TIME-OF-CONCENTRATION NOMOGRAPH FOR INITIAL SUBAREA<<

=====

INITIAL SUBAREA FLOW-LENGTH(FEET) = 184.00
ELEVATION DATA: UPSTREAM(FEET) = 385.06 DOWNSTREAM(FEET) = 379.41

$T_c = K * [(LENGTH ** 3.00) / (ELEVATION CHANGE)] ** 0.20$
 SUBAREA ANALYSIS USED MINIMUM $T_c(MIN.) = 5.000$
 * 2 YEAR RAINFALL INTENSITY(INCH/HR) = 2.264
 SUBAREA T_c AND LOSS RATE DATA(AMC I):

DEVELOPMENT TYPE/ LAND USE	SCS SOIL GROUP	AREA (ACRES)	F_p (INCH/HR)	A_p (DECIMAL)	SCS CN	T_c (MIN.)
COMMERCIAL	D	0.30	0.20	0.100	57	5.00

 SUBAREA AVERAGE PERVIOUS LOSS RATE, $F_p(INCH/HR) = 0.20$
 SUBAREA AVERAGE PERVIOUS AREA FRACTION, $A_p = 0.100$
 SUBAREA RUNOFF(CFS) = 0.60
 TOTAL AREA(ACRES) = 0.30 PEAK FLOW RATE(CFS) = 0.60

FLOW PROCESS FROM NODE 400.00 TO NODE 401.00 IS CODE = 21

>>>>RATIONAL METHOD INITIAL SUBAREA ANALYSIS<<<<<
 >>USE TIME-OF-CONCENTRATION NOMOGRAPH FOR INITIAL SUBAREA<<

INITIAL SUBAREA FLOW-LENGTH(FEET) = 109.00
 ELEVATION DATA: UPSTREAM(FEET) = 392.60 DOWNSTREAM(FEET) = 389.35

$T_c = K * [(LENGTH ** 3.00) / (ELEVATION CHANGE)] ** 0.20$
 SUBAREA ANALYSIS USED MINIMUM $T_c(MIN.) = 5.000$
 * 2 YEAR RAINFALL INTENSITY(INCH/HR) = 2.264
 SUBAREA T_c AND LOSS RATE DATA(AMC I):

DEVELOPMENT TYPE/ LAND USE	SCS SOIL GROUP	AREA (ACRES)	F_p (INCH/HR)	A_p (DECIMAL)	SCS CN	T_c (MIN.)
COMMERCIAL	D	0.24	0.20	0.100	57	5.00

 SUBAREA AVERAGE PERVIOUS LOSS RATE, $F_p(INCH/HR) = 0.20$
 SUBAREA AVERAGE PERVIOUS AREA FRACTION, $A_p = 0.100$
 SUBAREA RUNOFF(CFS) = 0.48
 TOTAL AREA(ACRES) = 0.24 PEAK FLOW RATE(CFS) = 0.48

FLOW PROCESS FROM NODE 200.00 TO NODE 201.00 IS CODE = 81

>>>>ADDITION OF SUBAREA TO MAINLINE PEAK FLOW<<<<<

MAINLINE $T_c(MIN.) = 5.00$
 * 2 YEAR RAINFALL INTENSITY(INCH/HR) = 2.264
 SUBAREA LOSS RATE DATA(AMC I):

DEVELOPMENT TYPE/ LAND USE	SCS SOIL GROUP	AREA (ACRES)	F_p (INCH/HR)	A_p (DECIMAL)	SCS CN
COMMERCIAL	D	0.75	0.20	0.100	57

 SUBAREA AVERAGE PERVIOUS LOSS RATE, $F_p(INCH/HR) = 0.20$
 SUBAREA AVERAGE PERVIOUS AREA FRACTION, $A_p = 0.100$
 SUBAREA AREA(ACRES) = 0.75 SUBAREA RUNOFF(CFS) = 1.52
 EFFECTIVE AREA(ACRES) = 0.99 AREA-AVERAGED $F_m(INCH/HR) = 0.02$
 AREA-AVERAGED $F_p(INCH/HR) = 0.20$ AREA-AVERAGED $A_p = 0.10$
 TOTAL AREA(ACRES) = 1.0 PEAK FLOW RATE(CFS) = 2.00

FLOW PROCESS FROM NODE 300.00 TO NODE 301.00 IS CODE = 21

>>>>RATIONAL METHOD INITIAL SUBAREA ANALYSIS<<<<<
>>USE TIME-OF-CONCENTRATION NOMOGRAPH FOR INITIAL SUBAREA<<

=====

INITIAL SUBAREA FLOW-LENGTH(FEET) = 9.00
ELEVATION DATA: UPSTREAM(FEET) = 391.60 DOWNSTREAM(FEET) = 390.90

$T_c = K * [(LENGTH ** 3.00) / (ELEVATION CHANGE)] ** 0.20$

SUBAREA ANALYSIS USED MINIMUM T_c (MIN.) = 5.000

* 2 YEAR RAINFALL INTENSITY(INCH/HR) = 2.264

SUBAREA T_c AND LOSS RATE DATA(AMC I):

DEVELOPMENT TYPE/ LAND USE	SCS SOIL GROUP	AREA (ACRES)	F_p (INCH/HR)	A_p (DECIMAL)	SCS CN	T_c (MIN.)
COMMERCIAL	D	0.22	0.20	0.100	57	5.00

SUBAREA AVERAGE PERVIOUS LOSS RATE, F_p (INCH/HR) = 0.20

SUBAREA AVERAGE PERVIOUS AREA FRACTION, A_p = 0.100

SUBAREA RUNOFF(CFS) = 0.44

TOTAL AREA(ACRES) = 0.22 PEAK FLOW RATE(CFS) = 0.44

FLOW PROCESS FROM NODE 500.00 TO NODE 501.00 IS CODE = 21

>>>>RATIONAL METHOD INITIAL SUBAREA ANALYSIS<<<<<
>>USE TIME-OF-CONCENTRATION NOMOGRAPH FOR INITIAL SUBAREA<<

=====

INITIAL SUBAREA FLOW-LENGTH(FEET) = 30.00
ELEVATION DATA: UPSTREAM(FEET) = 391.30 DOWNSTREAM(FEET) = 390.65

$T_c = K * [(LENGTH ** 3.00) / (ELEVATION CHANGE)] ** 0.20$

SUBAREA ANALYSIS USED MINIMUM T_c (MIN.) = 5.000

* 2 YEAR RAINFALL INTENSITY(INCH/HR) = 2.264

SUBAREA T_c AND LOSS RATE DATA(AMC I):

DEVELOPMENT TYPE/ LAND USE	SCS SOIL GROUP	AREA (ACRES)	F_p (INCH/HR)	A_p (DECIMAL)	SCS CN	T_c (MIN.)
COMMERCIAL	D	0.04	0.20	0.100	57	5.00

SUBAREA AVERAGE PERVIOUS LOSS RATE, F_p (INCH/HR) = 0.20

SUBAREA AVERAGE PERVIOUS AREA FRACTION, A_p = 0.100

SUBAREA RUNOFF(CFS) = 0.08

TOTAL AREA(ACRES) = 0.04 PEAK FLOW RATE(CFS) = 0.08

=====

END OF STUDY SUMMARY:

TOTAL AREA(ACRES) = 0.0 TC(MIN.) = 5.00

EFFECTIVE AREA(ACRES) = 0.04 AREA-AVERAGED F_m (INCH/HR) = 0.02

AREA-AVERAGED F_p (INCH/HR) = 0.20 AREA-AVERAGED A_p = 0.100

PEAK FLOW RATE(CFS) = 0.08

=====

END OF RATIONAL METHOD ANALYSIS



RATIONAL METHOD HYDROLOGY COMPUTER PROGRAM PACKAGE
(Reference: 1986 ORANGE COUNTY HYDROLOGY CRITERION)
(c) Copyright 1983-2012 Advanced Engineering Software (aes)
Ver. 18.2 Release Date: 05/08/2012 License ID 1537

***** DESCRIPTION OF STUDY *****

* IN-N-OUT 18181 IMPERIAL HWY *
* 25-YR HYDROLOGY ANALYSIS *
* *

FILE NAME: PRE18021.DAT
TIME/DATE OF STUDY: 13:01 12/17/2018

=====

USER SPECIFIED HYDROLOGY AND HYDRAULIC MODEL INFORMATION:

=====

--*TIME-OF-CONCENTRATION MODEL*--

USER SPECIFIED STORM EVENT(YEAR) = 25.00
SPECIFIED MINIMUM PIPE SIZE(INCH) = 12.00
SPECIFIED PERCENT OF GRADIENTS(DECIMAL) TO USE FOR FRICTION SLOPE = 0.01
DATA BANK RAINFALL USED
ANTECEDENT MOISTURE CONDITION (AMC) I ASSUMED FOR RATIONAL METHOD

USER-DEFINED STREET-SECTIONS FOR COUPLED PIPEFLOW AND STREETFLOW MODEL

NO.	HALF- WIDTH (FT)	CROWN TO CROSSFALL (FT)	STREET-CROSSFALL: IN- / OUT-/PARK- SIDE / SIDE/ WAY	CURB HEIGHT (FT)	GUTTER-GEOMETRIES: WIDTH LIP HIKE (FT) (FT) (FT)	MANNING FACTOR (n)
1	30.0	20.0	0.018/0.018/0.020	0.67	2.00 0.0312 0.167	0.0150

GLOBAL STREET FLOW-DEPTH CONSTRAINTS:

1. Relative Flow-Depth = 0.00 FEET
as (Maximum Allowable Street Flow Depth) - (Top-of-Curb)
2. (Depth)*(Velocity) Constraint = 6.0 (FT*FT/S)

*SIZE PIPE WITH A FLOW CAPACITY GREATER THAN
OR EQUAL TO THE UPSTREAM TRIBUTARY PIPE.*

*USER-SPECIFIED MINIMUM TOPOGRAPHIC SLOPE ADJUSTMENT NOT SELECTED

FLOW PROCESS FROM NODE 100.00 TO NODE 101.00 IS CODE = 21

>>>>RATIONAL METHOD INITIAL SUBAREA ANALYSIS<<<<<
>>USE TIME-OF-CONCENTRATION NOMOGRAPH FOR INITIAL SUBAREA<<

=====

INITIAL SUBAREA FLOW-LENGTH(FEET) = 184.00
ELEVATION DATA: UPSTREAM(FEET) = 385.06 DOWNSTREAM(FEET) = 379.41

$T_c = K * [(LENGTH ** 3.00) / (ELEVATION CHANGE)] ** 0.20$
 SUBAREA ANALYSIS USED MINIMUM $T_c(MIN.) = 5.000$
 * 25 YEAR RAINFALL INTENSITY(INCH/HR) = 4.824
 SUBAREA T_c AND LOSS RATE DATA(AMC I):

DEVELOPMENT TYPE/ LAND USE	SCS SOIL GROUP	AREA (ACRES)	F_p (INCH/HR)	A_p (DECIMAL)	SCS CN	T_c (MIN.)
COMMERCIAL	D	0.30	0.20	0.100	57	5.00

 SUBAREA AVERAGE PERVIOUS LOSS RATE, $F_p(INCH/HR) = 0.20$
 SUBAREA AVERAGE PERVIOUS AREA FRACTION, $A_p = 0.100$
 SUBAREA RUNOFF(CFS) = 1.29
 TOTAL AREA(ACRES) = 0.30 PEAK FLOW RATE(CFS) = 1.29

FLOW PROCESS FROM NODE 400.00 TO NODE 401.00 IS CODE = 21

>>>>RATIONAL METHOD INITIAL SUBAREA ANALYSIS<<<<<
 >>USE TIME-OF-CONCENTRATION NOMOGRAPH FOR INITIAL SUBAREA<<

=====
 INITIAL SUBAREA FLOW-LENGTH(FEET) = 109.00
 ELEVATION DATA: UPSTREAM(FEET) = 392.60 DOWNSTREAM(FEET) = 389.35

$T_c = K * [(LENGTH ** 3.00) / (ELEVATION CHANGE)] ** 0.20$
 SUBAREA ANALYSIS USED MINIMUM $T_c(MIN.) = 5.000$
 * 25 YEAR RAINFALL INTENSITY(INCH/HR) = 4.824
 SUBAREA T_c AND LOSS RATE DATA(AMC I):

DEVELOPMENT TYPE/ LAND USE	SCS SOIL GROUP	AREA (ACRES)	F_p (INCH/HR)	A_p (DECIMAL)	SCS CN	T_c (MIN.)
COMMERCIAL	D	0.24	0.20	0.100	57	5.00

 SUBAREA AVERAGE PERVIOUS LOSS RATE, $F_p(INCH/HR) = 0.20$
 SUBAREA AVERAGE PERVIOUS AREA FRACTION, $A_p = 0.100$
 SUBAREA RUNOFF(CFS) = 1.03
 TOTAL AREA(ACRES) = 0.24 PEAK FLOW RATE(CFS) = 1.03

FLOW PROCESS FROM NODE 200.00 TO NODE 201.00 IS CODE = 81

>>>>ADDITION OF SUBAREA TO MAINLINE PEAK FLOW<<<<<

=====
 MAINLINE $T_c(MIN.) = 5.00$
 * 25 YEAR RAINFALL INTENSITY(INCH/HR) = 4.824
 SUBAREA LOSS RATE DATA(AMC I):

DEVELOPMENT TYPE/ LAND USE	SCS SOIL GROUP	AREA (ACRES)	F_p (INCH/HR)	A_p (DECIMAL)	SCS CN
COMMERCIAL	D	0.75	0.20	0.100	57

 SUBAREA AVERAGE PERVIOUS LOSS RATE, $F_p(INCH/HR) = 0.20$
 SUBAREA AVERAGE PERVIOUS AREA FRACTION, $A_p = 0.100$
 SUBAREA AREA(ACRES) = 0.75 SUBAREA RUNOFF(CFS) = 3.25
 EFFECTIVE AREA(ACRES) = 0.99 AREA-AVERAGED $F_m(INCH/HR) = 0.02$
 AREA-AVERAGED $F_p(INCH/HR) = 0.20$ AREA-AVERAGED $A_p = 0.10$
 TOTAL AREA(ACRES) = 1.0 PEAK FLOW RATE(CFS) = 4.28

FLOW PROCESS FROM NODE 300.00 TO NODE 301.00 IS CODE = 21

>>>>RATIONAL METHOD INITIAL SUBAREA ANALYSIS<<<<<
>>USE TIME-OF-CONCENTRATION NOMOGRAPH FOR INITIAL SUBAREA<<

=====

INITIAL SUBAREA FLOW-LENGTH(FEET) = 9.00
ELEVATION DATA: UPSTREAM(FEET) = 391.60 DOWNSTREAM(FEET) = 390.90

$T_c = K * [(LENGTH ** 3.00) / (ELEVATION CHANGE)] ** 0.20$

SUBAREA ANALYSIS USED MINIMUM T_c (MIN.) = 5.000

* 25 YEAR RAINFALL INTENSITY(INCH/HR) = 4.824

SUBAREA T_c AND LOSS RATE DATA(AMC I):

DEVELOPMENT TYPE/ LAND USE	SCS SOIL GROUP	AREA (ACRES)	Fp (INCH/HR)	Ap (DECIMAL)	SCS CN	T_c (MIN.)
COMMERCIAL	D	0.22	0.20	0.100	57	5.00

SUBAREA AVERAGE PERVIOUS LOSS RATE, F_p (INCH/HR) = 0.20

SUBAREA AVERAGE PERVIOUS AREA FRACTION, A_p = 0.100

SUBAREA RUNOFF(CFS) = 0.93

TOTAL AREA(ACRES) = 0.22 PEAK FLOW RATE(CFS) = 0.93

FLOW PROCESS FROM NODE 500.00 TO NODE 501.00 IS CODE = 21

>>>>RATIONAL METHOD INITIAL SUBAREA ANALYSIS<<<<<
>>USE TIME-OF-CONCENTRATION NOMOGRAPH FOR INITIAL SUBAREA<<

=====

INITIAL SUBAREA FLOW-LENGTH(FEET) = 30.00
ELEVATION DATA: UPSTREAM(FEET) = 391.30 DOWNSTREAM(FEET) = 390.65

$T_c = K * [(LENGTH ** 3.00) / (ELEVATION CHANGE)] ** 0.20$

SUBAREA ANALYSIS USED MINIMUM T_c (MIN.) = 5.000

* 25 YEAR RAINFALL INTENSITY(INCH/HR) = 4.824

SUBAREA T_c AND LOSS RATE DATA(AMC I):

DEVELOPMENT TYPE/ LAND USE	SCS SOIL GROUP	AREA (ACRES)	Fp (INCH/HR)	Ap (DECIMAL)	SCS CN	T_c (MIN.)
COMMERCIAL	D	0.04	0.20	0.100	57	5.00

SUBAREA AVERAGE PERVIOUS LOSS RATE, F_p (INCH/HR) = 0.20

SUBAREA AVERAGE PERVIOUS AREA FRACTION, A_p = 0.100

SUBAREA RUNOFF(CFS) = 0.18

TOTAL AREA(ACRES) = 0.04 PEAK FLOW RATE(CFS) = 0.18

=====

END OF STUDY SUMMARY:

TOTAL AREA(ACRES) = 0.0 T_c (MIN.) = 5.00

EFFECTIVE AREA(ACRES) = 0.04 AREA-AVERAGED F_m (INCH/HR) = 0.02

AREA-AVERAGED F_p (INCH/HR) = 0.20 AREA-AVERAGED A_p = 0.100

PEAK FLOW RATE(CFS) = 0.18

=====

END OF RATIONAL METHOD ANALYSIS



RATIONAL METHOD HYDROLOGY COMPUTER PROGRAM PACKAGE
(Reference: 1986 ORANGE COUNTY HYDROLOGY CRITERION)
(c) Copyright 1983-2012 Advanced Engineering Software (aes)
Ver. 18.2 Release Date: 05/08/2012 License ID 1537

Analysis prepared by:

***** DESCRIPTION OF STUDY *****

* IN-N-OUT BURGER, 18181 IMPERIAL HWY, YORBA LINDA, CA *
* 2YR POST HYDROLOGY ANALYSIS *
* *

FILE NAME: IN018021.DAT
TIME/DATE OF STUDY: 10:46 08/06/2019

=====

USER SPECIFIED HYDROLOGY AND HYDRAULIC MODEL INFORMATION:

=====

--*TIME-OF-CONCENTRATION MODEL*--

USER SPECIFIED STORM EVENT(YEAR) = 2.00
SPECIFIED MINIMUM PIPE SIZE(INCH) = 12.00
SPECIFIED PERCENT OF GRADIENTS(DECIMAL) TO USE FOR FRICTION SLOPE = 0.95
DATA BANK RAINFALL USED
ANTECEDENT MOISTURE CONDITION (AMC) I ASSUMED FOR RATIONAL METHOD

USER-DEFINED STREET-SECTIONS FOR COUPLED PIPEFLOW AND STREETFLOW MODEL

NO.	HALF- WIDTH (FT)	CROWN TO CROSSFALL (FT)	STREET-CROSSFALL: IN- / OUT-/PARK- SIDE / SIDE/ WAY	CURB HEIGHT (FT)	GUTTER-GEOMETRIES: WIDTH LIP HIKE (FT) (FT) (FT)	MANNING FACTOR (n)
1	30.0	20.0	0.018/0.018/0.020	0.67	2.00 0.0312 0.167	0.0150

GLOBAL STREET FLOW-DEPTH CONSTRAINTS:

1. Relative Flow-Depth = 0.00 FEET
as (Maximum Allowable Street Flow Depth) - (Top-of-Curb)
2. (Depth)*(Velocity) Constraint = 6.0 (FT*FT/S)

*SIZE PIPE WITH A FLOW CAPACITY GREATER THAN
OR EQUAL TO THE UPSTREAM TRIBUTARY PIPE.*

*USER-SPECIFIED MINIMUM TOPOGRAPHIC SLOPE ADJUSTMENT NOT SELECTED

FLOW PROCESS FROM NODE 100.00 TO NODE 101.00 IS CODE = 21

>>>>RATIONAL METHOD INITIAL SUBAREA ANALYSIS<<<<<

>>USE TIME-OF-CONCENTRATION NOMOGRAPH FOR INITIAL SUBAREA<<

=====

INITIAL SUBAREA FLOW-LENGTH(FEET) = 573.00

ELEVATION DATA: UPSTREAM(FEET) = 390.50 DOWNSTREAM(FEET) = 379.79

$T_c = K * [(LENGTH ** 3.00) / (ELEVATION CHANGE)] ** 0.20$

SUBAREA ANALYSIS USED MINIMUM T_c (MIN.) = 8.547

* 2 YEAR RAINFALL INTENSITY(INCH/HR) = 1.664

SUBAREA T_c AND LOSS RATE DATA(AMC I):

DEVELOPMENT TYPE/ LAND USE	SCS SOIL GROUP	AREA (ACRES)	Fp (INCH/HR)	Ap (DECIMAL)	SCS CN	T_c (MIN.)
COMMERCIAL	D	0.43	0.20	0.100	57	8.55

SUBAREA AVERAGE PERVIOUS LOSS RATE, F_p (INCH/HR) = 0.20

SUBAREA AVERAGE PERVIOUS AREA FRACTION, A_p = 0.100

SUBAREA RUNOFF(CFS) = 0.63

TOTAL AREA(ACRES) = 0.43 PEAK FLOW RATE(CFS) = 0.63

FLOW PROCESS FROM NODE 200.00 TO NODE 201.00 IS CODE = 21

>>>>RATIONAL METHOD INITIAL SUBAREA ANALYSIS<<<<<

>>USE TIME-OF-CONCENTRATION NOMOGRAPH FOR INITIAL SUBAREA<<

=====

INITIAL SUBAREA FLOW-LENGTH(FEET) = 157.00

ELEVATION DATA: UPSTREAM(FEET) = 387.96 DOWNSTREAM(FEET) = 380.77

$T_c = K * [(LENGTH ** 3.00) / (ELEVATION CHANGE)] ** 0.20$

SUBAREA ANALYSIS USED MINIMUM T_c (MIN.) = 5.000

* 2 YEAR RAINFALL INTENSITY(INCH/HR) = 2.264

SUBAREA T_c AND LOSS RATE DATA(AMC I):

DEVELOPMENT TYPE/ LAND USE	SCS SOIL GROUP	AREA (ACRES)	Fp (INCH/HR)	Ap (DECIMAL)	SCS CN	T_c (MIN.)
COMMERCIAL	D	0.27	0.20	0.100	57	5.00

SUBAREA AVERAGE PERVIOUS LOSS RATE, F_p (INCH/HR) = 0.20

SUBAREA AVERAGE PERVIOUS AREA FRACTION, A_p = 0.100

SUBAREA RUNOFF(CFS) = 0.55

TOTAL AREA(ACRES) = 0.27 PEAK FLOW RATE(CFS) = 0.55

FLOW PROCESS FROM NODE 300.00 TO NODE 301.00 IS CODE = 21

>>>>RATIONAL METHOD INITIAL SUBAREA ANALYSIS<<<<<

>>USE TIME-OF-CONCENTRATION NOMOGRAPH FOR INITIAL SUBAREA<<

=====

INITIAL SUBAREA FLOW-LENGTH(FEET) = 217.00

ELEVATION DATA: UPSTREAM(FEET) = 391.17 DOWNSTREAM(FEET) = 381.55

$T_c = K * [(LENGTH ** 3.00) / (ELEVATION CHANGE)] ** 0.20$

SUBAREA ANALYSIS USED MINIMUM Tc(MIN.) = 5.000
 * 2 YEAR RAINFALL INTENSITY(INCH/HR) = 2.264
 SUBAREA Tc AND LOSS RATE DATA(AMC I):

DEVELOPMENT TYPE/ LAND USE	SCS SOIL GROUP	AREA (ACRES)	Fp (INCH/HR)	Ap (DECIMAL)	SCS CN	Tc (MIN.)
COMMERCIAL	D	0.30	0.20	0.100	57	5.00

 SUBAREA AVERAGE PERVIOUS LOSS RATE, Fp(INCH/HR) = 0.20
 SUBAREA AVERAGE PERVIOUS AREA FRACTION, Ap = 0.100
 SUBAREA RUNOFF(CFS) = 0.61
 TOTAL AREA(ACRES) = 0.30 PEAK FLOW RATE(CFS) = 0.61

FLOW PROCESS FROM NODE 400.00 TO NODE 401.00 IS CODE = 21

>>>>RATIONAL METHOD INITIAL SUBAREA ANALYSIS<<<<<
 >>USE TIME-OF-CONCENTRATION NOMOGRAPH FOR INITIAL SUBAREA<<

=====

INITIAL SUBAREA FLOW-LENGTH(FEET) = 107.00
 ELEVATION DATA: UPSTREAM(FEET) = 391.79 DOWNSTREAM(FEET) = 387.50

$T_c = K * [(LENGTH ** 3.00) / (ELEVATION CHANGE)] ** 0.20$
 SUBAREA ANALYSIS USED MINIMUM Tc(MIN.) = 5.000
 * 2 YEAR RAINFALL INTENSITY(INCH/HR) = 2.264
 SUBAREA Tc AND LOSS RATE DATA(AMC I):

DEVELOPMENT TYPE/ LAND USE	SCS SOIL GROUP	AREA (ACRES)	Fp (INCH/HR)	Ap (DECIMAL)	SCS CN	Tc (MIN.)
COMMERCIAL	D	0.11	0.20	0.100	57	5.00

 SUBAREA AVERAGE PERVIOUS LOSS RATE, Fp(INCH/HR) = 0.20
 SUBAREA AVERAGE PERVIOUS AREA FRACTION, Ap = 0.100
 SUBAREA RUNOFF(CFS) = 0.22
 TOTAL AREA(ACRES) = 0.11 PEAK FLOW RATE(CFS) = 0.22

FLOW PROCESS FROM NODE 500.00 TO NODE 501.00 IS CODE = 21

>>>>RATIONAL METHOD INITIAL SUBAREA ANALYSIS<<<<<
 >>USE TIME-OF-CONCENTRATION NOMOGRAPH FOR INITIAL SUBAREA<<

=====

INITIAL SUBAREA FLOW-LENGTH(FEET) = 62.00
 ELEVATION DATA: UPSTREAM(FEET) = 391.97 DOWNSTREAM(FEET) = 389.12

$T_c = K * [(LENGTH ** 3.00) / (ELEVATION CHANGE)] ** 0.20$
 SUBAREA ANALYSIS USED MINIMUM Tc(MIN.) = 5.000
 * 2 YEAR RAINFALL INTENSITY(INCH/HR) = 2.264
 SUBAREA Tc AND LOSS RATE DATA(AMC I):

DEVELOPMENT TYPE/ LAND USE	SCS SOIL GROUP	AREA (ACRES)	Fp (INCH/HR)	Ap (DECIMAL)	SCS CN	Tc (MIN.)
COMMERCIAL	D	0.09	0.20	0.100	57	5.00

 SUBAREA AVERAGE PERVIOUS LOSS RATE, Fp(INCH/HR) = 0.20
 SUBAREA AVERAGE PERVIOUS AREA FRACTION, Ap = 0.100

SUBAREA RUNOFF(CFS) = 0.18
TOTAL AREA(ACRES) = 0.09 PEAK FLOW RATE(CFS) = 0.18

FLOW PROCESS FROM NODE 100.00 TO NODE 601.00 IS CODE = 21

>>>>RATIONAL METHOD INITIAL SUBAREA ANALYSIS<<<<<
>>USE TIME-OF-CONCENTRATION NOMOGRAPH FOR INITIAL SUBAREA<<

=====

INITIAL SUBAREA FLOW-LENGTH(FEET) = 67.00
ELEVATION DATA: UPSTREAM(FEET) = 390.50 DOWNSTREAM(FEET) = 390.02

$T_c = K * [(LENGTH ** 3.00) / (ELEVATION CHANGE)] ** 0.20$
SUBAREA ANALYSIS USED MINIMUM T_c (MIN.) = 6.972
* 2 YEAR RAINFALL INTENSITY(INCH/HR) = 1.870
SUBAREA T_c AND LOSS RATE DATA(AMC I):

DEVELOPMENT TYPE/ LAND USE	SCS SOIL GROUP	AREA (ACRES)	Fp (INCH/HR)	Ap (DECIMAL)	SCS CN	T_c (MIN.)
PUBLIC PARK	D	0.06	0.20	0.850	57	6.97

SUBAREA AVERAGE PERVIOUS LOSS RATE, F_p (INCH/HR) = 0.20
SUBAREA AVERAGE PERVIOUS AREA FRACTION, A_p = 0.850
SUBAREA RUNOFF(CFS) = 0.09
TOTAL AREA(ACRES) = 0.06 PEAK FLOW RATE(CFS) = 0.09

FLOW PROCESS FROM NODE 700.00 TO NODE 701.00 IS CODE = 21

>>>>RATIONAL METHOD INITIAL SUBAREA ANALYSIS<<<<<
>>USE TIME-OF-CONCENTRATION NOMOGRAPH FOR INITIAL SUBAREA<<

=====

INITIAL SUBAREA FLOW-LENGTH(FEET) = 71.00
ELEVATION DATA: UPSTREAM(FEET) = 382.87 DOWNSTREAM(FEET) = 376.79

$T_c = K * [(LENGTH ** 3.00) / (ELEVATION CHANGE)] ** 0.20$
SUBAREA ANALYSIS USED MINIMUM T_c (MIN.) = 5.000
* 2 YEAR RAINFALL INTENSITY(INCH/HR) = 2.264
SUBAREA T_c AND LOSS RATE DATA(AMC I):

DEVELOPMENT TYPE/ LAND USE	SCS SOIL GROUP	AREA (ACRES)	Fp (INCH/HR)	Ap (DECIMAL)	SCS CN	T_c (MIN.)
PUBLIC PARK	D	0.12	0.20	0.850	57	5.00

SUBAREA AVERAGE PERVIOUS LOSS RATE, F_p (INCH/HR) = 0.20
SUBAREA AVERAGE PERVIOUS AREA FRACTION, A_p = 0.850
SUBAREA RUNOFF(CFS) = 0.22
TOTAL AREA(ACRES) = 0.12 PEAK FLOW RATE(CFS) = 0.22

FLOW PROCESS FROM NODE 800.00 TO NODE 801.00 IS CODE = 21

>>>>RATIONAL METHOD INITIAL SUBAREA ANALYSIS<<<<<
>>USE TIME-OF-CONCENTRATION NOMOGRAPH FOR INITIAL SUBAREA<<

=====

INITIAL SUBAREA FLOW-LENGTH(FEET) = 47.00
ELEVATION DATA: UPSTREAM(FEET) = 390.60 DOWNSTREAM(FEET) = 390.20

$T_c = K * [(LENGTH ** 3.00) / (ELEVATION\ CHANGE)] ** 0.20$

SUBAREA ANALYSIS USED MINIMUM T_c (MIN.) = 5.845

* 2 YEAR RAINFALL INTENSITY(INCH/HR) = 2.070

SUBAREA T_c AND LOSS RATE DATA(AMC I):

DEVELOPMENT TYPE/ LAND USE	SCS SOIL GROUP	AREA (ACRES)	F_p (INCH/HR)	A_p (DECIMAL)	SCS CN	T_c (MIN.)
PUBLIC PARK	D	0.15	0.20	0.850	57	5.85

SUBAREA AVERAGE PERVIOUS LOSS RATE, F_p (INCH/HR) = 0.20

SUBAREA AVERAGE PERVIOUS AREA FRACTION, A_p = 0.850

SUBAREA RUNOFF(CFS) = 0.26

TOTAL AREA(ACRES) = 0.15 PEAK FLOW RATE(CFS) = 0.26

=====

END OF STUDY SUMMARY:

TOTAL AREA(ACRES) = 0.2 T_c (MIN.) = 5.85

EFFECTIVE AREA(ACRES) = 0.15 AREA-AVERAGED F_m (INCH/HR) = 0.17

AREA-AVERAGED F_p (INCH/HR) = 0.20 AREA-AVERAGED A_p = 0.850

PEAK FLOW RATE(CFS) = 0.26

=====

END OF RATIONAL METHOD ANALYSIS

↑

RATIONAL METHOD HYDROLOGY COMPUTER PROGRAM PACKAGE
(Reference: 1986 ORANGE COUNTY HYDROLOGY CRITERION)
(c) Copyright 1983-2012 Advanced Engineering Software (aes)
Ver. 18.2 Release Date: 05/08/2012 License ID 1537

Analysis prepared by:

***** DESCRIPTION OF STUDY *****

* IN-N-OUT BURGER, 18181 IMPERIAL HWY, YORBA LINDA, CA *
* 25- YR POST HYDROLOGY ANALYSIS *
* *

FILE NAME: IN018021.DAT

TIME/DATE OF STUDY: 10:48 08/06/2019

=====

USER SPECIFIED HYDROLOGY AND HYDRAULIC MODEL INFORMATION:

=====

--*TIME-OF-CONCENTRATION MODEL*--

USER SPECIFIED STORM EVENT(YEAR) = 25.00

SPECIFIED MINIMUM PIPE SIZE(INCH) = 12.00

SPECIFIED PERCENT OF GRADIENTS(DECIMAL) TO USE FOR FRICTION SLOPE = 0.95

DATA BANK RAINFALL USED

ANTECEDENT MOISTURE CONDITION (AMC) I ASSUMED FOR RATIONAL METHOD

USER-DEFINED STREET-SECTIONS FOR COUPLED PIPEFLOW AND STREETFLOW MODEL

NO.	HALF- WIDTH (FT)	CROWN TO CROSSFALL (FT)	STREET-CROSSFALL: IN- / OUT-/PARK- SIDE / SIDE/ WAY	CURB HEIGHT (FT)	GUTTER-GEOMETRIES: WIDTH LIP HIKE (FT) (FT) (FT)	MANNING FACTOR (n)
1	30.0	20.0	0.018/0.018/0.020	0.67	2.00 0.0312 0.167	0.0150

GLOBAL STREET FLOW-DEPTH CONSTRAINTS:

1. Relative Flow-Depth = 0.00 FEET

as (Maximum Allowable Street Flow Depth) - (Top-of-Curb)

2. (Depth)*(Velocity) Constraint = 6.0 (FT*FT/S)

*SIZE PIPE WITH A FLOW CAPACITY GREATER THAN

OR EQUAL TO THE UPSTREAM TRIBUTARY PIPE.*

*USER-SPECIFIED MINIMUM TOPOGRAPHIC SLOPE ADJUSTMENT NOT SELECTED

FLOW PROCESS FROM NODE 100.00 TO NODE 101.00 IS CODE = 21

>>>>RATIONAL METHOD INITIAL SUBAREA ANALYSIS<<<<<

>>USE TIME-OF-CONCENTRATION NOMOGRAPH FOR INITIAL SUBAREA<<

=====

INITIAL SUBAREA FLOW-LENGTH(FEET) = 573.00

ELEVATION DATA: UPSTREAM(FEET) = 390.50 DOWNSTREAM(FEET) = 379.79

$T_c = K * [(LENGTH ** 3.00) / (ELEVATION CHANGE)] ** 0.20$

SUBAREA ANALYSIS USED MINIMUM T_c (MIN.) = 8.547

* 25 YEAR RAINFALL INTENSITY(INCH/HR) = 3.561

SUBAREA T_c AND LOSS RATE DATA(AMC I):

DEVELOPMENT TYPE/ LAND USE	SCS SOIL GROUP	AREA (ACRES)	Fp (INCH/HR)	Ap (DECIMAL)	SCS CN	T_c (MIN.)
COMMERCIAL	D	0.43	0.20	0.100	57	8.55

SUBAREA AVERAGE PERVIOUS LOSS RATE, F_p (INCH/HR) = 0.20

SUBAREA AVERAGE PERVIOUS AREA FRACTION, A_p = 0.100

SUBAREA RUNOFF(CFS) = 1.35

TOTAL AREA(ACRES) = 0.43 PEAK FLOW RATE(CFS) = 1.35

FLOW PROCESS FROM NODE 200.00 TO NODE 201.00 IS CODE = 21

>>>>RATIONAL METHOD INITIAL SUBAREA ANALYSIS<<<<<

>>USE TIME-OF-CONCENTRATION NOMOGRAPH FOR INITIAL SUBAREA<<

=====

INITIAL SUBAREA FLOW-LENGTH(FEET) = 157.00

ELEVATION DATA: UPSTREAM(FEET) = 387.96 DOWNSTREAM(FEET) = 380.77

$T_c = K * [(LENGTH ** 3.00) / (ELEVATION CHANGE)] ** 0.20$

SUBAREA ANALYSIS USED MINIMUM T_c (MIN.) = 5.000

* 25 YEAR RAINFALL INTENSITY(INCH/HR) = 4.824

SUBAREA T_c AND LOSS RATE DATA(AMC I):

DEVELOPMENT TYPE/ LAND USE	SCS SOIL GROUP	AREA (ACRES)	Fp (INCH/HR)	Ap (DECIMAL)	SCS CN	T_c (MIN.)
COMMERCIAL	D	0.27	0.20	0.100	57	5.00

SUBAREA AVERAGE PERVIOUS LOSS RATE, F_p (INCH/HR) = 0.20

SUBAREA AVERAGE PERVIOUS AREA FRACTION, A_p = 0.100

SUBAREA RUNOFF(CFS) = 1.18

TOTAL AREA(ACRES) = 0.27 PEAK FLOW RATE(CFS) = 1.18

FLOW PROCESS FROM NODE 300.00 TO NODE 301.00 IS CODE = 21

>>>>RATIONAL METHOD INITIAL SUBAREA ANALYSIS<<<<<

>>USE TIME-OF-CONCENTRATION NOMOGRAPH FOR INITIAL SUBAREA<<

=====

INITIAL SUBAREA FLOW-LENGTH(FEET) = 217.00

ELEVATION DATA: UPSTREAM(FEET) = 391.17 DOWNSTREAM(FEET) = 381.55

$T_c = K * [(LENGTH ** 3.00) / (ELEVATION CHANGE)] ** 0.20$

SUBAREA ANALYSIS USED MINIMUM Tc(MIN.) = 5.000
 * 25 YEAR RAINFALL INTENSITY(INCH/HR) = 4.824
 SUBAREA Tc AND LOSS RATE DATA(AMC I):

DEVELOPMENT TYPE/ LAND USE	SCS SOIL GROUP	AREA (ACRES)	Fp (INCH/HR)	Ap (DECIMAL)	SCS CN	Tc (MIN.)
COMMERCIAL	D	0.30	0.20	0.100	57	5.00

 SUBAREA AVERAGE PERVIOUS LOSS RATE, Fp(INCH/HR) = 0.20
 SUBAREA AVERAGE PERVIOUS AREA FRACTION, Ap = 0.100
 SUBAREA RUNOFF(CFS) = 1.30
 TOTAL AREA(ACRES) = 0.30 PEAK FLOW RATE(CFS) = 1.30

FLOW PROCESS FROM NODE 400.00 TO NODE 401.00 IS CODE = 21

>>>>RATIONAL METHOD INITIAL SUBAREA ANALYSIS<<<<<
 >>USE TIME-OF-CONCENTRATION NOMOGRAPH FOR INITIAL SUBAREA<<

=====

INITIAL SUBAREA FLOW-LENGTH(FEET) = 107.00
 ELEVATION DATA: UPSTREAM(FEET) = 391.79 DOWNSTREAM(FEET) = 387.50

$T_c = K * [(LENGTH ** 3.00) / (ELEVATION CHANGE)] ** 0.20$
 SUBAREA ANALYSIS USED MINIMUM Tc(MIN.) = 5.000
 * 25 YEAR RAINFALL INTENSITY(INCH/HR) = 4.824
 SUBAREA Tc AND LOSS RATE DATA(AMC I):

DEVELOPMENT TYPE/ LAND USE	SCS SOIL GROUP	AREA (ACRES)	Fp (INCH/HR)	Ap (DECIMAL)	SCS CN	Tc (MIN.)
COMMERCIAL	D	0.11	0.20	0.100	57	5.00

 SUBAREA AVERAGE PERVIOUS LOSS RATE, Fp(INCH/HR) = 0.20
 SUBAREA AVERAGE PERVIOUS AREA FRACTION, Ap = 0.100
 SUBAREA RUNOFF(CFS) = 0.46
 TOTAL AREA(ACRES) = 0.11 PEAK FLOW RATE(CFS) = 0.46

FLOW PROCESS FROM NODE 500.00 TO NODE 501.00 IS CODE = 21

>>>>RATIONAL METHOD INITIAL SUBAREA ANALYSIS<<<<<
 >>USE TIME-OF-CONCENTRATION NOMOGRAPH FOR INITIAL SUBAREA<<

=====

INITIAL SUBAREA FLOW-LENGTH(FEET) = 62.00
 ELEVATION DATA: UPSTREAM(FEET) = 391.97 DOWNSTREAM(FEET) = 389.12

$T_c = K * [(LENGTH ** 3.00) / (ELEVATION CHANGE)] ** 0.20$
 SUBAREA ANALYSIS USED MINIMUM Tc(MIN.) = 5.000
 * 25 YEAR RAINFALL INTENSITY(INCH/HR) = 4.824
 SUBAREA Tc AND LOSS RATE DATA(AMC I):

DEVELOPMENT TYPE/ LAND USE	SCS SOIL GROUP	AREA (ACRES)	Fp (INCH/HR)	Ap (DECIMAL)	SCS CN	Tc (MIN.)
COMMERCIAL	D	0.09	0.20	0.100	57	5.00

 SUBAREA AVERAGE PERVIOUS LOSS RATE, Fp(INCH/HR) = 0.20
 SUBAREA AVERAGE PERVIOUS AREA FRACTION, Ap = 0.100

SUBAREA RUNOFF(CFS) = 0.38
TOTAL AREA(ACRES) = 0.09 PEAK FLOW RATE(CFS) = 0.38

FLOW PROCESS FROM NODE 100.00 TO NODE 601.00 IS CODE = 21

>>>>RATIONAL METHOD INITIAL SUBAREA ANALYSIS<<<<<
>>USE TIME-OF-CONCENTRATION NOMOGRAPH FOR INITIAL SUBAREA<<

=====

INITIAL SUBAREA FLOW-LENGTH(FEET) = 67.00
ELEVATION DATA: UPSTREAM(FEET) = 390.50 DOWNSTREAM(FEET) = 390.02

$T_c = K * [(LENGTH ** 3.00) / (ELEVATION CHANGE)] ** 0.20$
SUBAREA ANALYSIS USED MINIMUM T_c (MIN.) = 6.972
* 25 YEAR RAINFALL INTENSITY(INCH/HR) = 3.996
SUBAREA T_c AND LOSS RATE DATA(AMC I):

DEVELOPMENT TYPE/ LAND USE	SCS SOIL GROUP	AREA (ACRES)	Fp (INCH/HR)	Ap (DECIMAL)	SCS CN	T_c (MIN.)
PUBLIC PARK	D	0.06	0.20	0.850	57	6.97

SUBAREA AVERAGE PERVIOUS LOSS RATE, F_p (INCH/HR) = 0.20
SUBAREA AVERAGE PERVIOUS AREA FRACTION, A_p = 0.850
SUBAREA RUNOFF(CFS) = 0.19
TOTAL AREA(ACRES) = 0.06 PEAK FLOW RATE(CFS) = 0.19

FLOW PROCESS FROM NODE 700.00 TO NODE 701.00 IS CODE = 21

>>>>RATIONAL METHOD INITIAL SUBAREA ANALYSIS<<<<<
>>USE TIME-OF-CONCENTRATION NOMOGRAPH FOR INITIAL SUBAREA<<

=====

INITIAL SUBAREA FLOW-LENGTH(FEET) = 71.00
ELEVATION DATA: UPSTREAM(FEET) = 382.87 DOWNSTREAM(FEET) = 376.79

$T_c = K * [(LENGTH ** 3.00) / (ELEVATION CHANGE)] ** 0.20$
SUBAREA ANALYSIS USED MINIMUM T_c (MIN.) = 5.000
* 25 YEAR RAINFALL INTENSITY(INCH/HR) = 4.824
SUBAREA T_c AND LOSS RATE DATA(AMC I):

DEVELOPMENT TYPE/ LAND USE	SCS SOIL GROUP	AREA (ACRES)	Fp (INCH/HR)	Ap (DECIMAL)	SCS CN	T_c (MIN.)
PUBLIC PARK	D	0.12	0.20	0.850	57	5.00

SUBAREA AVERAGE PERVIOUS LOSS RATE, F_p (INCH/HR) = 0.20
SUBAREA AVERAGE PERVIOUS AREA FRACTION, A_p = 0.850
SUBAREA RUNOFF(CFS) = 0.49
TOTAL AREA(ACRES) = 0.12 PEAK FLOW RATE(CFS) = 0.49

FLOW PROCESS FROM NODE 800.00 TO NODE 801.00 IS CODE = 21

>>>>RATIONAL METHOD INITIAL SUBAREA ANALYSIS<<<<<
>>USE TIME-OF-CONCENTRATION NOMOGRAPH FOR INITIAL SUBAREA<<

=====

INITIAL SUBAREA FLOW-LENGTH(FEET) = 47.00
ELEVATION DATA: UPSTREAM(FEET) = 390.60 DOWNSTREAM(FEET) = 390.20

$T_c = K * [(LENGTH ** 3.00) / (ELEVATION CHANGE)] ** 0.20$

SUBAREA ANALYSIS USED MINIMUM T_c (MIN.) = 5.845

* 25 YEAR RAINFALL INTENSITY(INCH/HR) = 4.416

SUBAREA T_c AND LOSS RATE DATA(AMC I):

DEVELOPMENT TYPE/ LAND USE	SCS SOIL GROUP	AREA (ACRES)	F_p (INCH/HR)	A_p (DECIMAL)	SCS CN	T_c (MIN.)
PUBLIC PARK	D	0.15	0.20	0.850	57	5.85

SUBAREA AVERAGE PERVIOUS LOSS RATE, F_p (INCH/HR) = 0.20

SUBAREA AVERAGE PERVIOUS AREA FRACTION, A_p = 0.850

SUBAREA RUNOFF(CFS) = 0.58

TOTAL AREA(ACRES) = 0.15 PEAK FLOW RATE(CFS) = 0.58

=====

END OF STUDY SUMMARY:

TOTAL AREA(ACRES) = 0.2 T_c (MIN.) = 5.85

EFFECTIVE AREA(ACRES) = 0.15 AREA-AVERAGED F_m (INCH/HR) = 0.17

AREA-AVERAGED F_p (INCH/HR) = 0.20 AREA-AVERAGED A_p = 0.850

PEAK FLOW RATE(CFS) = 0.58

=====

END OF RATIONAL METHOD ANALYSIS

↑

SMALL AREA UNIT HYDROGRAPH MODEL

=====

(C) Copyright 1989-2012 Advanced Engineering Software (aes)
Ver. 19.0 Release Date: 06/01/2012 License ID 1537

Analysis prepared by:

Problem Descriptions:

2-yr Pre-Development Unit Hydrograph

RATIONAL METHOD CALIBRATION COEFFICIENT = 0.90
TOTAL CATCHMENT AREA(ACRES) = 1.54
SOIL-LOSS RATE, F_m , (INCH/HR) = 0.059
LOW LOSS FRACTION = 0.123
TIME OF CONCENTRATION(MIN.) = 5.00
SMALL AREA PEAK Q COMPUTED USING PEAK FLOW RATE FORMULA
USER SPECIFIED RAINFALL VALUES ARE USED
RETURN FREQUENCY(YEARS) = 2
5-MINUTE POINT RAINFALL VALUE(INCHES) = 0.17
30-MINUTE POINT RAINFALL VALUE(INCHES) = 0.39
1-HOUR POINT RAINFALL VALUE(INCHES) = 0.57
3-HOUR POINT RAINFALL VALUE(INCHES) = 1.03
6-HOUR POINT RAINFALL VALUE(INCHES) = 1.47
24-HOUR POINT RAINFALL VALUE(INCHES) = 2.61

TOTAL CATCHMENT RUNOFF VOLUME(ACRE-FEET) = 0.27
TOTAL CATCHMENT SOIL-LOSS VOLUME(ACRE-FEET) = 0.07

TIME (HOURS)	VOLUME (AF)	Q 0. (CFS)	2.5	5.0	7.5	10.0
0.08	0.0002	0.05 Q
0.17	0.0006	0.06 Q

0.25	0.0009	0.06	Q
0.33	0.0013	0.06	Q
0.42	0.0017	0.06	Q
0.50	0.0021	0.06	Q
0.58	0.0025	0.06	Q
0.67	0.0029	0.06	Q
0.75	0.0033	0.06	Q
0.83	0.0036	0.06	Q
0.92	0.0040	0.06	Q
1.00	0.0044	0.06	Q
1.08	0.0048	0.06	Q
1.17	0.0052	0.06	Q
1.25	0.0056	0.06	Q
1.33	0.0060	0.06	Q
1.42	0.0064	0.06	Q
1.50	0.0068	0.06	Q
1.58	0.0072	0.06	Q
1.67	0.0076	0.06	Q
1.75	0.0080	0.06	Q
1.83	0.0084	0.06	Q
1.92	0.0088	0.06	Q
2.00	0.0092	0.06	Q
2.08	0.0096	0.06	Q
2.17	0.0100	0.06	Q
2.25	0.0104	0.06	Q
2.33	0.0109	0.06	Q
2.42	0.0113	0.06	Q
2.50	0.0117	0.06	Q
2.58	0.0121	0.06	Q
2.67	0.0125	0.06	Q
2.75	0.0129	0.06	Q
2.83	0.0134	0.06	Q
2.92	0.0138	0.06	Q
3.00	0.0142	0.06	Q
3.08	0.0146	0.06	Q
3.17	0.0151	0.06	Q
3.25	0.0155	0.06	Q
3.33	0.0159	0.06	Q
3.42	0.0164	0.06	Q
3.50	0.0168	0.06	Q
3.58	0.0172	0.06	Q
3.67	0.0177	0.06	Q
3.75	0.0181	0.06	Q
3.83	0.0186	0.06	Q
3.92	0.0190	0.06	Q
4.00	0.0194	0.06	Q
4.08	0.0199	0.07	Q
4.17	0.0203	0.07	Q
4.25	0.0208	0.07	Q
4.33	0.0212	0.07	Q

4.42	0.0217	0.07	Q
4.50	0.0222	0.07	Q
4.58	0.0226	0.07	Q
4.67	0.0231	0.07	Q
4.75	0.0235	0.07	Q
4.83	0.0240	0.07	Q
4.92	0.0245	0.07	Q
5.00	0.0249	0.07	Q
5.08	0.0254	0.07	Q
5.17	0.0259	0.07	Q
5.25	0.0264	0.07	Q
5.33	0.0268	0.07	Q
5.42	0.0273	0.07	Q
5.50	0.0278	0.07	Q
5.58	0.0283	0.07	Q
5.67	0.0288	0.07	Q
5.75	0.0292	0.07	Q
5.83	0.0297	0.07	Q
5.92	0.0302	0.07	Q
6.00	0.0307	0.07	Q
6.08	0.0312	0.07	Q
6.17	0.0317	0.07	Q
6.25	0.0322	0.07	Q
6.33	0.0327	0.07	Q
6.42	0.0332	0.07	Q
6.50	0.0337	0.07	Q
6.58	0.0343	0.07	Q
6.67	0.0348	0.07	Q
6.75	0.0353	0.08	Q
6.83	0.0358	0.08	Q
6.92	0.0363	0.08	Q
7.00	0.0369	0.08	Q
7.08	0.0374	0.08	Q
7.17	0.0379	0.08	Q
7.25	0.0385	0.08	Q
7.33	0.0390	0.08	Q
7.42	0.0395	0.08	Q
7.50	0.0401	0.08	Q
7.58	0.0406	0.08	Q
7.67	0.0412	0.08	Q
7.75	0.0417	0.08	Q
7.83	0.0423	0.08	Q
7.92	0.0428	0.08	Q
8.00	0.0434	0.08	Q
8.08	0.0440	0.08	Q
8.17	0.0445	0.08	Q
8.25	0.0451	0.08	Q
8.33	0.0457	0.08	Q
8.42	0.0463	0.08	Q
8.50	0.0469	0.09	Q

8.58	0.0475	0.09	Q
8.67	0.0480	0.09	Q
8.75	0.0486	0.09	Q
8.83	0.0492	0.09	Q
8.92	0.0498	0.09	Q
9.00	0.0505	0.09	Q
9.08	0.0511	0.09	Q
9.17	0.0517	0.09	Q
9.25	0.0523	0.09	Q
9.33	0.0529	0.09	Q
9.42	0.0536	0.09	Q
9.50	0.0542	0.09	Q
9.58	0.0548	0.09	Q
9.67	0.0555	0.09	Q
9.75	0.0561	0.09	Q
9.83	0.0568	0.10	Q
9.92	0.0574	0.10	Q
10.00	0.0581	0.10	Q
10.08	0.0588	0.10	Q
10.17	0.0595	0.10	Q
10.25	0.0601	0.10	Q
10.33	0.0608	0.10	Q
10.42	0.0615	0.10	Q
10.50	0.0622	0.10	Q
10.58	0.0629	0.10	Q
10.67	0.0636	0.10	Q
10.75	0.0643	0.10	Q
10.83	0.0651	0.11	Q
10.92	0.0658	0.11	Q
11.00	0.0665	0.11	Q
11.08	0.0673	0.11	Q
11.17	0.0680	0.11	Q
11.25	0.0688	0.11	Q
11.33	0.0696	0.11	Q
11.42	0.0703	0.11	Q
11.50	0.0711	0.11	Q
11.58	0.0719	0.12	Q
11.67	0.0727	0.12	Q
11.75	0.0735	0.12	Q
11.83	0.0743	0.12	Q
11.92	0.0752	0.12	Q
12.00	0.0760	0.12	Q
12.08	0.0770	0.15	Q
12.17	0.0780	0.15	Q
12.25	0.0791	0.16	Q
12.33	0.0802	0.16	Q
12.42	0.0813	0.16	Q
12.50	0.0824	0.16	Q
12.58	0.0835	0.16	Q
12.67	0.0847	0.17	Q

12.75	0.0858	0.17	Q
12.83	0.0870	0.17	Q
12.92	0.0881	0.17	Q
13.00	0.0893	0.17	Q
13.08	0.0905	0.18	Q
13.17	0.0918	0.18	Q
13.25	0.0930	0.18	Q
13.33	0.0943	0.18	Q
13.42	0.0956	0.19	Q
13.50	0.0969	0.19	Q
13.58	0.0982	0.19	Q
13.67	0.0995	0.20	Q
13.75	0.1009	0.20	Q
13.83	0.1023	0.20	Q
13.92	0.1037	0.21	Q
14.00	0.1051	0.21	Q
14.08	0.1066	0.23	Q
14.17	0.1082	0.23	Q
14.25	0.1099	0.24	Q
14.33	0.1115	0.24	Q
14.42	0.1132	0.25	Q
14.50	0.1150	0.25	.Q
14.58	0.1167	0.26	.Q
14.67	0.1186	0.27	.Q
14.75	0.1204	0.28	.Q
14.83	0.1224	0.28	.Q
14.92	0.1243	0.29	.Q
15.00	0.1264	0.30	.Q
15.08	0.1285	0.32	.Q
15.17	0.1307	0.33	.Q
15.25	0.1330	0.35	.Q
15.33	0.1355	0.36	.Q
15.42	0.1380	0.37	.Q
15.50	0.1405	0.38	.Q
15.58	0.1433	0.43	.Q
15.67	0.1464	0.45	.Q
15.75	0.1496	0.49	.Q
15.83	0.1531	0.54	. Q
15.92	0.1576	0.75	. Q
16.00	0.1637	1.02	. Q
16.08	0.1764	2.69	. Q
16.17	0.1878	0.62	. Q
16.25	0.1916	0.48	.Q
16.33	0.1947	0.40	.Q
16.42	0.1973	0.37	.Q
16.50	0.1997	0.33	.Q
16.58	0.2020	0.31	.Q
16.67	0.2040	0.29	.Q
16.75	0.2060	0.27	.Q
16.83	0.2078	0.26	.Q

16.92	0.2095	0.25	Q
17.00	0.2112	0.24	Q
17.08	0.2127	0.21	Q
17.17	0.2142	0.21	Q
17.25	0.2155	0.20	Q
17.33	0.2169	0.19	Q
17.42	0.2182	0.19	Q
17.50	0.2195	0.18	Q
17.58	0.2207	0.18	Q
17.67	0.2219	0.17	Q
17.75	0.2230	0.17	Q
17.83	0.2242	0.16	Q
17.92	0.2253	0.16	Q
18.00	0.2264	0.16	Q
18.08	0.2273	0.12	Q
18.17	0.2282	0.12	Q
18.25	0.2290	0.12	Q
18.33	0.2298	0.12	Q
18.42	0.2306	0.11	Q
18.50	0.2313	0.11	Q
18.58	0.2321	0.11	Q
18.67	0.2328	0.11	Q
18.75	0.2336	0.10	Q
18.83	0.2343	0.10	Q
18.92	0.2350	0.10	Q
19.00	0.2357	0.10	Q
19.08	0.2363	0.10	Q
19.17	0.2370	0.10	Q
19.25	0.2376	0.09	Q
19.33	0.2383	0.09	Q
19.42	0.2389	0.09	Q
19.50	0.2396	0.09	Q
19.58	0.2402	0.09	Q
19.67	0.2408	0.09	Q
19.75	0.2414	0.09	Q
19.83	0.2420	0.09	Q
19.92	0.2426	0.08	Q
20.00	0.2431	0.08	Q
20.08	0.2437	0.08	Q
20.17	0.2443	0.08	Q
20.25	0.2448	0.08	Q
20.33	0.2454	0.08	Q
20.42	0.2459	0.08	Q
20.50	0.2465	0.08	Q
20.58	0.2470	0.08	Q
20.67	0.2475	0.08	Q
20.75	0.2480	0.08	Q
20.83	0.2485	0.07	Q
20.92	0.2491	0.07	Q
21.00	0.2496	0.07	Q

21.08	0.2501	0.07	Q
21.17	0.2506	0.07	Q
21.25	0.2510	0.07	Q
21.33	0.2515	0.07	Q
21.42	0.2520	0.07	Q
21.50	0.2525	0.07	Q
21.58	0.2530	0.07	Q
21.67	0.2534	0.07	Q
21.75	0.2539	0.07	Q
21.83	0.2544	0.07	Q
21.92	0.2548	0.07	Q
22.00	0.2553	0.07	Q
22.08	0.2557	0.06	Q
22.17	0.2562	0.06	Q
22.25	0.2566	0.06	Q
22.33	0.2570	0.06	Q
22.42	0.2575	0.06	Q
22.50	0.2579	0.06	Q
22.58	0.2583	0.06	Q
22.67	0.2588	0.06	Q
22.75	0.2592	0.06	Q
22.83	0.2596	0.06	Q
22.92	0.2600	0.06	Q
23.00	0.2604	0.06	Q
23.08	0.2608	0.06	Q
23.17	0.2612	0.06	Q
23.25	0.2617	0.06	Q
23.33	0.2621	0.06	Q
23.42	0.2625	0.06	Q
23.50	0.2628	0.06	Q
23.58	0.2632	0.06	Q
23.67	0.2636	0.06	Q
23.75	0.2640	0.06	Q
23.83	0.2644	0.06	Q
23.92	0.2648	0.06	Q
24.00	0.2652	0.06	Q
24.08	0.2654	0.00	Q

TIME DURATION(minutes) OF PERCENTILES OF ESTIMATED PEAK FLOW RATE:
 (Note: 100% of Peak Flow Rate estimate assumed to have
 an instantaneous time duration)

Percentile of Estimated Peak Flow Rate	Duration (minutes)
=====	=====
0%	1440.0
10%	125.0
20%	25.0
30%	10.0

40%	5.0
50%	5.0
60%	5.0
70%	5.0
80%	5.0
90%	5.0

SMALL AREA UNIT HYDROGRAPH MODEL

=====

(C) Copyright 1989-2012 Advanced Engineering Software (aes)
Ver. 19.0 Release Date: 06/01/2012 License ID 1537

Analysis prepared by:

Problem Descriptions:

2-Yr Post-Development Unit Hydrograph

RATIONAL METHOD CALIBRATION COEFFICIENT = 0.90
TOTAL CATCHMENT AREA(ACRES) = 1.52
SOIL-LOSS RATE, F_m , (INCH/HR) = 0.068
LOW LOSS FRACTION = 0.128
TIME OF CONCENTRATION(MIN.) = 8.55
SMALL AREA PEAK Q COMPUTED USING PEAK FLOW RATE FORMULA
USER SPECIFIED RAINFALL VALUES ARE USED
RETURN FREQUENCY(YEARS) = 2
5-MINUTE POINT RAINFALL VALUE(INCHES) = 0.17
30-MINUTE POINT RAINFALL VALUE(INCHES) = 0.39
1-HOUR POINT RAINFALL VALUE(INCHES) = 0.57
3-HOUR POINT RAINFALL VALUE(INCHES) = 1.03
6-HOUR POINT RAINFALL VALUE(INCHES) = 1.47
24-HOUR POINT RAINFALL VALUE(INCHES) = 2.61

TOTAL CATCHMENT RUNOFF VOLUME(ACRE-FEET) = 0.26
TOTAL CATCHMENT SOIL-LOSS VOLUME(ACRE-FEET) = 0.07

TIME (HOURS)	VOLUME (AF)	Q (CFS)	0.	2.5	5.0	7.5	10.0
0.04	0.0000	0.00	Q
0.18	0.0003	0.05	Q

0.32	0.0010	0.05	Q
0.47	0.0016	0.05	Q
0.61	0.0022	0.05	Q
0.75	0.0029	0.05	Q
0.89	0.0035	0.06	Q
1.04	0.0042	0.06	Q
1.18	0.0048	0.06	Q
1.32	0.0055	0.06	Q
1.46	0.0062	0.06	Q
1.61	0.0068	0.06	Q
1.75	0.0075	0.06	Q
1.89	0.0082	0.06	Q
2.03	0.0088	0.06	Q
2.18	0.0095	0.06	Q
2.32	0.0102	0.06	Q
2.46	0.0109	0.06	Q
2.60	0.0116	0.06	Q
2.75	0.0123	0.06	Q
2.89	0.0130	0.06	Q
3.03	0.0137	0.06	Q
3.17	0.0144	0.06	Q
3.32	0.0151	0.06	Q
3.46	0.0159	0.06	Q
3.60	0.0166	0.06	Q
3.74	0.0173	0.06	Q
3.89	0.0181	0.06	Q
4.03	0.0188	0.06	Q
4.17	0.0195	0.06	Q
4.32	0.0203	0.06	Q
4.46	0.0211	0.06	Q
4.60	0.0218	0.06	Q
4.74	0.0226	0.07	Q
4.88	0.0234	0.07	Q
5.03	0.0241	0.07	Q
5.17	0.0249	0.07	Q
5.31	0.0257	0.07	Q
5.45	0.0265	0.07	Q
5.60	0.0273	0.07	Q
5.74	0.0281	0.07	Q
5.88	0.0289	0.07	Q
6.03	0.0298	0.07	Q
6.17	0.0306	0.07	Q
6.31	0.0314	0.07	Q
6.45	0.0323	0.07	Q
6.59	0.0331	0.07	Q
6.74	0.0340	0.07	Q
6.88	0.0349	0.07	Q
7.02	0.0357	0.07	Q
7.16	0.0366	0.08	Q
7.31	0.0375	0.08	Q

7.45	0.0384	0.08	Q
7.59	0.0393	0.08	Q
7.73	0.0402	0.08	Q
7.88	0.0412	0.08	Q
8.02	0.0421	0.08	Q
8.16	0.0430	0.08	Q
8.30	0.0440	0.08	Q
8.45	0.0450	0.08	Q
8.59	0.0459	0.08	Q
8.73	0.0469	0.08	Q
8.88	0.0479	0.09	Q
9.02	0.0489	0.09	Q
9.16	0.0500	0.09	Q
9.30	0.0510	0.09	Q
9.45	0.0520	0.09	Q
9.59	0.0531	0.09	Q
9.73	0.0542	0.09	Q
9.87	0.0553	0.09	Q
10.01	0.0564	0.09	Q
10.16	0.0575	0.10	Q
10.30	0.0586	0.10	Q
10.44	0.0598	0.10	Q
10.59	0.0609	0.10	Q
10.73	0.0621	0.10	Q
10.87	0.0633	0.10	Q
11.01	0.0646	0.10	Q
11.15	0.0658	0.11	Q
11.30	0.0671	0.11	Q
11.44	0.0683	0.11	Q
11.58	0.0697	0.11	Q
11.73	0.0710	0.11	Q
11.87	0.0724	0.12	Q
12.01	0.0737	0.12	Q
12.15	0.0753	0.15	Q
12.30	0.0771	0.15	Q
12.44	0.0789	0.16	Q
12.58	0.0808	0.16	Q
12.72	0.0827	0.16	Q
12.87	0.0846	0.16	Q
13.01	0.0866	0.17	Q
13.15	0.0886	0.17	Q
13.29	0.0906	0.18	Q
13.43	0.0928	0.18	Q
13.58	0.0949	0.19	Q
13.72	0.0972	0.19	Q
13.86	0.0995	0.20	Q
14.01	0.1018	0.20	Q
14.15	0.1043	0.23	Q
14.29	0.1070	0.23	Q
14.43	0.1098	0.24	Q

14.57	0.1127	0.25	Q
14.72	0.1157	0.26	.Q
14.86	0.1189	0.27	.Q
15.00	0.1222	0.29	.Q
15.15	0.1258	0.31	.Q
15.29	0.1295	0.34	.Q
15.43	0.1336	0.36	.Q
15.57	0.1380	0.40	.Q
15.72	0.1429	0.44	.Q
15.86	0.1487	0.54	. Q
16.00	0.1562	0.73	. Q
16.14	0.1720	1.97	.	Q	.	.	.
16.28	0.1864	0.47	.Q
16.43	0.1913	0.37	.Q
16.57	0.1954	0.32	.Q
16.71	0.1989	0.28	.Q
16.85	0.2021	0.26	.Q
17.00	0.2050	0.24	Q
17.14	0.2076	0.21	Q
17.28	0.2100	0.19	Q
17.42	0.2122	0.18	Q
17.57	0.2143	0.18	Q
17.71	0.2163	0.17	Q
17.85	0.2183	0.16	Q
17.99	0.2201	0.15	Q
18.14	0.2218	0.12	Q
18.28	0.2232	0.12	Q
18.42	0.2245	0.11	Q
18.57	0.2258	0.11	Q
18.71	0.2270	0.10	Q
18.85	0.2282	0.10	Q
18.99	0.2294	0.10	Q
19.14	0.2305	0.09	Q
19.28	0.2316	0.09	Q
19.42	0.2327	0.09	Q
19.56	0.2338	0.09	Q
19.70	0.2348	0.09	Q
19.85	0.2358	0.08	Q
19.99	0.2368	0.08	Q
20.13	0.2377	0.08	Q
20.27	0.2387	0.08	Q
20.42	0.2396	0.08	Q
20.56	0.2405	0.08	Q
20.70	0.2414	0.07	Q
20.84	0.2422	0.07	Q
20.99	0.2431	0.07	Q
21.13	0.2439	0.07	Q
21.27	0.2447	0.07	Q
21.42	0.2455	0.07	Q
21.56	0.2463	0.07	Q

21.70	0.2471	0.07	Q
21.84	0.2479	0.07	Q
21.98	0.2487	0.06	Q
22.13	0.2494	0.06	Q
22.27	0.2502	0.06	Q
22.41	0.2509	0.06	Q
22.56	0.2516	0.06	Q
22.70	0.2523	0.06	Q
22.84	0.2530	0.06	Q
22.98	0.2537	0.06	Q
23.12	0.2544	0.06	Q
23.27	0.2551	0.06	Q
23.41	0.2558	0.06	Q
23.55	0.2564	0.06	Q
23.69	0.2571	0.06	Q
23.84	0.2577	0.05	Q
23.98	0.2584	0.05	Q
24.12	0.2590	0.05	Q
24.27	0.2593	0.00	Q

TIME DURATION(minutes) OF PERCENTILES OF ESTIMATED PEAK FLOW RATE:
 (Note: 100% of Peak Flow Rate estimate assumed to have
 an instantaneous time duration)

Percentile of Estimated Peak Flow Rate	Duration (minutes)
=====	=====
0%	1445.0
10%	205.2
20%	51.3
30%	17.1
40%	8.6
50%	8.6
60%	8.6
70%	8.6
80%	8.6
90%	8.6

NON-HOMOGENEOUS WATERSHED AREA-AVERAGED LOSS RATE (Fm)
AND LOW LOSS FRACTION ESTIMATIONS

=====

(C) Copyright 1989-2012 Advanced Engineering Software (aes)
Ver. 19.0 Release Date: 06/01/2012 License ID 1537

Analysis prepared by:

Problem Descriptions:
2-Yr Post-Development Unit Hydrograph

=====

*** NON-HOMOGENEOUS WATERSHED AREA-AVERAGED LOSS RATE (Fm)
AND LOW LOSS FRACTION ESTIMATIONS FOR AMC I:

TOTAL 24-HOUR DURATION RAINFALL DEPTH = 2.61 (inches)

SOIL-COVER TYPE	AREA (Acres)	PERCENT OF PERVIOUS AREA	SCS CURVE NUMBER	LOSS RATE Fp(in./hr.)	YIELD
1	1.52	33.80	98.(AMC II)	0.200	0.872

TOTAL AREA (Acres) = 1.52

AREA-AVERAGED LOSS RATE, \bar{F}_m (in./hr.) = 0.068

AREA-AVERAGED LOW LOSS FRACTION, \bar{Y} = 0.128

=====

Problem Descriptions:
2-Yr Post-Development Unit Hydrograph

RATIONAL METHOD CALIBRATION COEFFICIENT = 0.90
TOTAL CATCHMENT AREA(ACRES) = 1.52
SOIL-LOSS RATE, F_m , (INCH/HR) = 0.068
LOW LOSS FRACTION = 0.128

TIME OF CONCENTRATION(MIN.) = 5.25
 SMALL AREA PEAK Q COMPUTED USING PEAK FLOW RATE FORMULA
 USER SPECIFIED RAINFALL VALUES ARE USED
 RETURN FREQUENCY(YEARS) = 2

5-MINUTE POINT RAINFALL VALUE(INCHES) = 0.17
 30-MINUTE POINT RAINFALL VALUE(INCHES) = 0.39
 1-HOUR POINT RAINFALL VALUE(INCHES) = 0.57
 3-HOUR POINT RAINFALL VALUE(INCHES) = 1.03
 6-HOUR POINT RAINFALL VALUE(INCHES) = 1.47
 24-HOUR POINT RAINFALL VALUE(INCHES) = 2.61

 TOTAL CATCHMENT RUNOFF VOLUME(ACRE-FEET) = 0.26
 TOTAL CATCHMENT SOIL-LOSS VOLUME(ACRE-FEET) = 0.07

TIME (HOURS)	VOLUME (AF)	Q (CFS)	0.	2.5	5.0	7.5	10.0
-----------------	----------------	------------	----	-----	-----	-----	------

0.08	0.0002	0.05	Q
0.16	0.0006	0.05	Q
0.25	0.0010	0.05	Q
0.34	0.0014	0.05	Q
0.43	0.0018	0.05	Q
0.51	0.0021	0.05	Q
0.60	0.0025	0.05	Q
0.69	0.0029	0.05	Q
0.77	0.0033	0.06	Q
0.86	0.0037	0.06	Q
0.95	0.0041	0.06	Q
1.04	0.0045	0.06	Q
1.12	0.0049	0.06	Q
1.21	0.0053	0.06	Q
1.30	0.0057	0.06	Q
1.39	0.0062	0.06	Q
1.48	0.0066	0.06	Q
1.56	0.0070	0.06	Q
1.65	0.0074	0.06	Q
1.74	0.0078	0.06	Q
1.83	0.0082	0.06	Q
1.91	0.0086	0.06	Q
2.00	0.0090	0.06	Q
2.09	0.0095	0.06	Q
2.17	0.0099	0.06	Q
2.26	0.0103	0.06	Q
2.35	0.0107	0.06	Q
2.44	0.0112	0.06	Q
2.53	0.0116	0.06	Q
2.61	0.0120	0.06	Q

2.70	0.0124	0.06	Q
2.79	0.0129	0.06	Q
2.88	0.0133	0.06	Q
2.96	0.0137	0.06	Q
3.05	0.0142	0.06	Q
3.14	0.0146	0.06	Q
3.22	0.0151	0.06	Q
3.31	0.0155	0.06	Q
3.40	0.0159	0.06	Q
3.49	0.0164	0.06	Q
3.58	0.0168	0.06	Q
3.66	0.0173	0.06	Q
3.75	0.0177	0.06	Q
3.84	0.0182	0.06	Q
3.92	0.0186	0.06	Q
4.01	0.0191	0.06	Q
4.10	0.0196	0.06	Q
4.19	0.0200	0.06	Q
4.28	0.0205	0.06	Q
4.36	0.0209	0.06	Q
4.45	0.0214	0.06	Q
4.54	0.0219	0.06	Q
4.62	0.0223	0.07	Q
4.71	0.0228	0.07	Q
4.80	0.0233	0.07	Q
4.89	0.0238	0.07	Q
4.97	0.0243	0.07	Q
5.06	0.0247	0.07	Q
5.15	0.0252	0.07	Q
5.24	0.0257	0.07	Q
5.32	0.0262	0.07	Q
5.41	0.0267	0.07	Q
5.50	0.0272	0.07	Q
5.59	0.0277	0.07	Q
5.68	0.0282	0.07	Q
5.76	0.0287	0.07	Q
5.85	0.0292	0.07	Q
5.94	0.0297	0.07	Q
6.03	0.0302	0.07	Q
6.11	0.0307	0.07	Q
6.20	0.0312	0.07	Q
6.29	0.0317	0.07	Q
6.38	0.0322	0.07	Q
6.46	0.0328	0.07	Q
6.55	0.0333	0.07	Q
6.64	0.0338	0.07	Q
6.72	0.0343	0.07	Q
6.81	0.0349	0.07	Q
6.90	0.0354	0.07	Q
6.99	0.0360	0.07	Q

7.07	0.0365	0.08	Q
7.16	0.0370	0.08	Q
7.25	0.0376	0.08	Q
7.34	0.0381	0.08	Q
7.43	0.0387	0.08	Q
7.51	0.0393	0.08	Q
7.60	0.0398	0.08	Q
7.69	0.0404	0.08	Q
7.78	0.0409	0.08	Q
7.86	0.0415	0.08	Q
7.95	0.0421	0.08	Q
8.04	0.0427	0.08	Q
8.12	0.0433	0.08	Q
8.21	0.0438	0.08	Q
8.30	0.0444	0.08	Q
8.39	0.0450	0.08	Q
8.48	0.0456	0.08	Q
8.56	0.0462	0.08	Q
8.65	0.0468	0.08	Q
8.74	0.0474	0.08	Q
8.82	0.0481	0.09	Q
8.91	0.0487	0.09	Q
9.00	0.0493	0.09	Q
9.09	0.0499	0.09	Q
9.18	0.0506	0.09	Q
9.26	0.0512	0.09	Q
9.35	0.0518	0.09	Q
9.44	0.0525	0.09	Q
9.52	0.0531	0.09	Q
9.61	0.0538	0.09	Q
9.70	0.0545	0.09	Q
9.79	0.0551	0.09	Q
9.88	0.0558	0.09	Q
9.96	0.0565	0.09	Q
10.05	0.0572	0.09	Q
10.14	0.0578	0.10	Q
10.23	0.0585	0.10	Q
10.31	0.0592	0.10	Q
10.40	0.0600	0.10	Q
10.49	0.0607	0.10	Q
10.57	0.0614	0.10	Q
10.66	0.0621	0.10	Q
10.75	0.0629	0.10	Q
10.84	0.0636	0.10	Q
10.93	0.0643	0.10	Q
11.01	0.0651	0.11	Q
11.10	0.0659	0.11	Q
11.19	0.0666	0.11	Q
11.27	0.0674	0.11	Q
11.36	0.0682	0.11	Q

11.45	0.0690	0.11	Q
11.54	0.0698	0.11	Q
11.62	0.0706	0.11	Q
11.71	0.0715	0.12	Q
11.80	0.0723	0.12	Q
11.89	0.0731	0.12	Q
11.98	0.0740	0.12	Q
12.06	0.0749	0.14	Q
12.15	0.0760	0.15	Q
12.24	0.0771	0.15	Q
12.32	0.0782	0.15	Q
12.41	0.0793	0.16	Q
12.50	0.0804	0.16	Q
12.59	0.0816	0.16	Q
12.68	0.0827	0.16	Q
12.76	0.0839	0.16	Q
12.85	0.0851	0.17	Q
12.94	0.0863	0.17	Q
13.02	0.0876	0.17	Q
13.11	0.0888	0.17	Q
13.20	0.0901	0.18	Q
13.29	0.0913	0.18	Q
13.38	0.0926	0.18	Q
13.46	0.0940	0.18	Q
13.55	0.0953	0.19	Q
13.64	0.0967	0.19	Q
13.73	0.0981	0.19	Q
13.81	0.0995	0.20	Q
13.90	0.1009	0.20	Q
13.99	0.1024	0.21	Q
14.07	0.1039	0.21	Q
14.16	0.1055	0.23	Q
14.25	0.1072	0.23	Q
14.34	0.1089	0.24	Q
14.43	0.1106	0.24	Q
14.51	0.1124	0.25	.Q
14.60	0.1142	0.25	.Q
14.69	0.1161	0.26	.Q
14.77	0.1180	0.27	.Q
14.86	0.1200	0.28	.Q
14.95	0.1221	0.29	.Q
15.04	0.1242	0.30	.Q
15.12	0.1264	0.31	.Q
15.21	0.1288	0.33	.Q
15.30	0.1312	0.34	.Q
15.39	0.1337	0.36	.Q
15.48	0.1363	0.37	.Q
15.56	0.1391	0.41	.Q
15.65	0.1422	0.43	.Q
15.74	0.1454	0.47	.Q

15.82	0.1490	0.51	. Q
15.91	0.1534	0.71	. Q
16.00	0.1594	0.96	. Q
16.09	0.1722	2.56	.	Q	.	.	.
16.17	0.1835	0.58	. Q
16.26	0.1873	0.46	.Q
16.35	0.1904	0.38	.Q
16.44	0.1930	0.35	.Q
16.52	0.1955	0.32	.Q
16.61	0.1977	0.29	.Q
16.70	0.1997	0.28	.Q
16.79	0.2017	0.26	.Q
16.88	0.2035	0.25	Q
16.96	0.2052	0.23	Q
17.05	0.2069	0.23	Q
17.14	0.2085	0.20	Q
17.23	0.2099	0.20	Q
17.31	0.2113	0.19	Q
17.40	0.2126	0.18	Q
17.49	0.2139	0.18	Q
17.58	0.2152	0.17	Q
17.66	0.2164	0.17	Q
17.75	0.2176	0.16	Q
17.84	0.2188	0.16	Q
17.92	0.2199	0.16	Q
18.01	0.2210	0.15	Q
18.10	0.2220	0.12	Q
18.19	0.2229	0.12	Q
18.27	0.2237	0.11	Q
18.36	0.2245	0.11	Q
18.45	0.2253	0.11	Q
18.54	0.2261	0.11	Q
18.62	0.2269	0.10	Q
18.71	0.2276	0.10	Q
18.80	0.2284	0.10	Q
18.89	0.2291	0.10	Q
18.98	0.2298	0.10	Q
19.06	0.2305	0.10	Q
19.15	0.2312	0.09	Q
19.24	0.2318	0.09	Q
19.33	0.2325	0.09	Q
19.41	0.2332	0.09	Q
19.50	0.2338	0.09	Q
19.59	0.2344	0.09	Q
19.67	0.2351	0.09	Q
19.76	0.2357	0.08	Q
19.85	0.2363	0.08	Q
19.94	0.2369	0.08	Q
20.02	0.2375	0.08	Q
20.11	0.2380	0.08	Q

20.20	0.2386	0.08	Q
20.29	0.2392	0.08	Q
20.38	0.2398	0.08	Q
20.46	0.2403	0.08	Q
20.55	0.2409	0.08	Q
20.64	0.2414	0.07	Q
20.73	0.2419	0.07	Q
20.81	0.2425	0.07	Q
20.90	0.2430	0.07	Q
20.99	0.2435	0.07	Q
21.08	0.2440	0.07	Q
21.16	0.2445	0.07	Q
21.25	0.2450	0.07	Q
21.34	0.2455	0.07	Q
21.42	0.2460	0.07	Q
21.51	0.2465	0.07	Q
21.60	0.2470	0.07	Q
21.69	0.2475	0.07	Q
21.77	0.2479	0.07	Q
21.86	0.2484	0.06	Q
21.95	0.2489	0.06	Q
22.04	0.2493	0.06	Q
22.12	0.2498	0.06	Q
22.21	0.2503	0.06	Q
22.30	0.2507	0.06	Q
22.39	0.2512	0.06	Q
22.48	0.2516	0.06	Q
22.56	0.2520	0.06	Q
22.65	0.2525	0.06	Q
22.74	0.2529	0.06	Q
22.83	0.2533	0.06	Q
22.91	0.2538	0.06	Q
23.00	0.2542	0.06	Q
23.09	0.2546	0.06	Q
23.17	0.2550	0.06	Q
23.26	0.2554	0.06	Q
23.35	0.2559	0.06	Q
23.44	0.2563	0.06	Q
23.52	0.2567	0.06	Q
23.61	0.2571	0.06	Q
23.70	0.2575	0.06	Q
23.79	0.2579	0.05	Q
23.88	0.2583	0.05	Q
23.96	0.2587	0.05	Q
24.05	0.2590	0.05	Q
24.14	0.2592	0.00	Q

TIME DURATION(minutes) OF PERCENTILES OF ESTIMATED PEAK FLOW RATE:

(Note: 100% of Peak Flow Rate estimate assumed to have

an instantaneous time duration)

Percentile of Estimated Peak Flow Rate	Duration (minutes)
=====	=====
0%	1443.8
10%	131.2
20%	26.2
30%	10.5
40%	5.2
50%	5.2
60%	5.2
70%	5.2
80%	5.2
90%	5.2

3.0 HYDRAULICS ANALYSIS

3.1 24" BY 36" GRATED INLET SIZE ANALYSIS AT NODE 101

For sizing the grated inlet the 25 year storm event was analyzed.

Total area: 2' X 3' = 6 sf.

Total area of opening (assume 50%) = 6/2 = 3.0 sf.

50% clogging factor = 3.0/2 = 1.5 sf.

$$Q_{design} = C \times A \times \sqrt{2GH}$$

$$G = 32.2 \text{ ft/s}^2$$

$$A = 1.5 \text{ sf.}$$

$$C = 0.67$$

$$Q_{25} = 1.35 \text{ cfs}$$

$$1.35 = 0.67 \times 1.5 \times \sqrt{(32.2 \times 2 \times H)}$$

$$H = 0.028' = 0.34''$$

3.2 24" BY 36" GRATED INLET SIZE ANALYSIS AT NODE 201

For sizing the grated inlet the 25 year storm event was analyzed.

Total area: 2' X 3' = 6 sf.

Total area of opening (assume 50%) = 6/2 = 3.0 sf.

50% clogging factor = 3.0/2 = 1.5 sf.

$$Q_{design} = C \times A \times \sqrt{2GH}$$

$$G = 32.2 \text{ ft/s}^2$$

$$A = 1.5 \text{ sf.}$$

$$C = 0.67$$

$$Q_{25} = 1.18 \text{ cfs}$$

$$1.18 = 0.67 \times 1.5 \times \sqrt{(32.2 \times 2 \times H)}$$

$$H = 0.021' = 0.26''$$

3.3 24" BY 36" GRATED INLET SIZE ANALYSIS AT NODE 301

For sizing the grated inlet the 25 year storm event was analyzed.

Total area: 2' X 3' = 6 sf.

Total area of opening (assume 50%) = 6/2 = 3.0 sf.

50% clogging factor = 3.0/2 = 1.5 sf.

$$Q_{design} = C \times A \times \sqrt{2GH}$$

$$G = 32.2 \text{ ft/s}^2$$

$$A = 1.5 \text{ sf.}$$

$$C = 0.67$$

$$Q_{25} = 1.30 \text{ cfs}$$

$$1.30 = 0.67 \times 1.5 \times \sqrt{(32.2 \times 2 \times H)}$$

$$H = 0.026' = 0.32''$$

3.4 24" BY 36" GRATED INLET SIZE ANALYSIS AT NODE 401

For sizing the grated inlet the 50 year storm event was analyzed.

Total area: 2' X 3' = 6 sf.

Total area of opening (assume 50%) = 6/2 = 3.0 sf.

50% clogging factor = 3.0/2 = 1.5 sf.

$$Q_{design} = C \times A \times \sqrt{2GH}$$

$$G = 32.2 \text{ ft/s}^2$$

$$A = 1.5 \text{ sf.}$$

$$C = 0.67$$

$$Q_{25} = 0.46 \text{ cfs}$$

$$0.46 = 0.67 \times 1.5 \times \sqrt{(32.2 \times 2 \times H)}$$

$$H < 0.01' \text{ negligible}$$

In-N-Out Burger
18181 Imperial Hwy

City of Yorba Linda, County of Orange, California

3.5 24" BY 36" GRATED INLET SIZE ANALYSIS AT NODE 501

For sizing the grated inlet the 50 year storm event was analyzed.

Total area: 2' X 3' = 6 sf.

Total area of opening (assume 50%) = 6/2 = 3.0 sf.

50% clogging factor = 3.0/2 = 1.5 sf.

$$Q_{design} = C \times A \times \sqrt{2GH}$$

$$G = 32.2 \text{ ft/s}^2$$

$$A = 1.5 \text{ sf.}$$

$$C = 0.67$$

$$Q_{25} = 0.38 \text{ cfs}$$

$$0.38 = 0.67 \times 1.5 \times \sqrt{(32.2 \times 2 \times H)}$$

$$H < 0.01' \text{ negligible}$$

3.5 24" BY 36" GRATED INLET SIZE ANALYSIS AT NODE 601

For sizing the grated inlet the 50 year storm event was analyzed.

Total area: 2' X 3' = 6 sf.

Total area of opening (assume 50%) = 6/2 = 3.0 sf.

50% clogging factor = 3.0/2 = 1.5 sf.

$$Q_{design} = C \times A \times \sqrt{2GH}$$

$$G = 32.2 \text{ ft/s}^2$$

$$A = 1.5 \text{ sf.}$$

$$C = 0.67$$

$$Q_{25} = 0.19 \text{ cfs}$$

$$0.19 = 0.67 \times 1.5 \times \sqrt{(32.2 \times 2 \times H)}$$

$$H < 0.01' \text{ negligible}$$

In-N-Out Burger
18181 Imperial Hwy

City of Yorba Linda, County of Orange, California

3.6 36" BY 36" GRATED INLET SIZE ANALYSIS AT BIO-FILTRATION GRATE

For sizing the grated inlet the 50 year storm event was analyzed.

Total area: 3' X 3' = 9 sf.

Total area of opening (assume 50%) = 9/2 = 4.5 sf.

50% clogging factor = 4.5/2 = 2.25 sf.

$$Q_{design} = C \times A \times \sqrt{2GH}$$

$$G = 32.2 \text{ ft/s}^2$$

$$A = 2.25 \text{ sf.}$$

$$C = 0.67$$

$$Q_{25} = 1.35 + 1.18 + 1.30 + 0.46 + 0.38 + 0.19 + 0.49 = 5.35 \text{ cfs}$$

$$5.35 = 0.67 \times 2.25 \times \sqrt{(32.2 \times 2 \times H)}$$

$$H = 0.20' = 2.35"$$

Lowest elevation at top of basin slope = 79.3'

Ponding elevation = 77.29 + 0.20 = 77.49'; Basin will not overflow

In-N-Out Burger
18181 Imperial Hwy

City of Yorba Linda, County of Orange, California

**3.7 PIPE SIZE ANALYSIS FROM GRATE INLET NODE 601 TO
GRATE INLET NODE 501**

For sizing the pipe the 25 year storm event was analyzed

Data

$$d = 12 \text{ in} \quad Q_{\text{design}} = 0.19 \text{ cfs}$$

$$s = 0.020$$

$$n = 0.011 \text{ (pvc)}$$

Analysis

$$D/d = 0.08$$

$$D = 1.0 \text{ in}$$

$$A = 0.14 \text{ ft}^2$$

$$P = 0.57 \text{ ft}$$

$$V = 1.33 \text{ ft/s}$$

**3.8 PIPE SIZE ANALYSIS FROM GRATE INLET NODE 501 TO GRATE
INLET NODE 401**

For sizing the pipe the 25 year storm event was analyzed

Data

$$d = 12 \text{ in} \quad Q_{\text{design}} = 0.19 + 0.38 = 0.57 \text{ cfs}$$

$$s = 0.035$$

$$n = 0.011 \text{ (pvc)}$$

Analysis

$$D/d = 0.13$$

$$D = 1.56 \text{ in}$$

$$A = 0.18 \text{ ft}^2$$

$$P = 0.74 \text{ ft}$$

$$V = 3.09 \text{ ft/s}$$

In-N-Out Burger
18181 Imperial Hwy

City of Yorba Linda, County of Orange, California

**3.9 PIPE SIZE ANALYSIS FROM GRATE INLET NODE 401 TO GRATE
INLET NODE 201**

For sizing the pipe the 25 year storm event was analyzed

Data

$$d = 12 \text{ in} \quad Q_{\text{design}} = 0.57 + 0.46 = 1.03 \text{ cfs}$$

$$s = 0.025$$

$$n = 0.011 \text{ (pvc)}$$

Analysis

$$D/d = 0.19$$

$$D = 2.29 \text{ in}$$

$$A = 0.23 \text{ ft}^2$$

$$P = 0.90 \text{ ft}$$

$$V = 4.57 \text{ ft/s}$$

**3.9 PIPE SIZE ANALYSIS FROM GRATE INLET NODE 301 TO GRATE
INLET NODE 201**

For sizing the pipe the 25 year storm event was analyzed

Data

$$d = 12 \text{ in} \quad Q_{\text{design}} = 0.61$$

$$s = 0.021$$

$$n = 0.011 \text{ (pvc)}$$

Analysis

$$D/d = 0.15$$

$$D = 1.8 \text{ in}$$

$$A = 0.20 \text{ ft}^2$$

$$P = 0.80 \text{ ft}$$

$$V = 3.07 \text{ ft/s}$$

In-N-Out Burger
18181 Imperial Hwy

City of Yorba Linda, County of Orange, California

**3.10 PIPE SIZE ANALYSIS FROM GRATE INLET NODE 201 TO GRATE
INLET NODE 101**

For sizing the pipe the 25 year storm event was analyzed

Data

$$d = 12 \text{ in} \quad Q_{\text{design}} = 1.03 + 0.61 \cdot 1.30 = 2.94 \text{ cfs}$$

$$s = 0.021$$

$$n = 0.011 \text{ (pvc)}$$

Analysis

$$D/d = 0.38$$

$$D = 4.56 \text{ in}$$

$$A = 0.33 \text{ ft}^2$$

$$P = 1.34 \text{ ft}$$

$$V = 8.85 \text{ ft/s}$$

**3.11 PIPE SIZE ANALYSIS FROM GRATE INLET NODE 101 TO BIO
TREATMENT BASIN**

For sizing the pipe the 25 year storm event was analyzed

Data

$$d = 12 \text{ in} \quad Q_{\text{design}} = 2.94 + 1.35 = 4.29 \text{ cfs}$$

$$s = 0.018$$

$$n = 0.011 \text{ (pvc)}$$

Analysis

$$D/d = 0.57$$

$$D = 6.84 \text{ in}$$

$$A = 0.46 \text{ ft}^2$$

$$P = 1.71 \text{ ft}$$

$$V = 9.28 \text{ ft/s}$$

In-N-Out Burger

18181 Imperial Hwy

City of Yorba Linda, County of Orange, California




4.0

APPENDIX "A"

In-N-Out Burger
18181 Imperial Hwy

City of Yorba Linda, County of Orange, California

4.1 REFERENCE MAPS

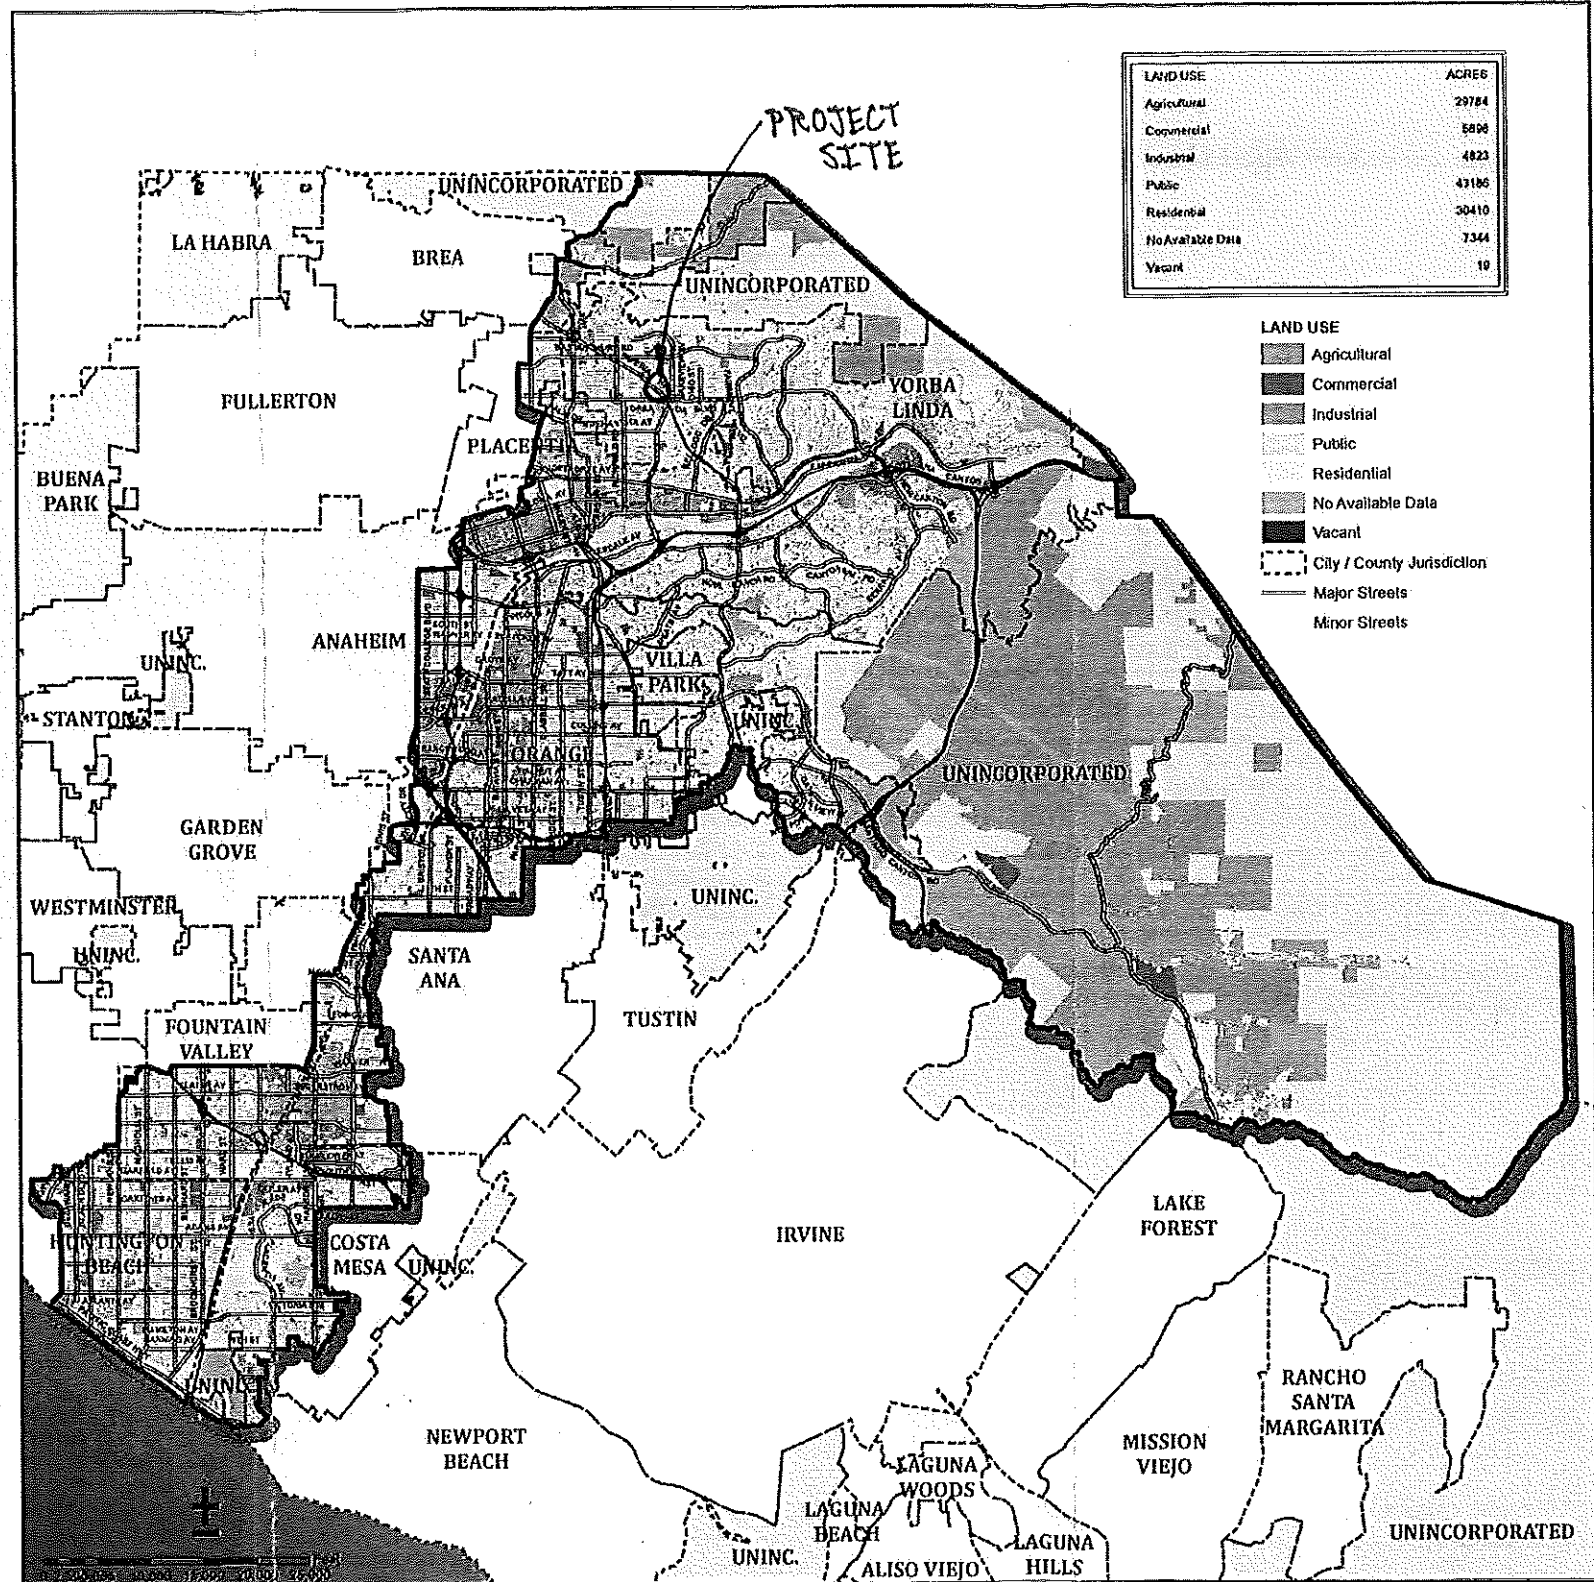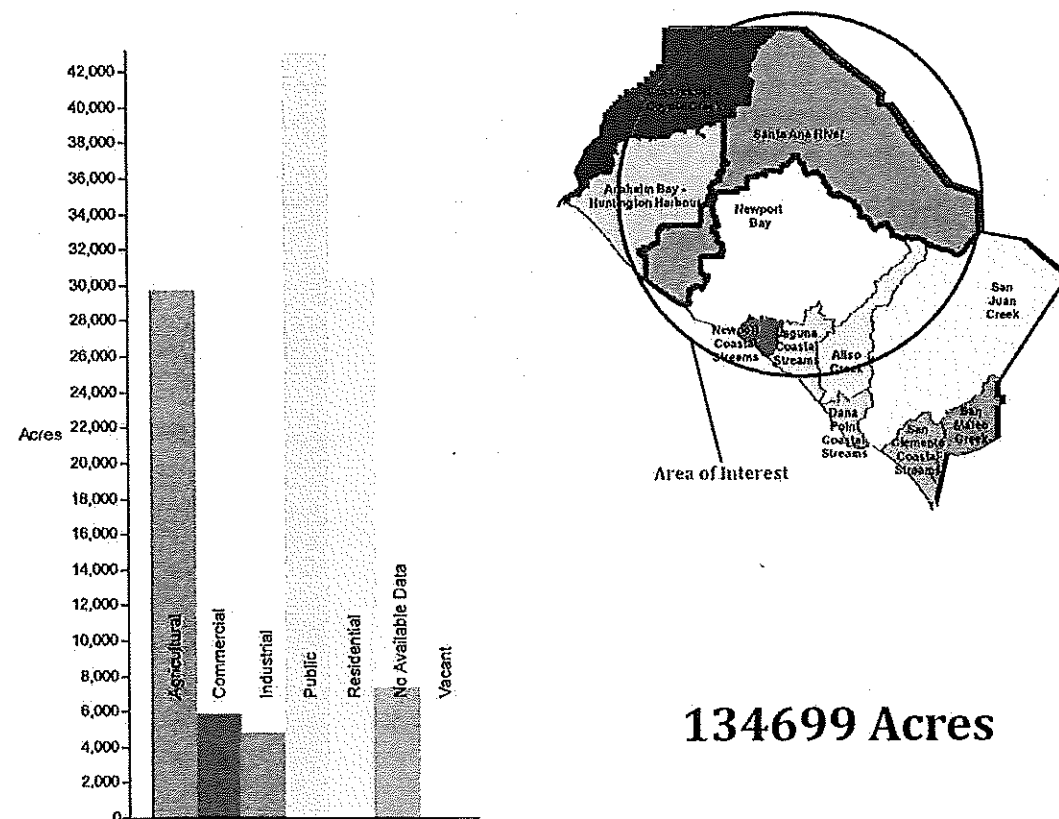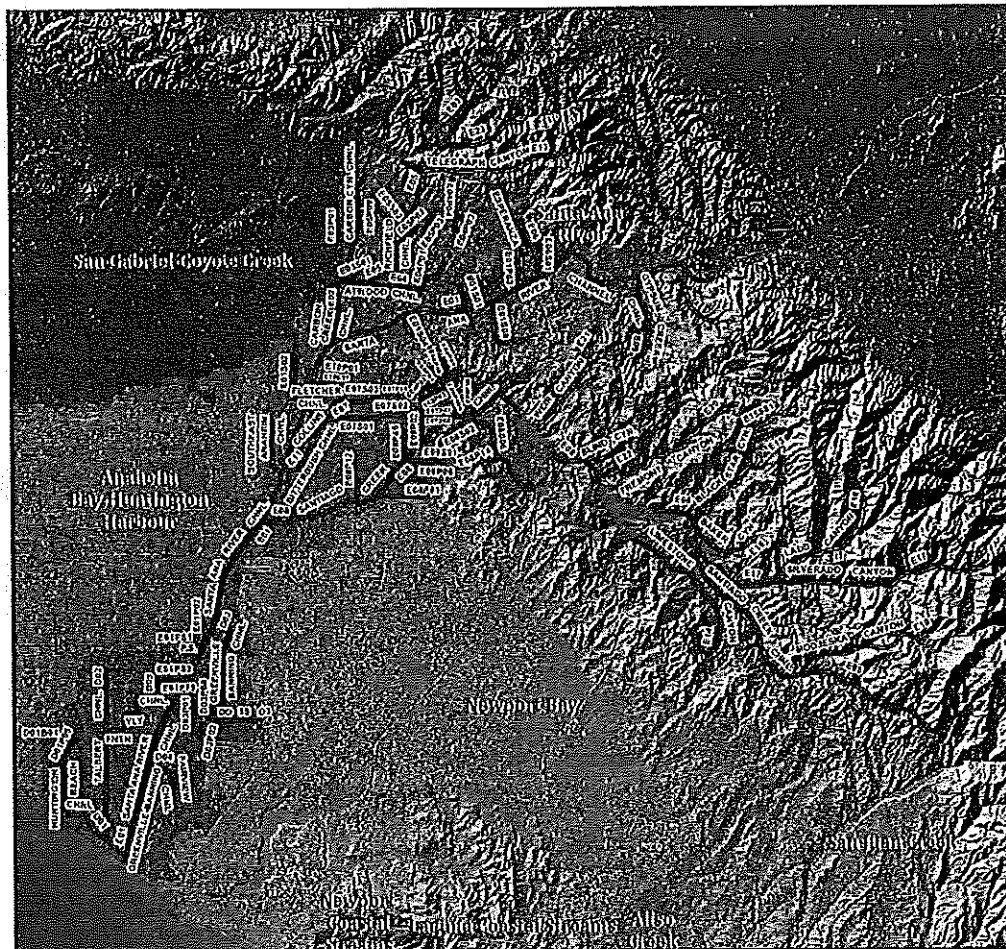

WATERSHED: SANTA ANA RIVER


COUNTY OF ORANGE, CALIFORNIA

DESIGNED AND PRODUCED BY:
 OO Public Works
 2014 Planning and Policy Project

DATA SOURCE:
 2014 Census of Agriculture and Census of Population

The County of Orange and the County of Orange Public Works Department are not responsible for the accuracy of the data presented in this map. The County of Orange and the County of Orange Public Works Department are not responsible for the accuracy of the data presented in this map.


DATE: June 18, 2014

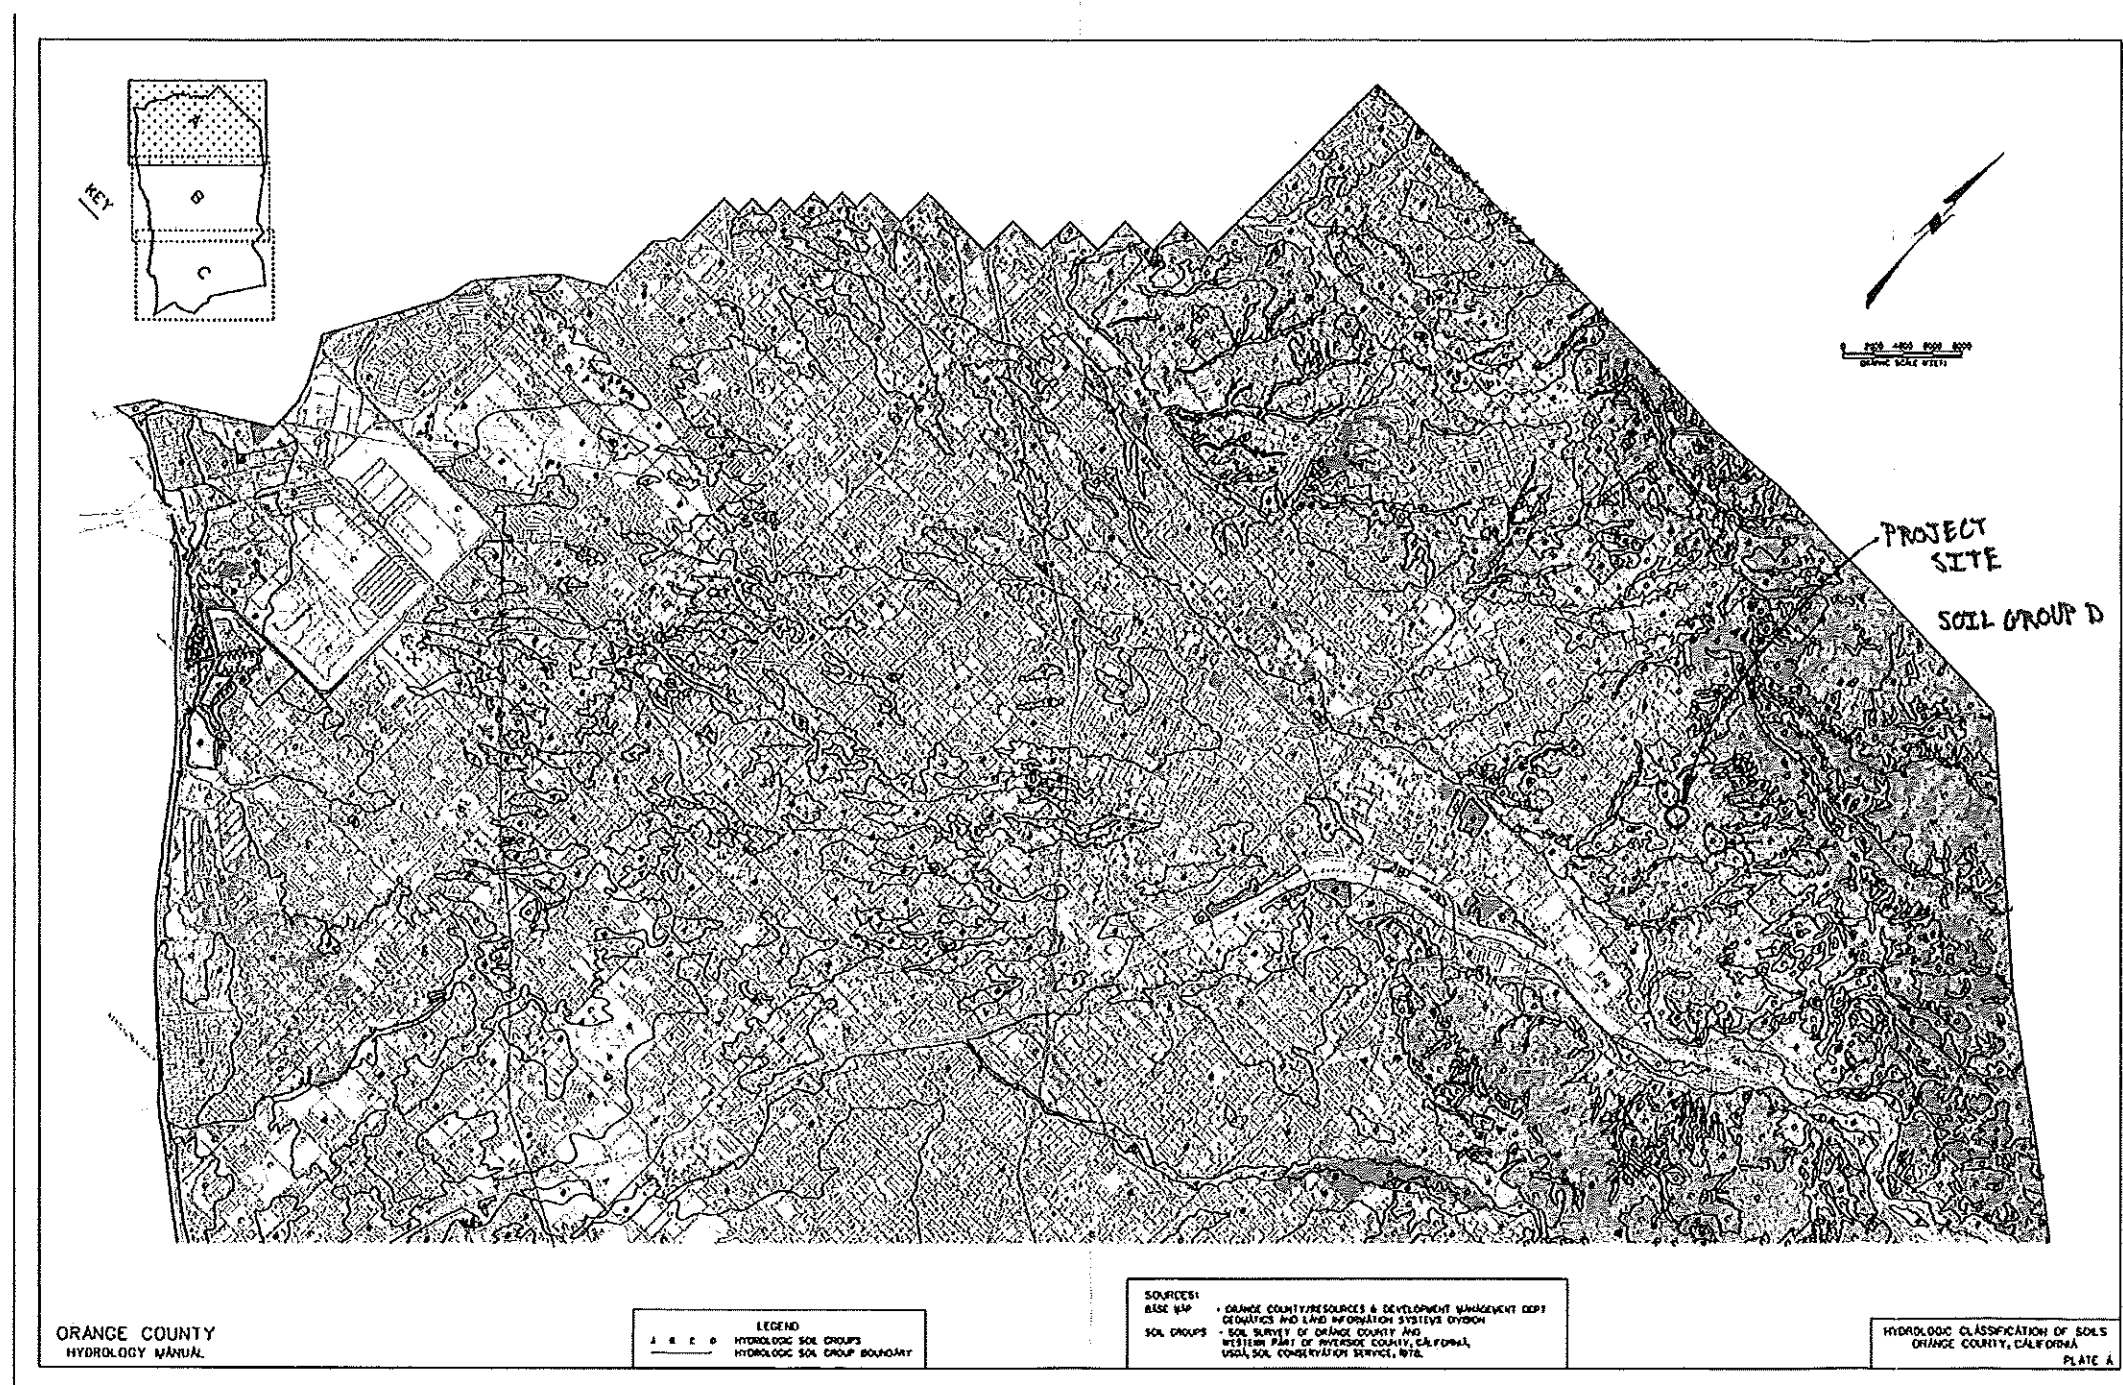

In-N-Out Burger
18181 Imperial Hwy

City of Yorba Linda, County of Orange, California

VICINITY MAP

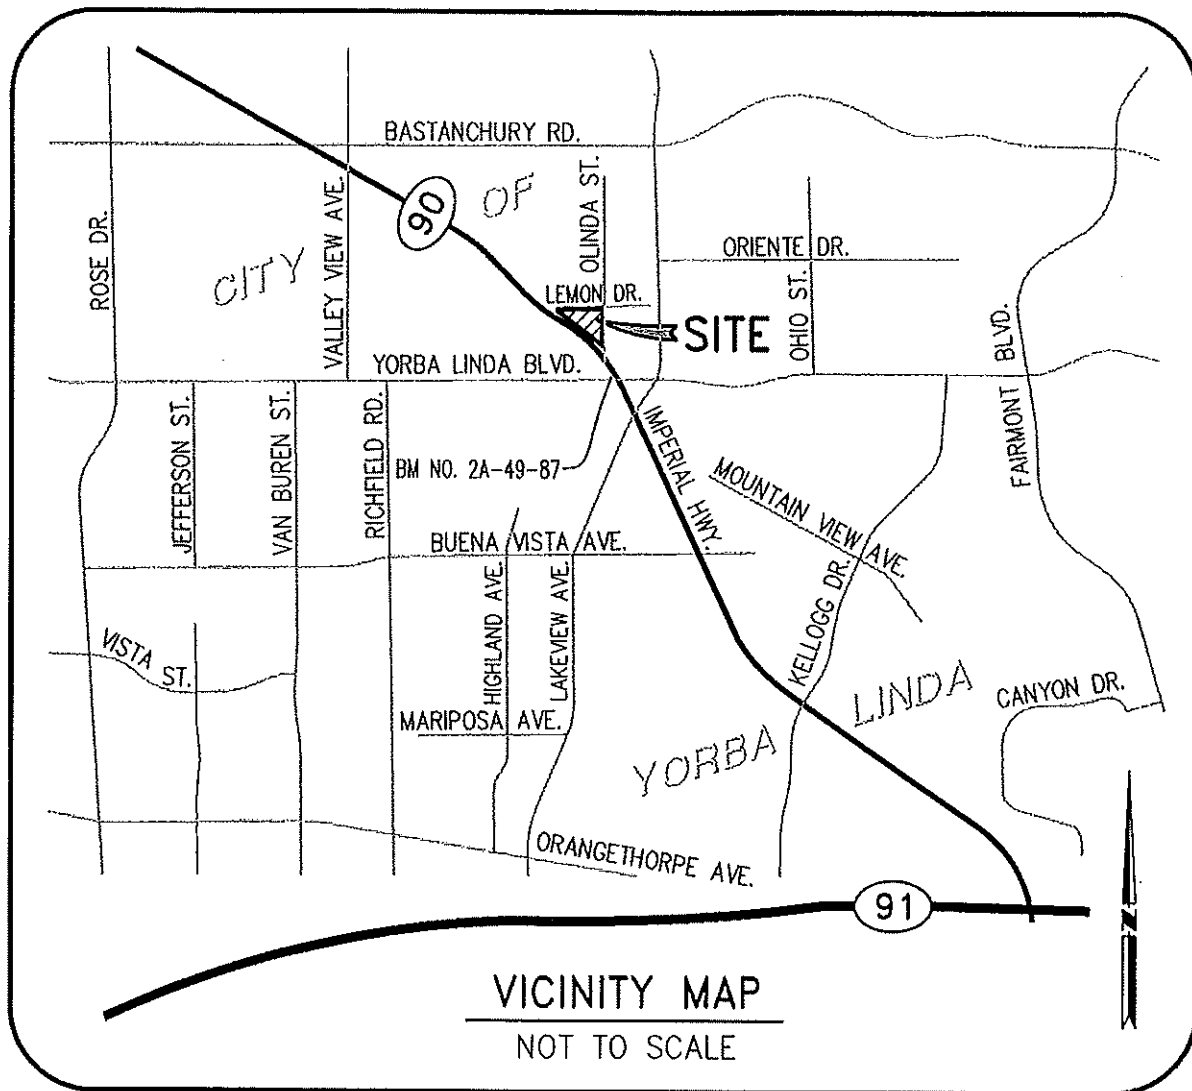

In-N-Out Burger
18181 Imperial Hwy



City of Yorba Linda, County of Orange, California

5.0 HYDROLOGY MAPS

In-N-Out Burger
18181 Imperial Hwy

City of Yorba Linda, County of Orange, California

5.1 HYDROLOGY MAP (EXISTING CONDITION)

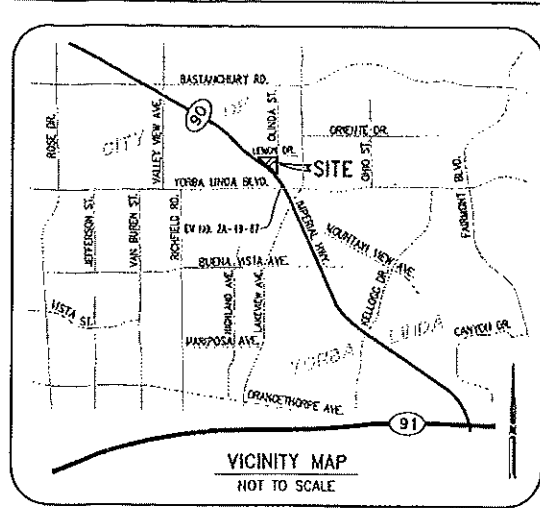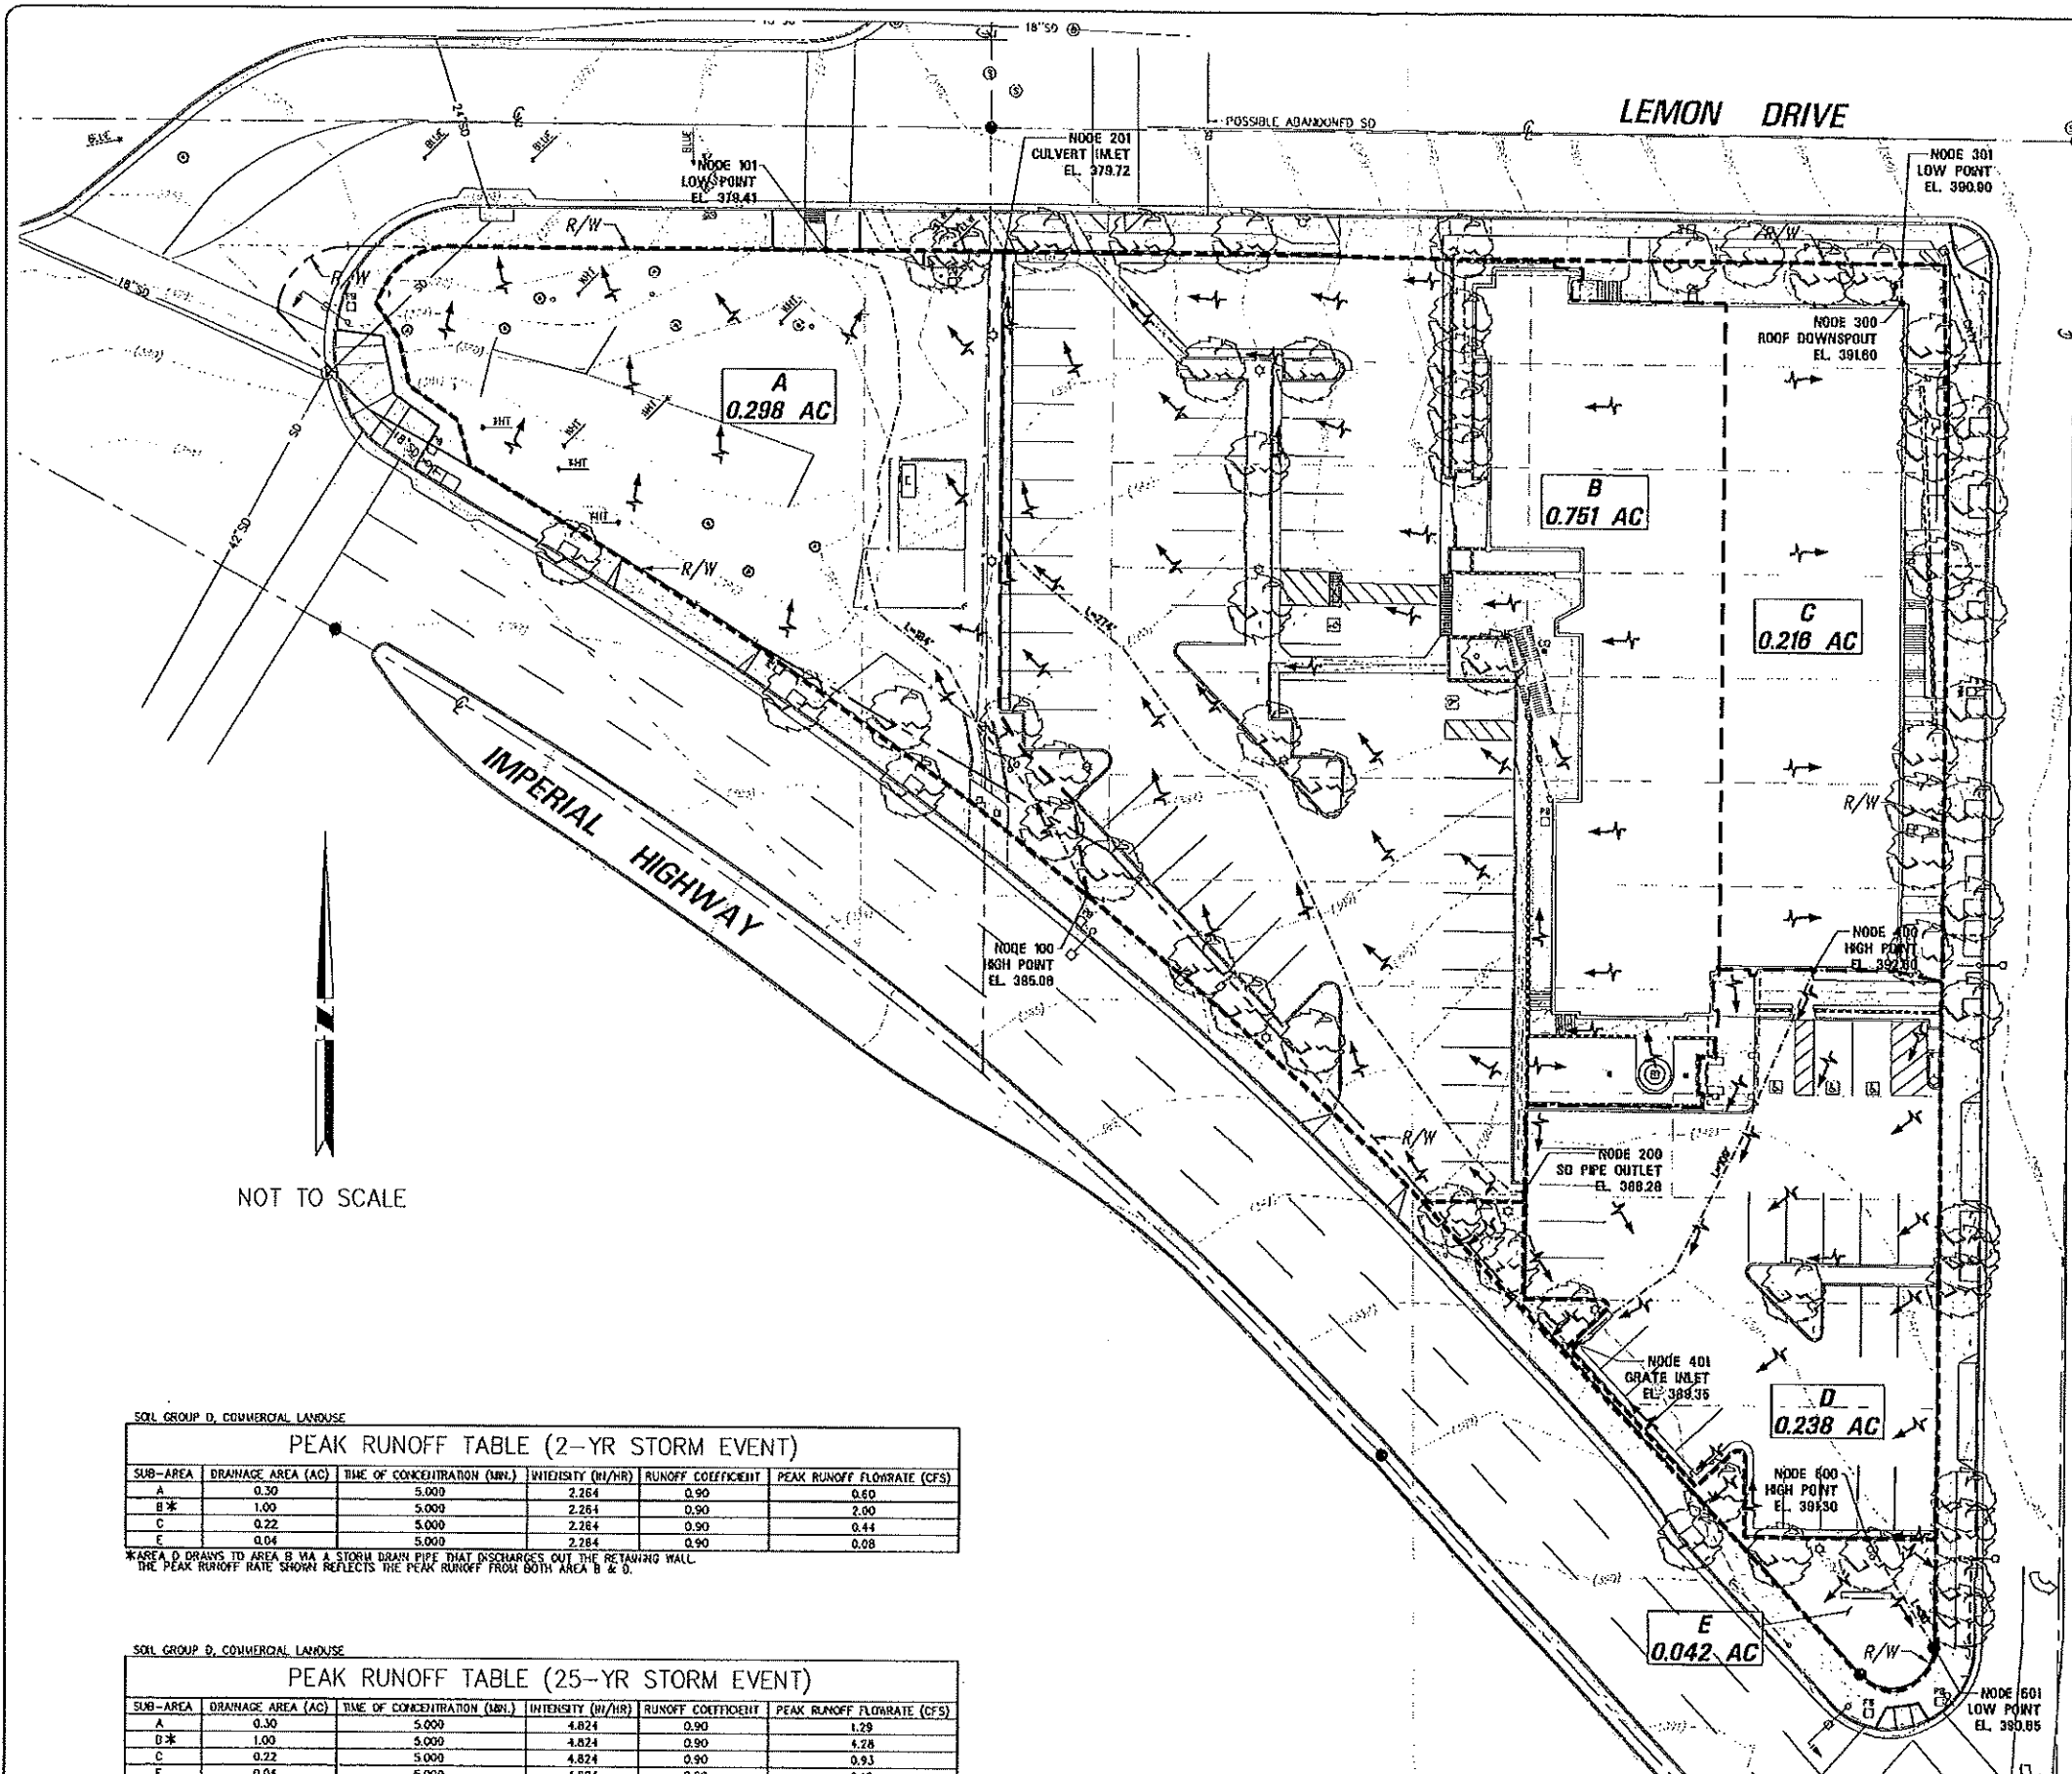

- LEGEND**
- ■ ■ ■ ■ DRAINAGE BOUNDARY
 - — — — — DRAINAGE SUB-AREA BOUNDARY
 - 101 ———— NODE
 - HIGHT POINT 450 ———— NODE DESCRIPTION ELEVATION
 - A ———— SUB-AREA NAME
 - 0.400 AC ———— DRAINAGE AREA IN ACRES
 - ← ———— PATH OF FLOW

SOIL GROUP D, COMMERCIAL LANDUSE

PEAK RUNOFF TABLE (2-YR STORM EVENT)

SUB-AREA	DRAINAGE AREA (AC)	TIME OF CONCENTRATION (MIN.)	INTENSITY (IN/HR)	RUNOFF COEFFICIENT	PEAK RUNOFF FLOWRATE (CFS)
A	0.30	5.000	2.264	0.90	0.60
B*	1.00	5.000	2.264	0.90	2.90
C	0.22	5.000	2.264	0.90	0.44
E	0.04	5.000	2.264	0.90	0.08

*AREA D DRAINS TO AREA B VIA A STORM DRAIN PIPE THAT DISCHARGES OUT THE RETAINING WALL. THE PEAK RUNOFF RATE SHOWN REFLECTS THE PEAK RUNOFF FROM BOTH AREA B & D.

SOIL GROUP D, COMMERCIAL LANDUSE


PEAK RUNOFF TABLE (25-YR STORM EVENT)

SUB-AREA	DRAINAGE AREA (AC)	TIME OF CONCENTRATION (MIN.)	INTENSITY (IN/HR)	RUNOFF COEFFICIENT	PEAK RUNOFF FLOWRATE (CFS)
A	0.30	5.000	4.824	0.90	1.28
D*	1.00	5.000	4.824	0.90	4.28
C	0.22	5.000	4.824	0.90	0.93
E	0.04	5.000	4.824	0.90	0.18

*AREA D DRAINS TO AREA B VIA A STORM DRAIN PIPE THAT DISCHARGES OUT THE RETAINING WALL. THE PEAK RUNOFF RATE SHOWN REFLECTS THE PEAK RUNOFF FROM BOTH AREA B & D.

NO.	REVISIONS	DATE

Prepared by
Joseph C. Truxaw and Associates, Inc.
Civil Engineers and Land Surveyors
265 S. Anita Dr., Suite 111, Orange, CA 92668 (714) 935-0662 fax (714) 935-0105



**PRE-DEVELOPMENT
HYDROLOGY PLAN**
IN-N-OUT BURGER
18181 IMPERIAL HWY
IN THE CITY OF YORBA LINDA
ORANGE COUNTY, STATE OF CALIFORNIA


DATE 1-18-19
DRAWN BY PJS/MOR
CHECKED BY SMH/CD
JOB NO. INO18021
SHEET NO. 1
OF 2 SHEETS

In-N-Out Burger

18181 Imperial Hwy

City of Yorba Linda, County of Orange, California

5.2 HYDROLOGY MAP (PROPOSED CONDITION)

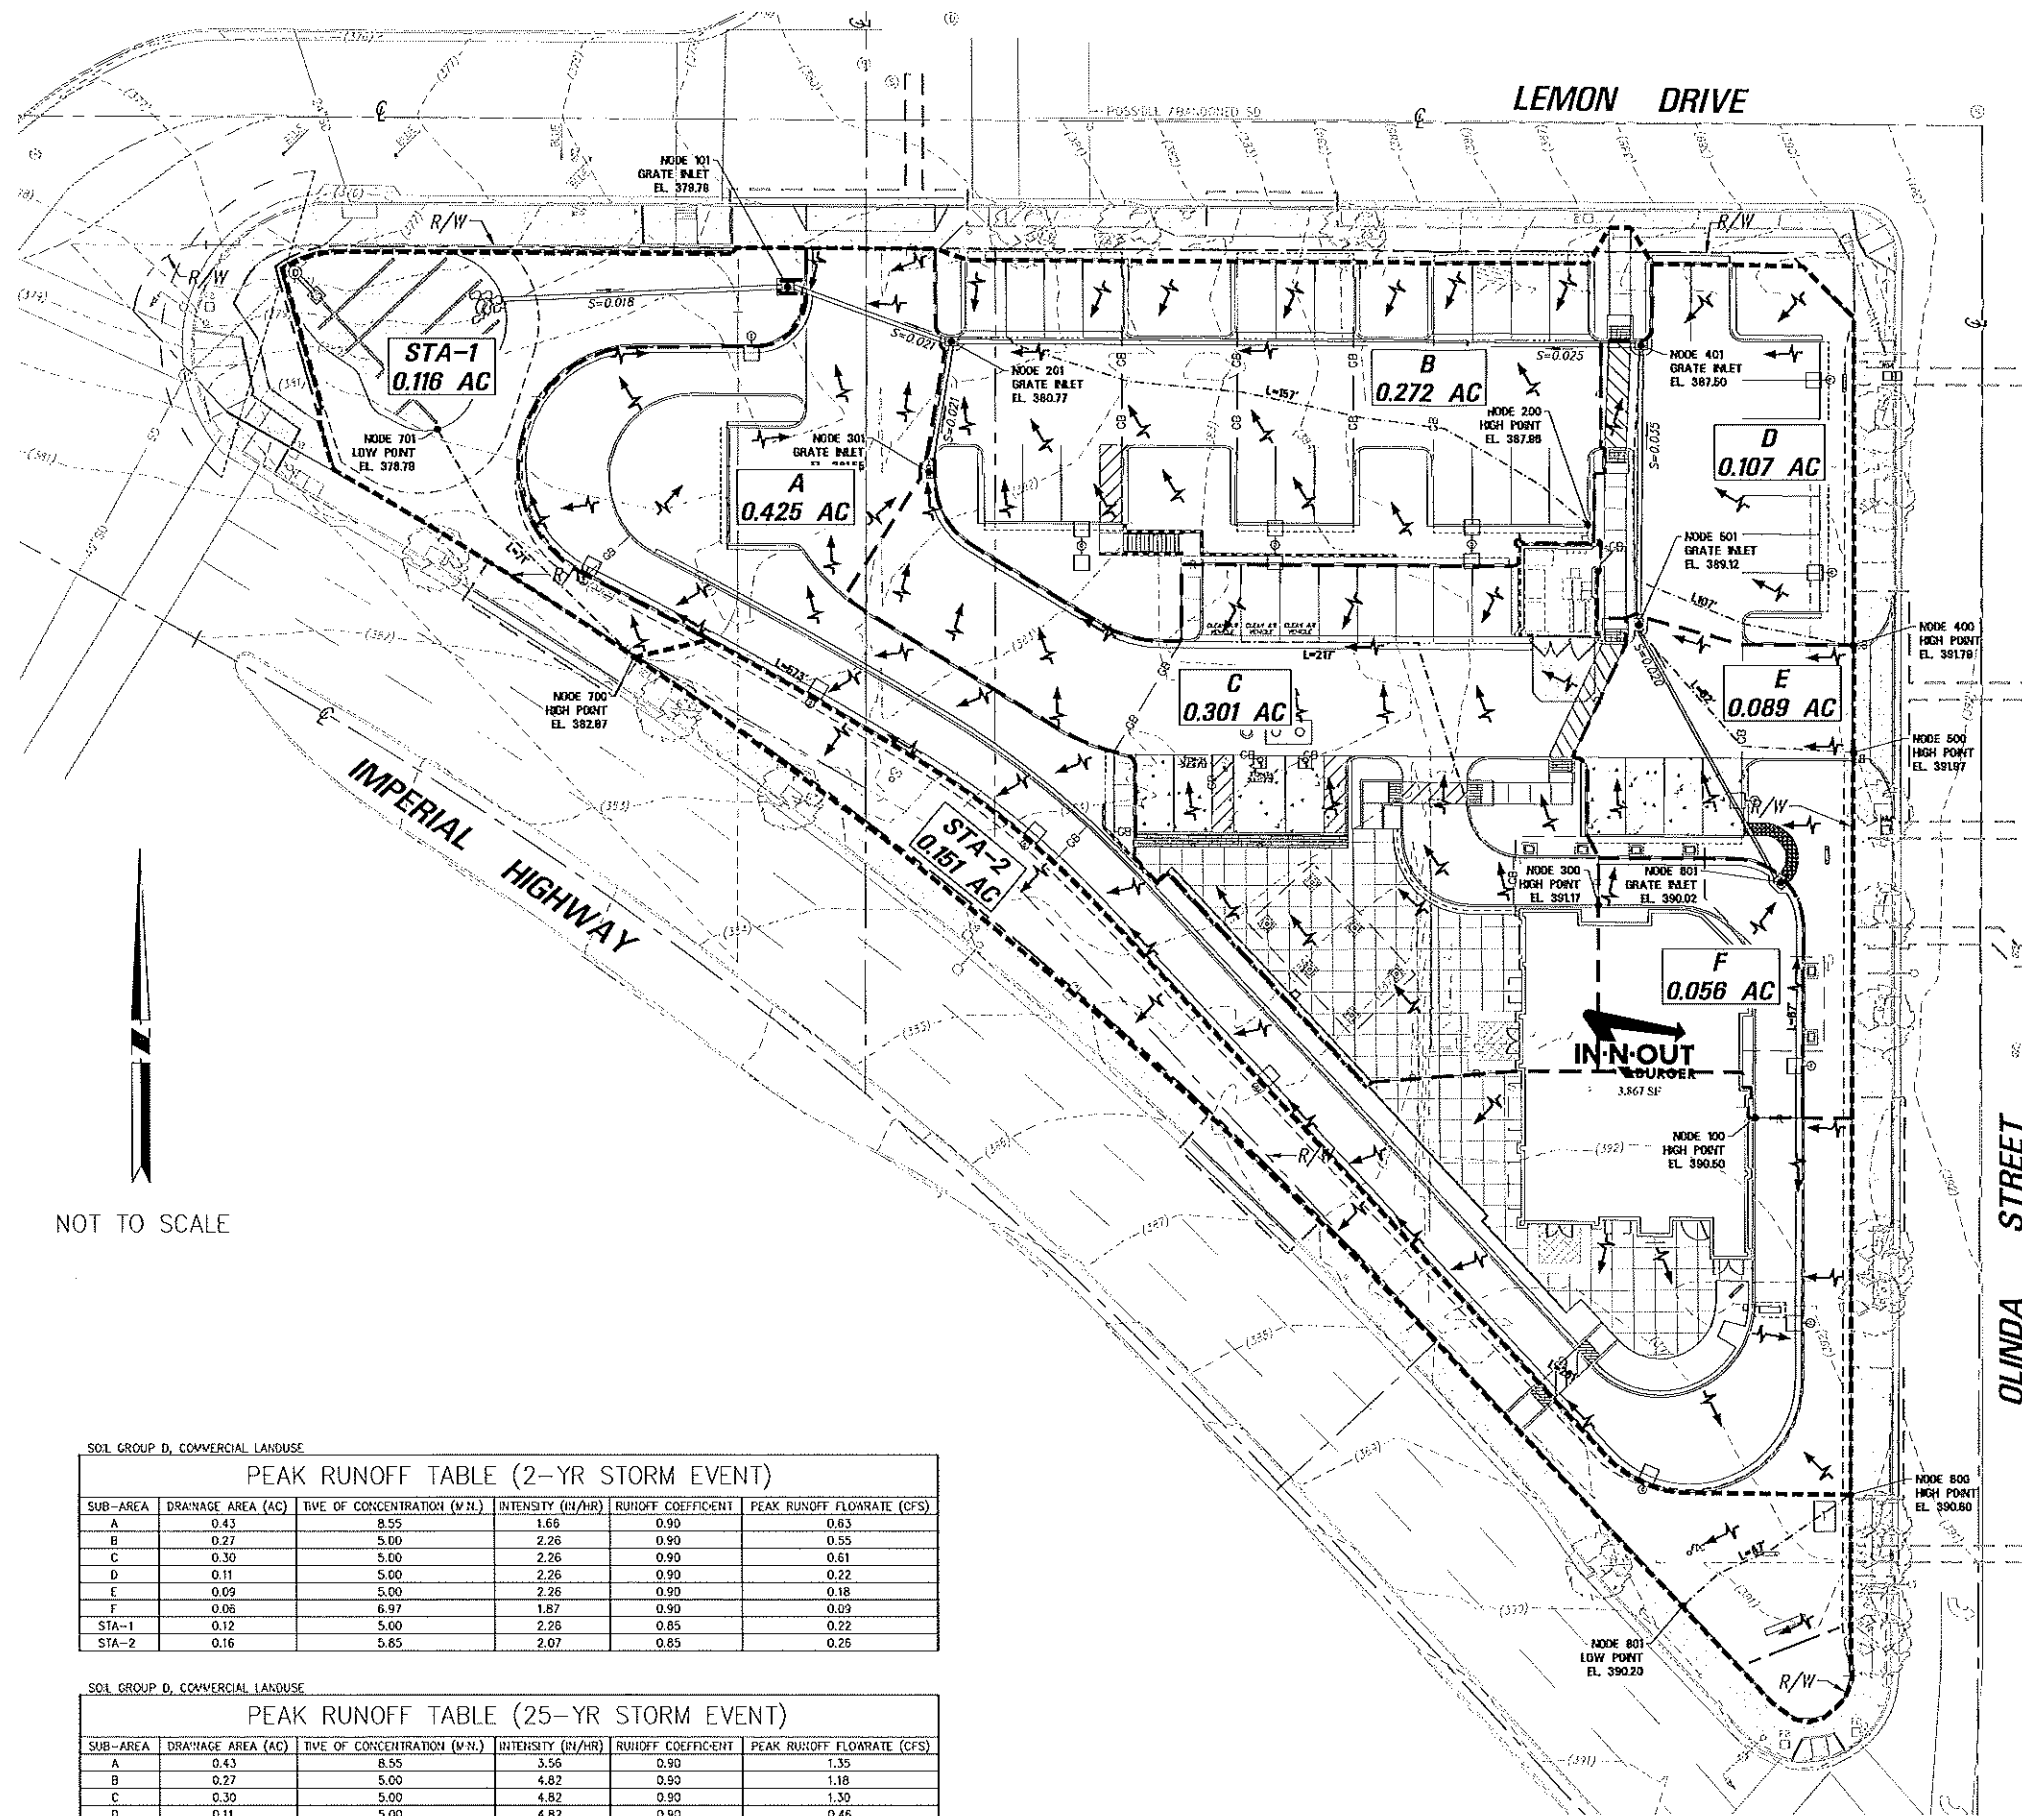

NOT TO SCALE

SOIL GROUP D, COMMERCIAL LANDUSE


PEAK RUNOFF TABLE (2-YR STORM EVENT)

SUB-AREA	DRAINAGE AREA (AC)	TIME OF CONCENTRATION (MIN.)	INTENSITY (IN/HR)	RUNOFF COEFFICIENT	PEAK RUNOFF FLOWRATE (CFS)
A	0.43	8.55	1.66	0.90	0.83
B	0.27	5.00	2.26	0.90	0.55
C	0.30	5.00	2.26	0.90	0.61
D	0.11	5.00	2.26	0.90	0.22
E	0.09	5.00	2.26	0.90	0.18
F	0.06	6.97	1.87	0.90	0.09
STA-1	0.12	5.00	2.26	0.85	0.22
STA-2	0.16	5.85	2.07	0.85	0.26

SOIL GROUP D, COMMERCIAL LANDUSE

PEAK RUNOFF TABLE (25-YR STORM EVENT)

SUB-AREA	DRAINAGE AREA (AC)	TIME OF CONCENTRATION (MIN.)	INTENSITY (IN/HR)	RUNOFF COEFFICIENT	PEAK RUNOFF FLOWRATE (CFS)
A	0.43	8.55	3.56	0.90	1.35
B	0.27	5.00	4.82	0.90	1.18
C	0.30	5.00	4.82	0.90	1.30
D	0.11	5.00	4.82	0.90	0.46
E	0.09	5.00	4.82	0.90	0.38
F	0.06	6.97	4.00	0.90	0.19
STA-1	0.12	5.00	4.82	0.85	0.49
STA-2	0.16	5.85	4.42	0.85	0.58

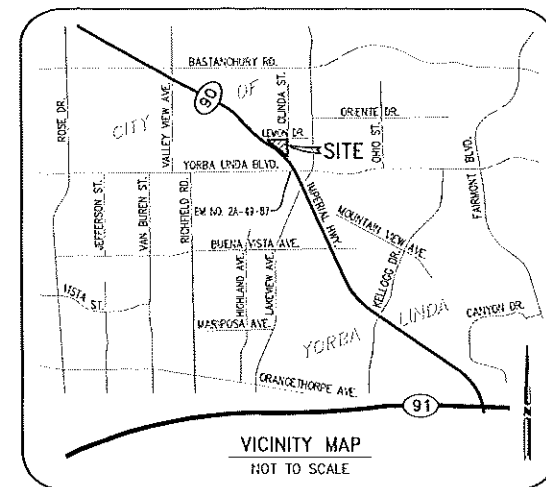

VICINITY MAP
NOT TO SCALE

LEGEND

- DRAINAGE BOUNDARY
- DRAINAGE SUB-AREA BOUNDARY
- 101 NODE
- HIGHT POINT 45Q NODE DESCRIPTION ELEVATION
- A SUB-AREA NAME
- 0.400 AC DRAINAGE AREA IN ACRES
- ← PATH OF FLOW


NOTICE TO CONTRACTOR
THE CONTRACTOR SHALL ASCERTAIN THE TRUE
VERTICAL AND HORIZONTAL LOCATION AND SIZE OF ALL
UTILITIES, PIPES, AND/OR STRUCTURES AND SHALL BE
RESPONSIBLE FOR DAMAGE TO ANY PUBLIC OR PRIVATE
UTILITIES, SHOWN OR NOT SHOWN HEREON.

IMPORTANT NOTICE
Section 4216 of the Government Code
requires a 15-day identification
Number be issued before a
"Permit to Excavate" will be issued.
For your City/County ID Number call
Underground Service Alert
1-800-485-5747
Two working days before you dig.

THIS PLAN IS:
PRELIMINARY
(NOT FOR CONSTRUCTION)

NO.	REVISIONS	DATE

Prepared by:
Joseph C. Truxaw and Associates, Inc.
Civil Engineers and Land Surveyors
285 S. Arroyo Dr., Suite 111, Orange, CA 92668 (714) 935-0265 fax: (714) 935-0106



POST-DEVELOPMENT
HYDROLOGY PLAN
IN-N-OUT BURGER
18181 IMPERIAL HWY
IN THE CITY OF YORBA LINDA
ORANGE COUNTY, STATE OF CALIFORNIA

DATE	04-16-20
DRAWN BY	PJS/MDR
CHECKED BY	SMH/CD
JOB NO.	IN018021
SHEET NO.	2
OF 2 SHEETS	

THIS PAGE INTENTIONALLY LEFT BLANK

**F.2 - County of Orange/Santa Ana Region Priority Project
Preliminary Water Quality Management Plan (WQMP)**

THIS PAGE INTENTIONALLY LEFT BLANK



WQ XX-XXXX

**County of Orange/Santa Ana
Region
Priority Project
Preliminary Water Quality Management
Plan
(WQMP)**

Project Name:

In-N-Out Burger

18181 IMPERIAL HWY

YORBA LINDA, COUNTY OF ORANGE, CA

APN: 323-303-01, -02, -03

Prepared for:

In-N-Out Burger

13502 Hamburger Lane

Baldwin Park, CA 91706

(626)-813-5375

Prepared by:

Joseph C. Truxaw & Associates, Inc.

265 S. Anita Dr. Suite 111

Orange, CA 92866

(714) 935-0265

Prepared: 01-22-19

Revised: 04-15-20



Priority Project Preliminary Water Quality Management Plan (WQMP)
In-N-Out, Yorba Linda

Project Owner's Certification			
Planning Application No. (If applicable)	CUP2019-05 DR2019-04	Grading Permit No.	Pending
Tract/Parcel Map and Lot(s) No.	Pending	Building Permit No.	Pending
Address of Project Site and APN (If no address, specify Tract/Parcel Map and Lot Numbers)			18181 Imperial Hwy, Yorba Linda, CA 323-303-01, -02, -03

This Water Quality Management Plan (WQMP) has been prepared for In-N-Out Burger by Joseph C. Truxaw & Associates. The WQMP is intended to comply with the requirements of the County of Orange NPDES Stormwater Program requiring the preparation of the plan.

The undersigned, while it owns the subject property, is responsible for the implementation of the provisions of this plan, including the ongoing operation and maintenance of all best management practices (BMPs), and will ensure that this plan is amended as appropriate to reflect up-to-date conditions on the site consistent with the current Orange County Drainage Area Management Plan (DAMP) and the intent of the non-point source NPDES Permit for Waste Discharge Requirements for the County of Orange, Orange County Flood Control District and the incorporated Cities of Orange County within the Santa Ana Region. Once the undersigned transfers its interest in the property, its successors-in-interest shall bear the aforementioned responsibility to implement and amend the WQMP. An appropriate number of approved and signed copies of this document shall be available on the subject site in perpetuity.

Owner:			
Title	Michelle Bennett, Development Manager		
Company	In-N-Out Burger		
Address	13502 Hamburger Lane, Baldwin Park, CA 91706		
Email	mbennett@innout.com		
Telephone #	(626) 813-5375		
I understand my responsibility to implement the provisions of this WQMP including the ongoing operation and maintenance of the best management practices (BMPs) described herein.			
Owner Signature		Date	

Water Quality Management Plan (WQMP)
In-N-Out, Yorba Linda

Preparer (Engineer): Craig Di Bias, PE			
Title	Civil Engineer	PE Registration #	75205
Company	Joseph C. Truxaw & Associates, Inc.		
Address	265 S. Anita Dr., Suite 111		
Email	craigdibias@truxaw.com		
Telephone #	(714) 935-0265		
I hereby certify that this Water Quality Management Plan is in compliance with, and meets the requirements set forth in, Order No. R8-2009-0030/NPDES No. CAS618030, of the Santa Ana Regional Water Quality Control Board.			
Preparer Signature		Date	
Place Stamp Here			

Contents

Page No.

Section I	Permit(s) and Water Quality Conditions of Approval or Issuance	1
Section II	Project Description	3
Section III	Site Description	8
Section IV	Best Management Practices (BMPs)	11
Section V	Inspection/Maintenance Responsibility for BMPs	27
Section VI	BMP Exhibit (Site Plan).....	34
Section VII	Educational Materials	35

Attachments

Attachment A.. Educational Materials
Attachment B.. Reference Maps
Attachment C..Worksheet B: Simple Design Capture Volume Sizing Method
Attachment D Soils Report
Attachment E..WQMP BMP Exhibit

Section I Permit(s) and Water Quality Conditions of Approval or Issuance

Provide discretionary or grading/building permit information and water quality conditions of approval, or permit issuance, applied to the project. If conditions are unknown, please request applicable conditions from staff. *Refer to Section 2.1 in the Technical Guidance Document (TGD) available on the OC Planning website (ocplanning.net).*

Project Information			
Permit/ Application No. (If applicable)	CUP 2019-05 DR 2019-04	Grading or Building Permit No. (If applicable)	Pending
Address of Project Site (or Tract Map and Lot Number if no address) and APN	18181 Imperial Hwy Yorba Linda, CA		
Water Quality Conditions of Approval or Issuance			
Water Quality Conditions of Approval or Issuance applied to this project. (Please list verbatim.)	No conditions known at time of this submittal		
Conceptual WQMP			
Was a Conceptual Water Quality Management Plan previously approved for this project?	No		

Watershed-Based Plan Conditions

Provide applicable conditions from watershed - based plans including WIHMPs and TMDLS.

Santa Ana River, Reach 2 – TMDL Required List: Alachlor, Atrazine, Azinphos-methyl, Carbaryl, Carbofuran, Chlorpyrifos, DDE, Diazinon, Dieldrin, Disulfoton, Malathion, Methyl, Parathion, Molinate, Simazine, Thiobencarb/Bolero, Cadmium, Copper, Indicator Bacteria, Lead

No WIHMP currently exists for this watershed

Section II Project Description

II.1 Project Description

Provide a detailed project description including:

- Project areas;
- Land uses;
- Land cover;
- Design elements;
- A general description not broken down by drainage management areas (DMAs).

Include attributes relevant to determining applicable source controls. *Refer to Section 2.2 in the Technical Guidance Document (TGD) for information that must be included in the project description.*

Description of Proposed Project				
Development Category (From Model WQMP, Table 7.11-2; or -3):	Priority Development Project			
Project Area (ft²): 71,738	Number of Dwelling Units: N/A		SIC Code: 5812	
Project Area	Pervious		Impervious	
	Area (acres or sq ft)	Percentage	Area (acres or sq ft)	Percentage
Pre-Project Conditions	19,809 sf	29.4%	47,492 sf	70.6%
Post-Project Conditions	22,316 sf	33.8%	43,763 sf	66.2%
Drainage Patterns/Connections	<p>The existing site conditions consist of the Yorba Linda Library, parking areas, and a dirt lot with soil remediation equipment. The site is bounded by three streets, Imperial Hwy to the south and west, Lemon Dr. to the north, and Olinda St. to the east. There is a significant grade difference across the site of about 16'.</p> <p>EXISTING CONDITION</p> <p>Due to the significant grade difference the library parking areas are separated by a retaining wall. The higher parking area is located nearest to the corner of Olinda St. and Imperial Hwy and drains away from the building towards Imperial where the runoff is collected by a grated inlet. The grated inlet discharges runoff</p>			

<p>Narrative Project Description: (Use as much space as necessary.)</p>	<p>to the lower parking lot through a storm drain pipe that connects the drainage from the higher elevation parking area to the lower parking area. The remainder of the lower parking area flows northwest where the runoff enters an under sidewalk drain and discharges into Lemon Dr. The runoff is picked up by the curb & gutter in Lemon Dr. and conveyed to the catch basin at the low point. The dirt lot west of the library sheet flows to the low point and enters Lemon Dr. and discharged at the low point.</p> <p>PROPOSED CONDITION</p> <p>The proposed development will raze the existing library building, asphalt pavement, curbs, v-gutter, landscape, etc. and significant grading will be performed to accommodate the new In-N-Out building location which will be along Imperial Hwy. Multiple retaining walls will be constructed to make up the grade difference across the site and a storm drain system will direct runoff to the low point of the site. A bio-retention basin is proposed at the northwest corner of the site where all the stormwater runoff from impervious surfaces will discharge. The proposed grading divides the site into eight drainage areas. Six of the drainage areas will consists of new impervious surfaces which will collect runoff into a corresponding grated inlet and convey runoff to the bio-retention basin. The remaining two areas consist of landscape only and can be considered 'Self-Treating' areas. One of these areas (STA-1) is the basin itself, and the other area (STA-2) is a landscaped area between the drive-thru and Imperial Hwy that will discharge into Imperial Hwy.</p>
---	---

II.2 Potential Stormwater Pollutants

Determine and list expected stormwater pollutants based on land uses and site activities. *Refer to Section 2.2.2 and Table 2.1 in the Technical Guidance Document (TGD) for guidance.*

Pollutants of Concern			
Pollutant	Check One for each: E=Expected to be of concern N=Not Expected to be of concern		Additional Information and Comments
Suspended-Solid/ Sediment	E <input checked="" type="checkbox"/>	N <input type="checkbox"/>	
Nutrients	E <input checked="" type="checkbox"/>	N <input type="checkbox"/>	
Heavy Metals	E <input checked="" type="checkbox"/>	N <input type="checkbox"/>	
Pathogens (Bacteria/Virus)	E <input checked="" type="checkbox"/>	N <input type="checkbox"/>	
Pesticides	E <input checked="" type="checkbox"/>	N <input type="checkbox"/>	
Oil and Grease	E <input checked="" type="checkbox"/>	N <input type="checkbox"/>	
Toxic Organic Compounds	E <input type="checkbox"/>	N <input checked="" type="checkbox"/>	
Trash and Debris	E <input checked="" type="checkbox"/>	N <input type="checkbox"/>	

II.3 Hydrologic Conditions of Concern

Determine if streams located downstream from the project area are potentially susceptible to hydromodification impacts. *Refer to Section 2.2.3.1 in the Technical Guidance Document (TGD) for North Orange County or Section 2.2.3.2 for South Orange County.*


☐ No – Show map

☒ Yes – Describe applicable hydrologic conditions of concern below. *Refer to Section 2.2.3 in the Technical Guidance Document (TGD).*

The proposed condition of the site drainage will capture runoff from all impervious surfaces into the bio-retention basin. The treated runoff and/or overflow will enter the municipal storm drain system where the runoff travels through a concrete storm drain and into an O.C.F.C.D. facility (E05). Just before the runoff enters the O.C.F.C.D facility, there are two segments of the local facility that are 'natural watercourses' and are therefore potentially susceptible to hydromodification impacts. Per Section 2.2.3.1 of the TGD an HCOC exists if any downstream facility that the runoff enters is potentially susceptible to hydromodification impacts AND either the Post Development runoff volume for the 2-yr 24-hr storm exceeds the predevelopment volume by more than 5% OR the time of concentration of the post-development runoff for the 2-yr 24-hr storm event exceed the pre-development time of concentration by more than 5%.

In the case of this project, an HCOC exists due to the downstream facility's susceptibility to hydromodification and the post-development time of concentration for the 2-yr 24-yr storm is 71% greater than the pre-development. However, calculating the runoff volume for the 2-yr 24-hour storm event at the max allowable time of concentration (5% greater than pre-development condition) yields a volume that is less than the pre-adjusted time of concentration, therefore there is no additional volume to retain.

See following map and runoff volume calculations.

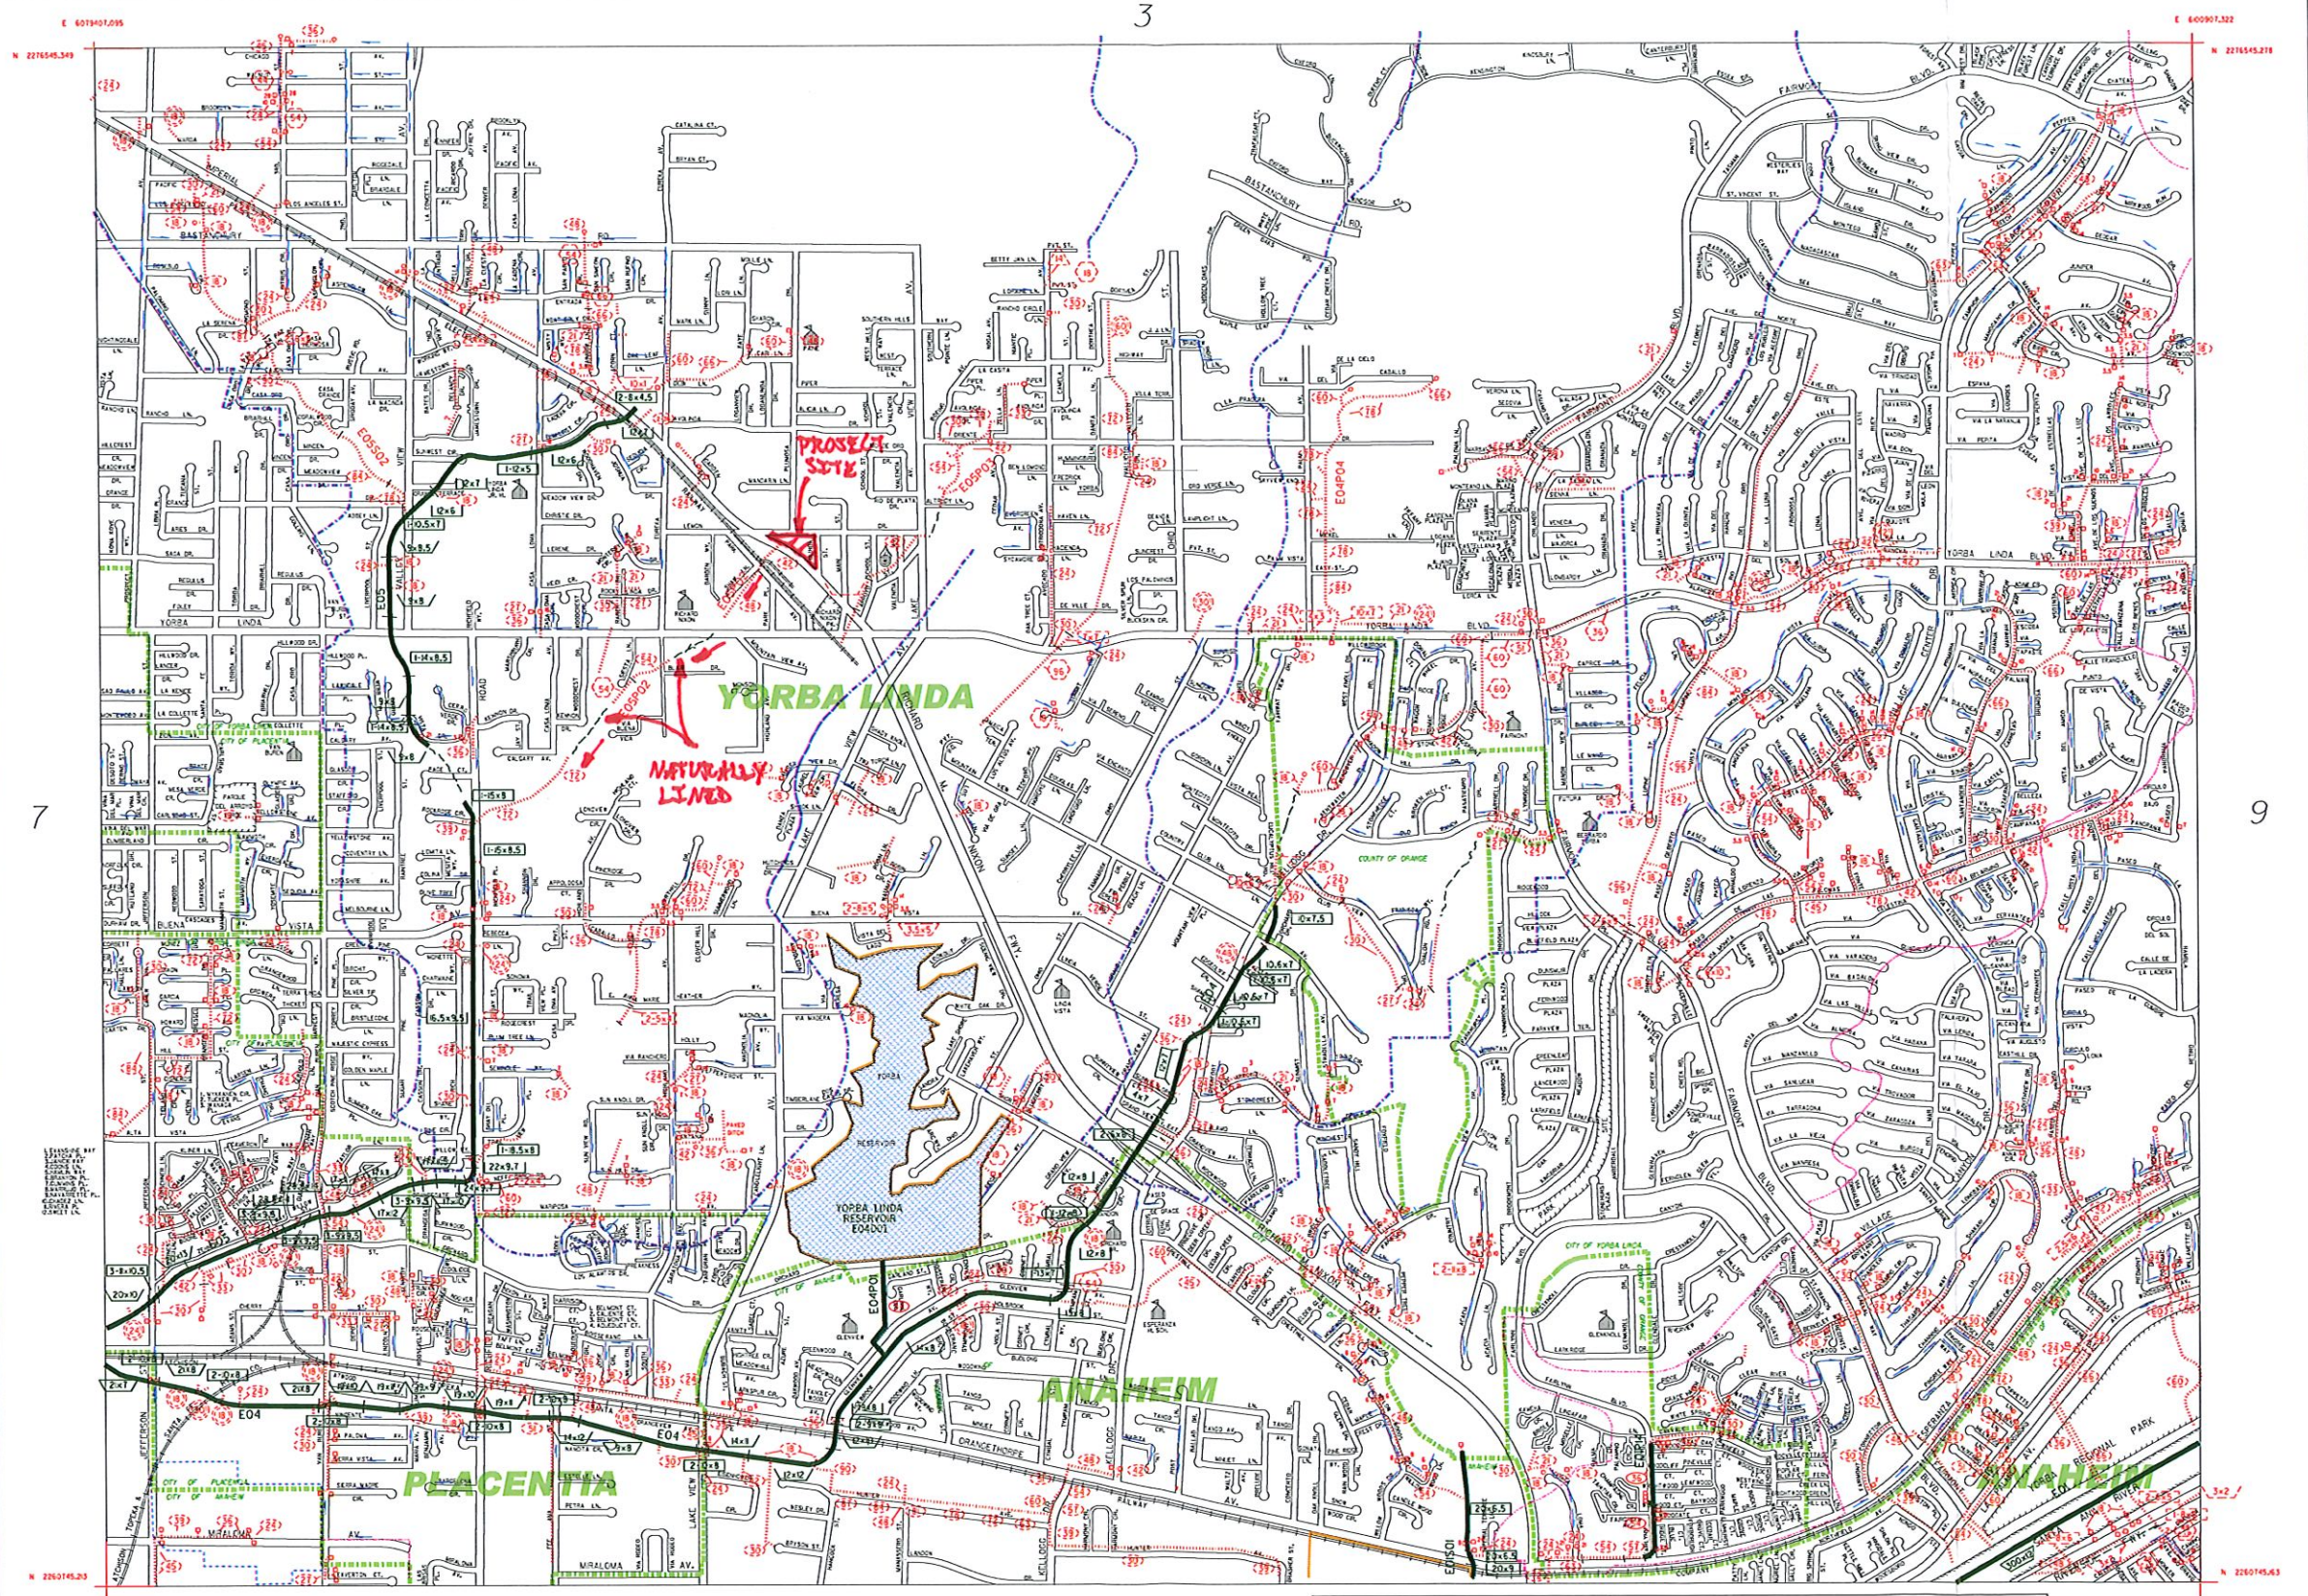

8

NOTICE

The drainage information has been prepared for information purposes only. The location, ownership, facility information and limits have been determined from available information provided by public agencies, but may not be exact, accurate, or up-to-date. The user of this information is responsible for verifying exact location, ownership, accuracy, and the regional versus local character of drainage facilities.

Additional information may be obtained from public plans and recorded deeds. Facility designations included with this information are for convenience only and are not controlling or intended to imply ownership by the County or the Orange County Flood Control District (OCFCD). The information is being provided as a courtesy and neither the County of Orange nor OCFCD assume any liability for inaccuracy of the information.

To notify OC Public Works Flood Control Section of additions or corrections, please contact Sal Gutierrez at (714) 834-5336 or by email at sal.gutierrez@ocpw.org.

15

ORANGE COUNTY FLOOD CONTROL DISTRICT

BASE MAP OF DRAINAGE FACILITIES IN ORANGE COUNTY

REVISION: 8/2008 DATE: 8/2008 SHEET NO: 8 OF 8 MAPS-113-3

Channel Drainage Area Boundary
Major Sub-Area Drainage Boundary
Minor Sub-Area Drainage Boundary
Existing O.C.F.C.D. Facility
Existing Local Facility
Existing Retaining Basin or Reservoir
Natural Watercourse
City Limits
Pump Station
Catch Basin (depth in feet)
Drop Inlet or Drop Entry
OCFCD Basins or Reservoirs

OWNERSHIP: Other than City or County: --- City or County: --- Scale: --- Revised: ---

EXISTING FACILITIES

LOCAL

Earth Trapezoidal Channel (base width by height in feet)
Reinforced Concrete Trapezoidal Channel (base width by height in feet)
Reinforced Concrete Rectangular Channel (base width by height in feet)
Reinforced Concrete Box (VCOB) (number of bays/width by height in feet)
Reinforced Concrete Pipe (RCP) (diameter in inches)
Metal Sheet Channel (MSC) (base width by height in feet sheet pile total length)
Corrugated Metal Pipe (CMP) (diameter in inches)
Concrete Pipe (diameter in inches)
Concrete Oval Pipe (width by height in inches)
Steel Pipe (diameter in inches)
Reinforced Concrete Arch (base span by height in inches)
Corrugated Metal Arch (base span by height in inches)

8

II.4 Post Development Drainage Characteristics

Describe post development drainage characteristics. *Refer to Section 2.2.4 in the Technical Guidance Document (TGD).*

The proposed grading will follow the natural grade of the site and flow to the northwest corner of the site. Once the runoff is treated by the bio-treatment basin it enters a municipal storm drain that passes through the corner of the site. Once in the municipal storm drain it passes through a natural water course before entering a O.C.F.C.D. facility (Eo5). The runoff eventually enters the Santa Ana River where it is discharged into the Pacific Ocean.

The onsite runoff will be captured onsite using curb & gutter, v-gutters, grate inlets, and storm drain pipes.

II.5 Property Ownership/Management

Describe property ownership/management. *Refer to Section 2.2.5 in the Technical Guidance Document (TGD).*

The property is currently under transfer of ownership from the City of Yorba Linda to In-N-Out Burger. Sale is pending.

Section III Site Description

III.1 Physical Setting

Fill out table with relevant information. *Refer to Section 2.3.1 in the Technical Guidance Document (TGD).*

Name of Planned Community/Planning Area (if applicable)	This site currently falls in the City of Yorba Linda Town Center Commercial District
Location/ Address	18181 Imperial Hwy
	Yorba Linda, CA
General Plan Land Use Designation	Yorba Linda Town Center
Zoning	Town Center Commercial District
Acreage of Project Site	1.53
Predominant Soil Type	Group D

III.2 Site Characteristics

Fill out table with relevant information and include information regarding BMP sizing, suitability, and feasibility, as applicable. *Refer to Section 2.3.2 in the Technical Guidance Document (TGD).*

Site Characteristics	
Precipitation Zone	0.85
Topography	The topography of the site is moderately sloped. The highest point of the site exists at the corner of Imperial Hwy and Olinda St. with an elevation of approx. 391.00 and the low point of the site exists at the northwest corner of the site in Lemon Ave. with an elevation of approx. 376.50.

Drainage Patterns/Connections	The proposed grading will follow the natural topography of the site and drain to the northwest corner of the site by curb & gutter, v-gutters, grate inlets and storm drain pipes.
Soil Type, Geology, and Infiltration Properties	Soil Group D, Infiltration Rates = 0.21 and 0.28 in/hr (see Soils Report by Krazan & Associates, Inc.) Soil Remediation equipment has been removed from the dirt lot at the northwest corner of the site, however the case is currently open as a LUST site.
Hydrogeologic (Groundwater) Conditions	N/A
Geotechnical Conditions (relevant to infiltration)	Infiltration Rates = 0.21 and 0.28 in/hr (See Soils Report by Krazan & Associates, Inc.)
Off-Site Drainage	No Offsite drainage exists on the site.
Utility and Infrastructure Information	All existing utilities are to be removed during demolition phase of the project with the exception of the municipal storm drain at the northwest corner of the site and abandonment of 8-inch sewer.

III.3 Watershed Description

Fill out table with relevant information and include information regarding BMP sizing, suitability, and feasibility, as applicable. *Refer to Section 2.3.3 in the Technical Guidance Document (TGD).*

Receiving Waters	O.C.F.C.D. drainage facility (E05), Santa Ana River Reach 2, Santa Ana River Reach 1, and Pacific Ocean
303(d) Listed Impairments	Indicator Bacteria
Applicable TMDLs	Alachlor, Altrazine, Azinphos-methyl, Carbaryl, Cargofuran, Chlorpyrifos, DDE, Diazinon, Dieldrin, Disulfoton, Malathion, Methyl, Parathion, Molinate, Simazine, Thiobencarb/Bolero, Cadmium, Copper, Lead
Pollutants of Concern for the Project	None

Priority Project Water Quality Management Plan (WQMP)
In-N-Out, Yorba Linda

Environmentally Sensitive and Special Biological Significant Areas	N/A
--	-----

Section IV Best Management Practices (BMPs)

IV. 1 Project Performance Criteria

Describe project performance criteria. Several steps must be followed in order to determine what performance criteria will apply to a project. These steps include:

- If the project has an approved WIHMP or equivalent, then any watershed specific criteria must be used and the project can evaluate participation in the approved regional or sub-regional opportunities. (Please ask your assigned planner or plan checker regarding whether your project is part of an approved WIHMP or equivalent.)
- Determine applicable hydromodification control performance criteria. *Refer to Section 7.II-2.4.2.2 of the Model WQMP.*
- Determine applicable LID performance criteria. *Refer to Section 7.II-2.4.3 of the Model WQMP.*
- Determine applicable treatment control BMP performance criteria. *Refer to Section 7.II-3.2.2 of the Model WQMP.*
- Calculate the LID design storm capture volume for the project. *Refer to Section 7.II-2.4.3 of the Model WQMP.*

(NOC Permit Area only) Is there an approved WIHMP or equivalent for the project area that includes more stringent LID feasibility criteria or if there are opportunities identified for implementing LID on regional or sub-regional basis?		YES <input type="checkbox"/>	NO <input checked="" type="checkbox"/>
If yes, describe WIHMP feasibility criteria or regional/sub-regional LID opportunities.			

Project Performance Criteria	
If HCOC exists, list applicable hydromodification control performance criteria (Section 7.II-2.4.2.2 in MWQMP)	HCOC exists but calculations show that no volume is required to retain
List applicable LID performance criteria (Section 7.II-2.4.3 from MWQMP)	Prioriy Projects must infiltrate, harvest and use, evapotranspire, or biotreat/biofilter, the 85 th percentile, 24-hour storm event (Design Capture Volume)
List applicable treatment control BMP performance criteria (Section 7.II-3.2.2 from MWQMP)	If it is not feasible to meet LID performance criteria through retention and/or bio-treatment provided on-site or at a sub-regional/regional scale, then treatment control BMPs shall be provided on-site or offsite prior to discharge to waters of the US. Sizing of treatment control BMPs (s) shall be based on either the unmet volume after claiming applicable water quality credits, if appropriate (See Section 7.II-3.1 Water Quality Credits) and as calculated in TGD Appendix VI. If treatment control BMPs can treat all of the remaining unmet volume and have a medium to high effectiveness for reducing the primary POCs, the project is considered to be in compliance; a waiver application and participation in an alternative program is not required.
Calculate LID design storm capture volume for Project.	Design Capture Volume = 2,893 cu.ft. Design Depth = 0.85 in Tributary Area = 1.25 ac (Does not include Self-Treating Areas) C = 0.75 For calculation of the DCV see Attachment C: Worksheet B

IV.2. Site Design and Drainage

Describe site design and drainage including

- A narrative of site design practices utilized or rationale for not using practices;
- A narrative of how site is designed to allow BMPs to be incorporated to the MEP
- A table of DMA characteristics and list of LID BMPs proposed in each DMA.
- Reference to the WQMP "BMP Exhibit."
- Calculation of Design Capture Volume (DCV) for each drainage area.
- A listing of GIS coordinates for LID and Treatment Control BMPs.

Refer to Section 2.4.2 in the Technical Guidance Document (TGD).

The proposed development will raze the existing library building, asphalt pavement, curbs, v-gutter, landscape, etc. and significant grading will be performed to accommodate the new In-N-Out building location which will be along Imperial Hwy. Multiple retaining walls will be constructed to make up the grade difference across the site and a storm drain system will be placed to direct runoff to the low point of the site. A bio-retention basin is proposed at the northwest corner of the site where all the stormwater runoff from impervious surfaces will discharge. The proposed grading divides the site into seven drainage areas. Five of the drainage areas will consists of new impervious surfaces which will collect runoff into a corresponding grated inlet and convey runoff to the bio-retention basin. The remaining two areas consist of landscape only and can be considered 'Self-Treating' areas. One of these areas (STA-1) is the basin itself, and the other area (STA-2) is a landscaped area between the drive-thru and Imperial Hwy that will discharge into Imperial Hwy.

See Attachment C: WorksheetB: Simple Design Capture Volume Sizing Method for DCV calculations

See Attachment E: WQMP BMP Exhibit for BMP coordinates

Tributary Area	Total Area (ac)	Impervious Area (%)	Design Capture Volume (cu.ft.)	Proposed BMP
Sub-Areas A, B,C,D, E & F	1.25	80.3%	2,893	Bio-Retention Basin
STA-1	0.116	100.0%	N/A	Bio-Retention Basin
STA-2	0.151	100.00%	N/A	N/A

IV.3 LID BMP Selection and Project Conformance Analysis

Each sub-section below documents that the proposed design features conform to the applicable project performance criteria via check boxes, tables, calculations, narratives, and/or references to worksheets. *Refer to Section 2.4.2.3 in the Technical Guidance Document (TGD) for selecting LID BMPs and Section 2.4.3 in the Technical Guidance Document (TGD) for conducting conformance analysis with project performance criteria.*

IV.3.1 Hydrologic Source Controls (HSCs)

If required HSCs are included, fill out applicable check box forms. If the retention criteria are otherwise met with other LID BMPs, include a statement indicating HSCs not required.

Name	Included?
Localized on-lot infiltration	<input type="checkbox"/>
Impervious area dispersion (e.g. roof top disconnection)	<input type="checkbox"/>
Street trees (canopy interception)	<input type="checkbox"/>
Residential rain barrels (not actively managed)	<input type="checkbox"/>
Green roofs/Brown roofs	<input type="checkbox"/>
Blue roofs	<input type="checkbox"/>
Impervious area reduction (e.g. permeable pavers, site design)	<input type="checkbox"/>
Other:	<input type="checkbox"/>
Other:	<input type="checkbox"/>
Other:	<input type="checkbox"/>
Other:	<input type="checkbox"/>
Other:	<input type="checkbox"/>
Other:	<input type="checkbox"/>
Other:	<input type="checkbox"/>
Other:	<input type="checkbox"/>

***All retention criteria is met with bio-retention basin BMP, therefore no HSCs are required. See BMP calculations in Section IV.3.4.**

IV.3.2 Infiltration BMPs

Identify infiltration BMPs to be used in project. If design volume cannot be met, state why.

Name	Included?
Bioretention without underdrains	<input type="checkbox"/>
Rain gardens	<input type="checkbox"/>
Porous landscaping	<input type="checkbox"/>
Infiltration planters	<input type="checkbox"/>
Retention swales	<input type="checkbox"/>
Infiltration trenches	<input type="checkbox"/>
Infiltration basins	<input type="checkbox"/>
Drywells	<input type="checkbox"/>
Subsurface infiltration galleries	<input type="checkbox"/>
French drains	<input type="checkbox"/>
Permeable asphalt	<input type="checkbox"/>
Permeable concrete	<input type="checkbox"/>
Permeable concrete pavers	<input type="checkbox"/>
Other:	<input type="checkbox"/>
Other:	<input type="checkbox"/>

Show calculations below to demonstrate if the LID Design Storm Capture Volume can be met with infiltration BMPs. If not, document how much can be met with infiltration and document why it is not feasible to meet the full volume with infiltration BMPs.

No infiltration BMPs were incorporated into the site design due to:

1. Low Infiltration Rates – 0.21 in/hr & 0.28 in/hr (see Soils Report)
2. Open LUST case at northwest corner of site.

IV.3.3 Evapotranspiration, Rainwater Harvesting BMPs

If the full Design Storm Capture Volume cannot be met with infiltration BMPs, describe any evapotranspiration and/or rainwater harvesting BMPs included.

Name	Included?
All HSCs; See Section IV.3.1	<input type="checkbox"/>
Surface-based infiltration BMPs	<input type="checkbox"/>
Biotreatment BMPs	<input type="checkbox"/>
Above-ground cisterns and basins	<input type="checkbox"/>
Underground detention	<input type="checkbox"/>
Other:	<input type="checkbox"/>
Other:	<input type="checkbox"/>
Other:	<input type="checkbox"/>

Show calculations below to demonstrate if the LID Design Storm Capture Volume can be met with evapotranspiration and/or rainwater harvesting BMPs in combination with infiltration BMPs. If not, document below how much can be met with either infiltration BMPs, evapotranspiration, rainwater harvesting BMPs, or a combination, and document why it is not feasible to meet the full volume with these BMP categories.

No evapotranspiration and/or rainwater harvesting BMPs were incorporated into the site design due to:

1. Low irrigation use demand and low evapotranspiration demand, i.e. cannot drawdown DCV is sufficient time.

IV.3.4 Biotreatment BMPs

If the full Design Storm Capture Volume cannot be met with infiltration BMPs, and/or evapotranspiration and rainwater harvesting BMPs, describe biotreatment BMPs included. Include sections for selection, suitability, sizing, and infeasibility, as applicable.

Name	Included?
Bioretention with underdrains	<input checked="" type="checkbox"/>
Stormwater planter boxes with underdrains	<input type="checkbox"/>
Rain gardens with underdrains	<input type="checkbox"/>
Constructed wetlands	<input type="checkbox"/>
Vegetated swales	<input type="checkbox"/>
Vegetated filter strips	<input type="checkbox"/>
Proprietary vegetated biotreatment systems	<input type="checkbox"/>
Wet extended detention basin	<input type="checkbox"/>
Dry extended detention basins	<input type="checkbox"/>
Other:	<input type="checkbox"/>
Other:	<input type="checkbox"/>

Show calculations below to demonstrate if the LID Design Storm Capture Volume can be met with infiltration, evapotranspiration, rainwater harvesting and/or biotreatment BMPs. If not, document how much can be met with either infiltration BMPs, evapotranspiration, rainwater harvesting BMPs, or a combination, and document why it is not feasible to meet the full volume with these BMP categories.

DCV = 2,893 cu.ft. Basin Surface Area = 1,521 sf
Ponding Surface Volume = $0.5' \times 1,521 \text{ sf} = 761 \text{ cu.ft.}$
Mulch Layer Volume = $0.25' \times 1,521 \text{ sf} \times 0.50 = 190 \text{ cu.ft.}$
Engineered Soil Layer = $2.0' \times 1,521 \text{ sf} \times 0.30 = 913 \text{ cu.ft.}$
Gravel Layer = $1.75' \times 1,521 \text{ sf} \times 0.40 = 1,065 \text{ cu.ft.}$
Provided Storage Volume in Basin = 2,929 cu.ft.
See attached Worksheet C for calculation of Design Capture Volume (DCV)
Drawdown Time = $(d_p / K_{\text{design}}) \times 12 \text{ in/ft}$
= $(0.5' / 2.5 \text{ in/hr}) \times 12 \text{ in/ft} = 2.4 \text{ hrs.}$ Use min. drawdown time = 3 hrs

Describe hydromodification control BMPs. *See Section 5 of the Technical Guidance Document (TGD).*

IV.3.6 Regional/Sub-Regional LID BMPs

Describe regional/sub-regional LID BMPs in which the project will participate. Refer to Section 7.II-

Regional/Sub-Regional LID BMPs

Section IV

IV.3.7 Treatment Control BMPs

Treatment control BMPs can only be considered if the project conformance analysis indicates that it is not feasible to retain the full design capture volume with LID BMPs. Describe treatment control BMPs including sections for selection, sizing, and infeasibility, as applicable.

Treatment Control BMPs	
BMP Name	BMP Description

IV.3.8 Non-structural Source Control BMPs

Fill out non-structural source control check box forms or provide a brief narrative explaining if non-structural source controls were not used.

Non-Structural Source Control BMPs				
Identifier	Name	Check One		If not applicable, state brief reason
		Included	Not Applicable	
N1	Education for Property Owners, Tenants and Occupants	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
N2	Activity Restrictions	<input type="checkbox"/>	<input checked="" type="checkbox"/>	Site will be monitored by restaurant operators and video surveillance
N3	Common Area Landscape Management	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
N4	BMP Maintenance	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
N5	Title 22 CCR Compliance (How development will comply)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	No hazardous materials expected
N6	Local Industrial Permit Compliance	<input type="checkbox"/>	<input checked="" type="checkbox"/>	No industrial waste expected
N7	Spill Contingency Plan	<input type="checkbox"/>	<input checked="" type="checkbox"/>	No hazardous materials expected
N8	Underground Storage Tank Compliance	<input type="checkbox"/>	<input checked="" type="checkbox"/>	No underground tanks will be installed on this site
N9	Hazardous Materials Disclosure Compliance	<input type="checkbox"/>	<input checked="" type="checkbox"/>	No hazardous materials expected
N10	Uniform Fire Code Implementation	<input type="checkbox"/>	<input checked="" type="checkbox"/>	No hazardous materials expected
N11	Common Area Litter Control	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
N12	Employee Training	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
N13	Housekeeping of Loading Docks	<input type="checkbox"/>	<input checked="" type="checkbox"/>	No loading docks will be constructed on this site
N14	Common Area Catch Basin Inspection	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
N15	Street Sweeping Private Streets and Parking Lots	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
N16	Retail Gasoline Outlets	<input type="checkbox"/>	<input checked="" type="checkbox"/>	

IV.3.9 Structural Source Control BMPs

Fill out structural source control check box forms or provide a brief narrative explaining if structural source controls were not used.

Structural Source Control BMPs				
Identifier	Name	Check One		If not applicable, state brief reason
		Included	Not Applicable	
S1	Provide storm drain system stenciling and signage	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
S2	Design and construct outdoor material storage areas to reduce pollution introduction	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
S3	Design and construct trash and waste storage areas to reduce pollution introduction	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
S4	Use efficient irrigation systems & landscape design, water conservation, smart controllers, and source control	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
S5	Protect slopes and channels and provide energy dissipation	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
	Incorporate requirements applicable to individual priority project categories (from SDRWQCB NPDES Permit)	<input type="checkbox"/>	<input type="checkbox"/>	
S6	Dock areas	<input type="checkbox"/>	<input checked="" type="checkbox"/>	No loading docks will be constructed on this site
S7	Maintenance bays	<input type="checkbox"/>	<input checked="" type="checkbox"/>	No maintenance bays will be constructed on this site
S8	Vehicle wash areas	<input type="checkbox"/>	<input checked="" type="checkbox"/>	No vehicle wash areas on this site
S9	Outdoor processing areas	<input type="checkbox"/>	<input checked="" type="checkbox"/>	No processing areas on this site
S10	Equipment wash areas	<input type="checkbox"/>	<input checked="" type="checkbox"/>	No equipment washing will occur on this site
S11	Fueling areas	<input type="checkbox"/>	<input checked="" type="checkbox"/>	No fueling areas will exist on this site
S12	Hillside landscaping	<input type="checkbox"/>	<input checked="" type="checkbox"/>	No significant hillsides exist on this site
S13	Wash water control for food preparation areas	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Food preparation areas will be inside the building and drained to the grease waste line.

Priority Project Water Quality Management Plan (WQMP)
In-N-Out, Yorba Linda

S14	Community car wash racks	<input type="checkbox"/>	<input checked="" type="checkbox"/>	No car washing will occur on this site
-----	--------------------------	--------------------------	-------------------------------------	--

IV.4 Alternative Compliance Plan (If Applicable)

Describe an alternative compliance plan (if applicable). Include alternative compliance obligations (i.e., gallons, pounds) and describe proposed alternative compliance measures. *Refer to Section 7.II 3.0 in the WQMP.*

IV.4.1 Water Quality Credits

Determine if water quality credits are applicable for the project. *Refer to Section 3.1 of the Model WQMP for description of credits and Appendix VI of the Technical Guidance Document (TGD) for calculation methods for applying water quality credits.*

Description of Proposed Project				
Project Types that Qualify for Water Quality Credits (Select all that apply):				
<input type="checkbox"/> Redevelopment projects that reduce the overall impervious footprint of the project site.	<input type="checkbox"/> Brownfield redevelopment, meaning redevelopment, expansion, or reuse of real property which may be complicated by the presence or potential presence of hazardous substances, pollutants or contaminants, and which have the potential to contribute to adverse ground or surface WQ if not redeveloped.	<input type="checkbox"/> Higher density development projects which include two distinct categories (credits can only be taken for one category): those with more than seven units per acre of development (lower credit allowance); vertical density developments, for example, those with a Floor to Area Ratio (FAR) of 2 or those having more than 18 units per acre (greater credit allowance).		
<input type="checkbox"/> Mixed use development, such as a combination of residential, commercial, industrial, office, institutional, or other land uses which incorporate design principles that can demonstrate environmental benefits that would not be realized through single use projects (e.g. reduced vehicle trip traffic with the potential to reduce sources of water or air pollution).	<input type="checkbox"/> Transit-oriented developments, such as a mixed use residential or commercial area designed to maximize access to public transportation; similar to above criterion, but where the development center is within one half mile of a mass transit center (e.g. bus, rail, light rail or commuter train station). Such projects would not be able to take credit for both categories, but may have greater credit assigned		<input type="checkbox"/> Redevelopment projects in an established historic district, historic preservation area, or similar significant city area including core City Center areas (to be defined through mapping).	
<input type="checkbox"/> Developments with dedication of undeveloped portions to parks, preservation areas and other pervious uses.	<input type="checkbox"/> Developments in a city center area.	<input type="checkbox"/> Developments in historic districts or historic preservation areas.	<input type="checkbox"/> Live-work developments, a variety of developments designed to support residential and vocational needs together -- similar to criteria to mixed use development; would not be able to take credit for both categories.	<input type="checkbox"/> In-fill projects, the conversion of empty lots and other underused spaces into more beneficially used spaces, such as residential or commercial areas.

Calculation of Water Quality Credits (if applicable)	
---	--

IV.4.2 Alternative Compliance Plan Information

Describe an alternative compliance plan (if applicable). Include alternative compliance obligations (i.e., gallons, pounds) and describe proposed alternative compliance measures. *Refer to Section 7.II 3.0 in the Model WQMP.*

--

Section V Inspection/Maintenance Responsibility for BMPs

Fill out information in table below. Prepare and attach an Operation and Maintenance Plan. Identify the funding mechanism through which BMPs will be maintained. Inspection and maintenance records must be kept for a minimum of five years for inspection by the regulatory agencies. *Refer to Section 7.II 4.0 in the Model WQMP.*

BMP Inspection/Maintenance			
BMP	Responsible Party(s)	Inspection/Maintenance Activities Required	Minimum Frequency of Activities
<p>N1 Education for Property Owners, Tenants and Occupants The property owner shall provide information contained within this report to educate the owners and tenants of general good housekeeping practices that contribute to the protection of storm water quality. Refer to Section VII for a checklist of educational materials included as part of this WQMP. This education program applies to all current and future employees of the facility as well as maintenance contractors. The</p>	In-N-Out Burger	<p>Education program as it would apply to future employees of the facility. The owner shall prepare manual(s) for employees. Included in Attachment A are educational materials intended for reproduction and distributed to employees. Copy of this WQMP to be present at the site</p>	Continuous

<p>owner shall prepare manual(s) that include copies of educational materials as included in Attachment A for distribution to employees, tenants and future property owners. Appropriate employee training shall be provided by the owner to provide employees, tenants and future property owners with an awareness and understanding of potential stormwater pollutants and potential pollutant-generating activities, the importance of maintaining potential pollutants in a manner that prevents them from physical contact with the outside environment and the storm drain system, and an awareness that stormwater entering the storm drain system is not treated and is conveyed directly to the ocean. A copy of this WQMP is to be present at the site at all times.</p> <p>This activity shall be conducted on an</p>			
---	--	--	--

ongoing/as needed basis			
N3 Common Area Landscaping The property owner will be responsible for on-going landscape management requirements consistent with the City's Water Conservation guidelines	In-N-Out Burger	Weekly	Owner may employ the services of a qualified landscape maintenance contractor to maintain all planters in accordance with the City of Yorba Linda
N4 BMP Maintenance The property owner shall be responsible for implementation, maintenance, and cleaning of all BMPs	In-N-Out Burger	The manager and employees will be instructed in environmental procedures regarding contamination and cleanup.	Per established maintenance schedule
N11 Common Area Litter Control The property owner shall implement trash management and litter control procedures aimed at reducing off-site migration of trash and pollution of drainage water. The property owner may contract with landscape maintenance firms to provide this service during regularly scheduled	In-N-Out Burger	Management shall prepare educational manuals based on this WQMP to inform future employees working at this site about the BMPs required at this facility.	Weekly/As-needed

<p>maintenance which should consist of litter patrol, and emptying of trash receptacles.</p>			
<p>N14 Common Area Catch Basin Inspection The property owner will be responsible for inspection and maintenance of all catch basins and inlet structures once per year prior to the storm season in August/September, and as necessary throughout the year. Maintenance consists of cleaning out accumulated debris and sediment either manually or by mechanical methods. Debris and sediment shall not be washed down the storm drain.</p>	<p>In-N-Out Burger</p>	<p>Management to inspect and, if necessary, remove silt and debris from catch basins prior to the rainy season</p>	<p>Monthly and prior to rainy season (October 1st each year)</p>
<p>N15 Street Sweeping Private Streets and Parking Lots The property owner shall be responsible for having the private streets, driveways, and parking areas swept at least once prior to the storm season in August/September,</p>	<p>In-N-Out Burger</p>	<p>Management may contract with a contractor to provide sweeping or vacuuming of the entrance driveway(s) and interior drive lanes. The use of water to flush debris and sediment into storm drains shall be prohibited.</p>	<p>Sweep parking lot weekly and prior to the rainy season (October 1st each year)</p>

and as necessary throughout the year.			
<p>S1 Provide Storm Drain Stencilling and signage Anti-dumping stencilling messages will be provided at storm drain inlets to alert the public to the destination of pollutants discharged into stormwater. Stencilling shall comply with the following requirements:</p> <p>(1) Provide stencilling or labelling of all storm drain inlets and catch basins within the project area with prohibitive language (such as: "NO DUMPING – DRAINS TO OCEAN") and/or graphical icons to discourage illegal dumping</p> <p>(2) Maintain legibility stencils</p>	In-N-Out Burger	<p>Management shall have the phrase "NO DUMPING – DRAINS TO OCEAN" stencilled on each catch basin to alert the public of the destination of pollutants discharged into stormwater.</p>	<p>Inspect annually. Re-stencil as needed if stencilling becomes faded or otherwise illegible.</p>
S2/S3 Design and Construct Outdoor Material/Waste Storage areas to reduce pollution	In-N-Out Burger	<p>Trash Enclosure/Waste Storage Area shall be covered with lockable doors. Trench drain</p>	Daily/as-needed

introduction		<p>piped to sewer system will prevent leaks and spills from entering the storm drain system.</p>	
<p>S4 Use efficient Irrigation systems & landscape design, water conservation, smart controllers and source control</p> <p>The landscape/irrigation plan shall implement irrigation smart timers. The property owner will be responsible for adjusting the system seasonally, and checking for broken/over-spraying splinkler heads. See additional irrigation requirements in BMP N3 above</p>	In-N-Out Burger	<p>Adjust landscape watering according to weather conditions to avoid excess usage: inspect timers and adjust seasonally; inspect for broken/over-spraying sprinkler heads</p>	Monthly
<p>S5 Protect Slopes and channels and provide energy dissipation The property owner shall inspect storm drain outlets that discharge onto natural ground. Energy dissipation rocks shall placed at pipe outlet and routinely inspected by property owner. Any noticeable</p>	In-N-Out Burger	<p>Management shall routinely insepct energy dissipation rocks for possible displacement during heavy storm events and soil erosion around energy dissipation rocks or along BMP slope.</p>	Monthly and prior to rainy season (October 1 st each year)

displacement of such rocks shall be noted and replaced to original location at pipe outlet. Inspection of any soil erosion around energy dissipation rocks shall be noted and reported.			
<p>T1 - Bio-retention Basin The property owner shall routinely inspect the bio-retention basin for treatment integrity. The bio-retention basin is to capture the Design Capture Volume calculated for this site and treat this volume before discharging to the municipal storm drain system. The vegetation planted within the basin provides for treatment and must be inspected and maintained. The mulch and engineered soil layer provide treatment and must be inspected and maintained</p>	In-N-Out Burger	<p>Management shall inspect the bio-retention basin for dead/dying vegetation and replace as necessary. The surface of the basin shall be inspected for trash/debris/sediment and shall be replaced as necessary</p>	<p>Every month and prior to the rainy season (October 1st each year)</p>

Section VI BMP Exhibit (Site Plan)

VI.1 BMP Exhibit (Site Plan)

Include a BMP Exhibit (Site Plan), at a size no less than 24" by 36," which includes the following minimum information:

- Insert in the title block (lower right hand corner) of BMP Exhibit: the WQMP Number (assigned by staff) and the grading/building or Planning Application permit numbers
- Project location (address, tract/lot number(s), etc.)
- Site boundary
- Land uses and land covers, as applicable
- Suitability/feasibility constraints
- Structural BMP locations
- Drainage delineations and flow information
- Delineate the area being treated by each structural BMP
- GIS coordinates for LID and Treatment Control BMPs
- Drainage connections
- BMP details
- Preparer name and stamp

Please do not include any areas outside of the project area or any information not related to drainage or water quality. The approved BMP Exhibit (Site Plan) shall be submitted as a plan sheet on all grading and building plan sets submitted for plan check review and approval. The BMP Exhibit shall be at the same size as the rest of the plan sheets in the submittal and shall have an approval stamp and signature prior to plan check submittal.

VI.2 Submittal and Recordation of Water Quality Management Plan

Following approval of the Final Project-Specific WQMP, three copies of the approved WQMP (including BMP Exhibit, Operations and Maintenance (O&M) Plan, and Appendices) shall be submitted. In addition, these documents shall be submitted in a PDF format.

Each approved WQMP (including BMP Exhibit, Operations and Maintenance (O&M) Plan, and Appendices) shall be recorded in the Orange County Clerk-Recorder's Office, prior to close-out of grading and/or building permit. Educational Materials are not required to be included.

Section VII Educational Materials

Refer to the Orange County Stormwater Program (ocwatersheds.com) for a library of materials available. Please only attach the educational materials specifically applicable to this project. Other materials specific to the project may be included as well and must be attached.

Education Materials			
Residential Material (http://www.ocwatersheds.com)	Check If Applicable	Business Material (http://www.ocwatersheds.com)	Check If Applicable
The Ocean Begins at Your Front Door	<input type="checkbox"/>	Tips for the Automotive Industry	<input type="checkbox"/>
Tips for Car Wash Fund-raisers	<input type="checkbox"/>	Tips for Using Concrete and Mortar	<input type="checkbox"/>
Tips for the Home Mechanic	<input type="checkbox"/>	Tips for the Food Service Industry	<input checked="" type="checkbox"/>
Homeowners Guide for Sustainable Water Use	<input type="checkbox"/>	Proper Maintenance Practices for Your Business	<input type="checkbox"/>
Household Tips	<input type="checkbox"/>	Other Material	Check If Attached
Proper Disposal of Household Hazardous Waste	<input type="checkbox"/>		
Recycle at Your Local Used Oil Collection Center (North County)	<input type="checkbox"/>		<input type="checkbox"/>
Recycle at Your Local Used Oil Collection Center (Central County)	<input type="checkbox"/>		<input type="checkbox"/>
Recycle at Your Local Used Oil Collection Center (South County)	<input type="checkbox"/>		<input type="checkbox"/>
Tips for Maintaining a Septic Tank System	<input type="checkbox"/>		<input type="checkbox"/>
Responsible Pest Control	<input type="checkbox"/>		<input type="checkbox"/>
Sewer Spill	<input type="checkbox"/>		<input type="checkbox"/>
Tips for the Home Improvement Projects	<input type="checkbox"/>		<input type="checkbox"/>
Tips for Horse Care	<input type="checkbox"/>		<input type="checkbox"/>
Tips for Landscaping and Gardening	<input type="checkbox"/>		<input type="checkbox"/>
Tips for Pet Care	<input type="checkbox"/>		<input type="checkbox"/>
Tips for Pool Maintenance	<input type="checkbox"/>		<input type="checkbox"/>
Tips for Residential Pool, Landscape and Hardscape Drains	<input type="checkbox"/>		<input type="checkbox"/>
Tips for Projects Using Paint	<input type="checkbox"/>		<input type="checkbox"/>

Attachment A Educational Materials

IC22. EATING AND DRINKING ESTABLISHMENTS

Best Management Practices (BMPs)

A BMP is a technique, measure or structural control that is used for a given set of conditions to improve the quality of the stormwater runoff in a cost effective manner¹. The minimum required BMPs for this activity are outlined in the box to the right. Implementation of pollution prevention/good housekeeping measures may reduce or eliminate the need to implement other more costly or complicated procedures. Proper employee training is key to the success of BMP implementation.

The BMPs outlined in this fact sheet target the following pollutants:

Targeted Constituents	
Sediment	
Nutrients	x
Floatable Materials	x
Metals	
Bacteria	x
Oil & Grease	x
Organics & Toxicants	x
Pesticides	x
Oxygen Demanding	x

MINIMUM BEST MANAGEMENT PRACTICES

Pollution Prevention/Good Housekeeping

- Use dry cleaning methods instead of water
- Clean equipment (floor mats, grease filters, grills, garbage cans, etc.) indoors or in a covered outdoor wash area that is plumbed to the sanitary sewer or in an area that will contain the wash water (Refer to fact sheet *IC24 Wastewater Disposal* for guidance on appropriate methods for disposal of wash water to the sanitary sewer).
- Recycle and/or properly dispose of grease and oil.
- Block the storm drain when hosing or steam/pressure washing outside dumpster areas, sidewalks, and common areas.

Stencil storm drains

Training

- Train employees on these BMPs, storm water discharge prohibitions, and wastewater discharge requirements.

Provided below are specific procedures associated with each of the minimum BMPs along with procedures for additional BMPs that should be considered if this activity takes place at a facility located near a sensitive waterbody. In order to meet the requirements for medium and high priority facilities, the owners/operators must select, install and maintain appropriate BMPs on site. Since the selection of the appropriate BMPs is a site-specific process, the types and numbers of additional BMPs will vary for each facility.

1. Practice good housekeeping.

- Conduct regular sweeping or vacuuming of outdoor areas: Dry sweep pavement areas including "drive-thru" areas, parking lots, sidewalks, outdoor eating areas and dumpster storage areas frequently.
- Keep outside areas free of trash & debris.
- Do not hose out dumpsters or fill them with liquid waste.
- Regularly inspect, repair, and/or replace dumpsters.

2. Clean equipment (floor mats, grease filters, grills, garbage cans, etc.) indoors or in a covered outdoor wash area that is plumbed to the sanitary sewer.

- Clean equipment in a mop sink if possible (never in a food preparation sink). If there is no mop sink, dedicate an indoor cleaning area where a drain is plumbed to the sanitary sewer.
- Dispose mop water from cleaning floors in a mop sink, toilet or other drain that is plumbed to the sanitary sewer. Refer to fact sheet *IC24 Wastewater Disposal* for guidance on appropriate methods for disposal of wash water to the sanitary sewer.
- Do not pour wash water outside or into a street, gutter, or storm drain.

¹ EPA "Preliminary Data Summary of Urban Stormwater Best Management Practices"

- Dispose of all wastewater containing oil and grease in a grease trap or interceptor.
3. **Recycle and/or properly dispose of grease and oil.** Collect and dispose of concentrated waste oil and grease and disposed of by a certified waste grease hauler. NEVER pour grease or oil into a sink, floor drain, storm drain or dumpster.
 4. **Block storm drain(s) when cleaning (hosing or steam/pressure washing) outside dumpster areas, sidewalks, and common areas with hot water, soap, or other cleaning agent.** Collect water/waste and discharge to the sanitary sewer (with approval of the local sanitation district).

Training

1. **Train employees on these BMPs, storm water discharge prohibitions, and wastewater discharge requirements.**
2. **Train employees on proper spill containment and cleanup.**
 - Establish training that provides employees with the proper tools and knowledge to immediately begin cleaning up a spill.
 - Ensure that employees are familiar with the site's spill control plan and/or proper spill cleanup procedures.
 - Fact sheet IC17 discusses Spill Prevention and Control in detail.
3. **Establish a regular training schedule, train all new employees, and conduct annual refresher training.**
4. **Use a training log or similar method to document training.**

Stencil storm drains

Storm drain system signs act as highly visible source controls that are typically stenciled directly adjacent to storm drain inlets. Stencils should read "No Dumping Drains to Ocean".

References

California Storm Water Best Management Practice Handbook. Industrial and Commercial. 2003. www.cabmphandbooks.com

Carlsbad Jurisdictional Urban Runoff Management Plan. Best Management Practices for Restaurants. City of Carlsbad. February 2002. On-line: <http://www.ci.carlsbad.ca.us/cserv/jurmp.html>

Orange County Stormwater Program. 2001. Water Quality Guidelines for Exterior Restaurant Cleaning Operations. Brochure. June.

Orange County Stormwater Program. Good Cleaning Practices Food & Restaurant Industry. Poster. Courtesy of the City and County of LA.

For additional information contact:


County of Orange/ OC Watersheds

Main: (714) 955-0600

24 hr Water Pollution Hotline: 1-877-89-SPILL

or visit our website at www.ocwatersheds.com

Attachment B Reference Maps

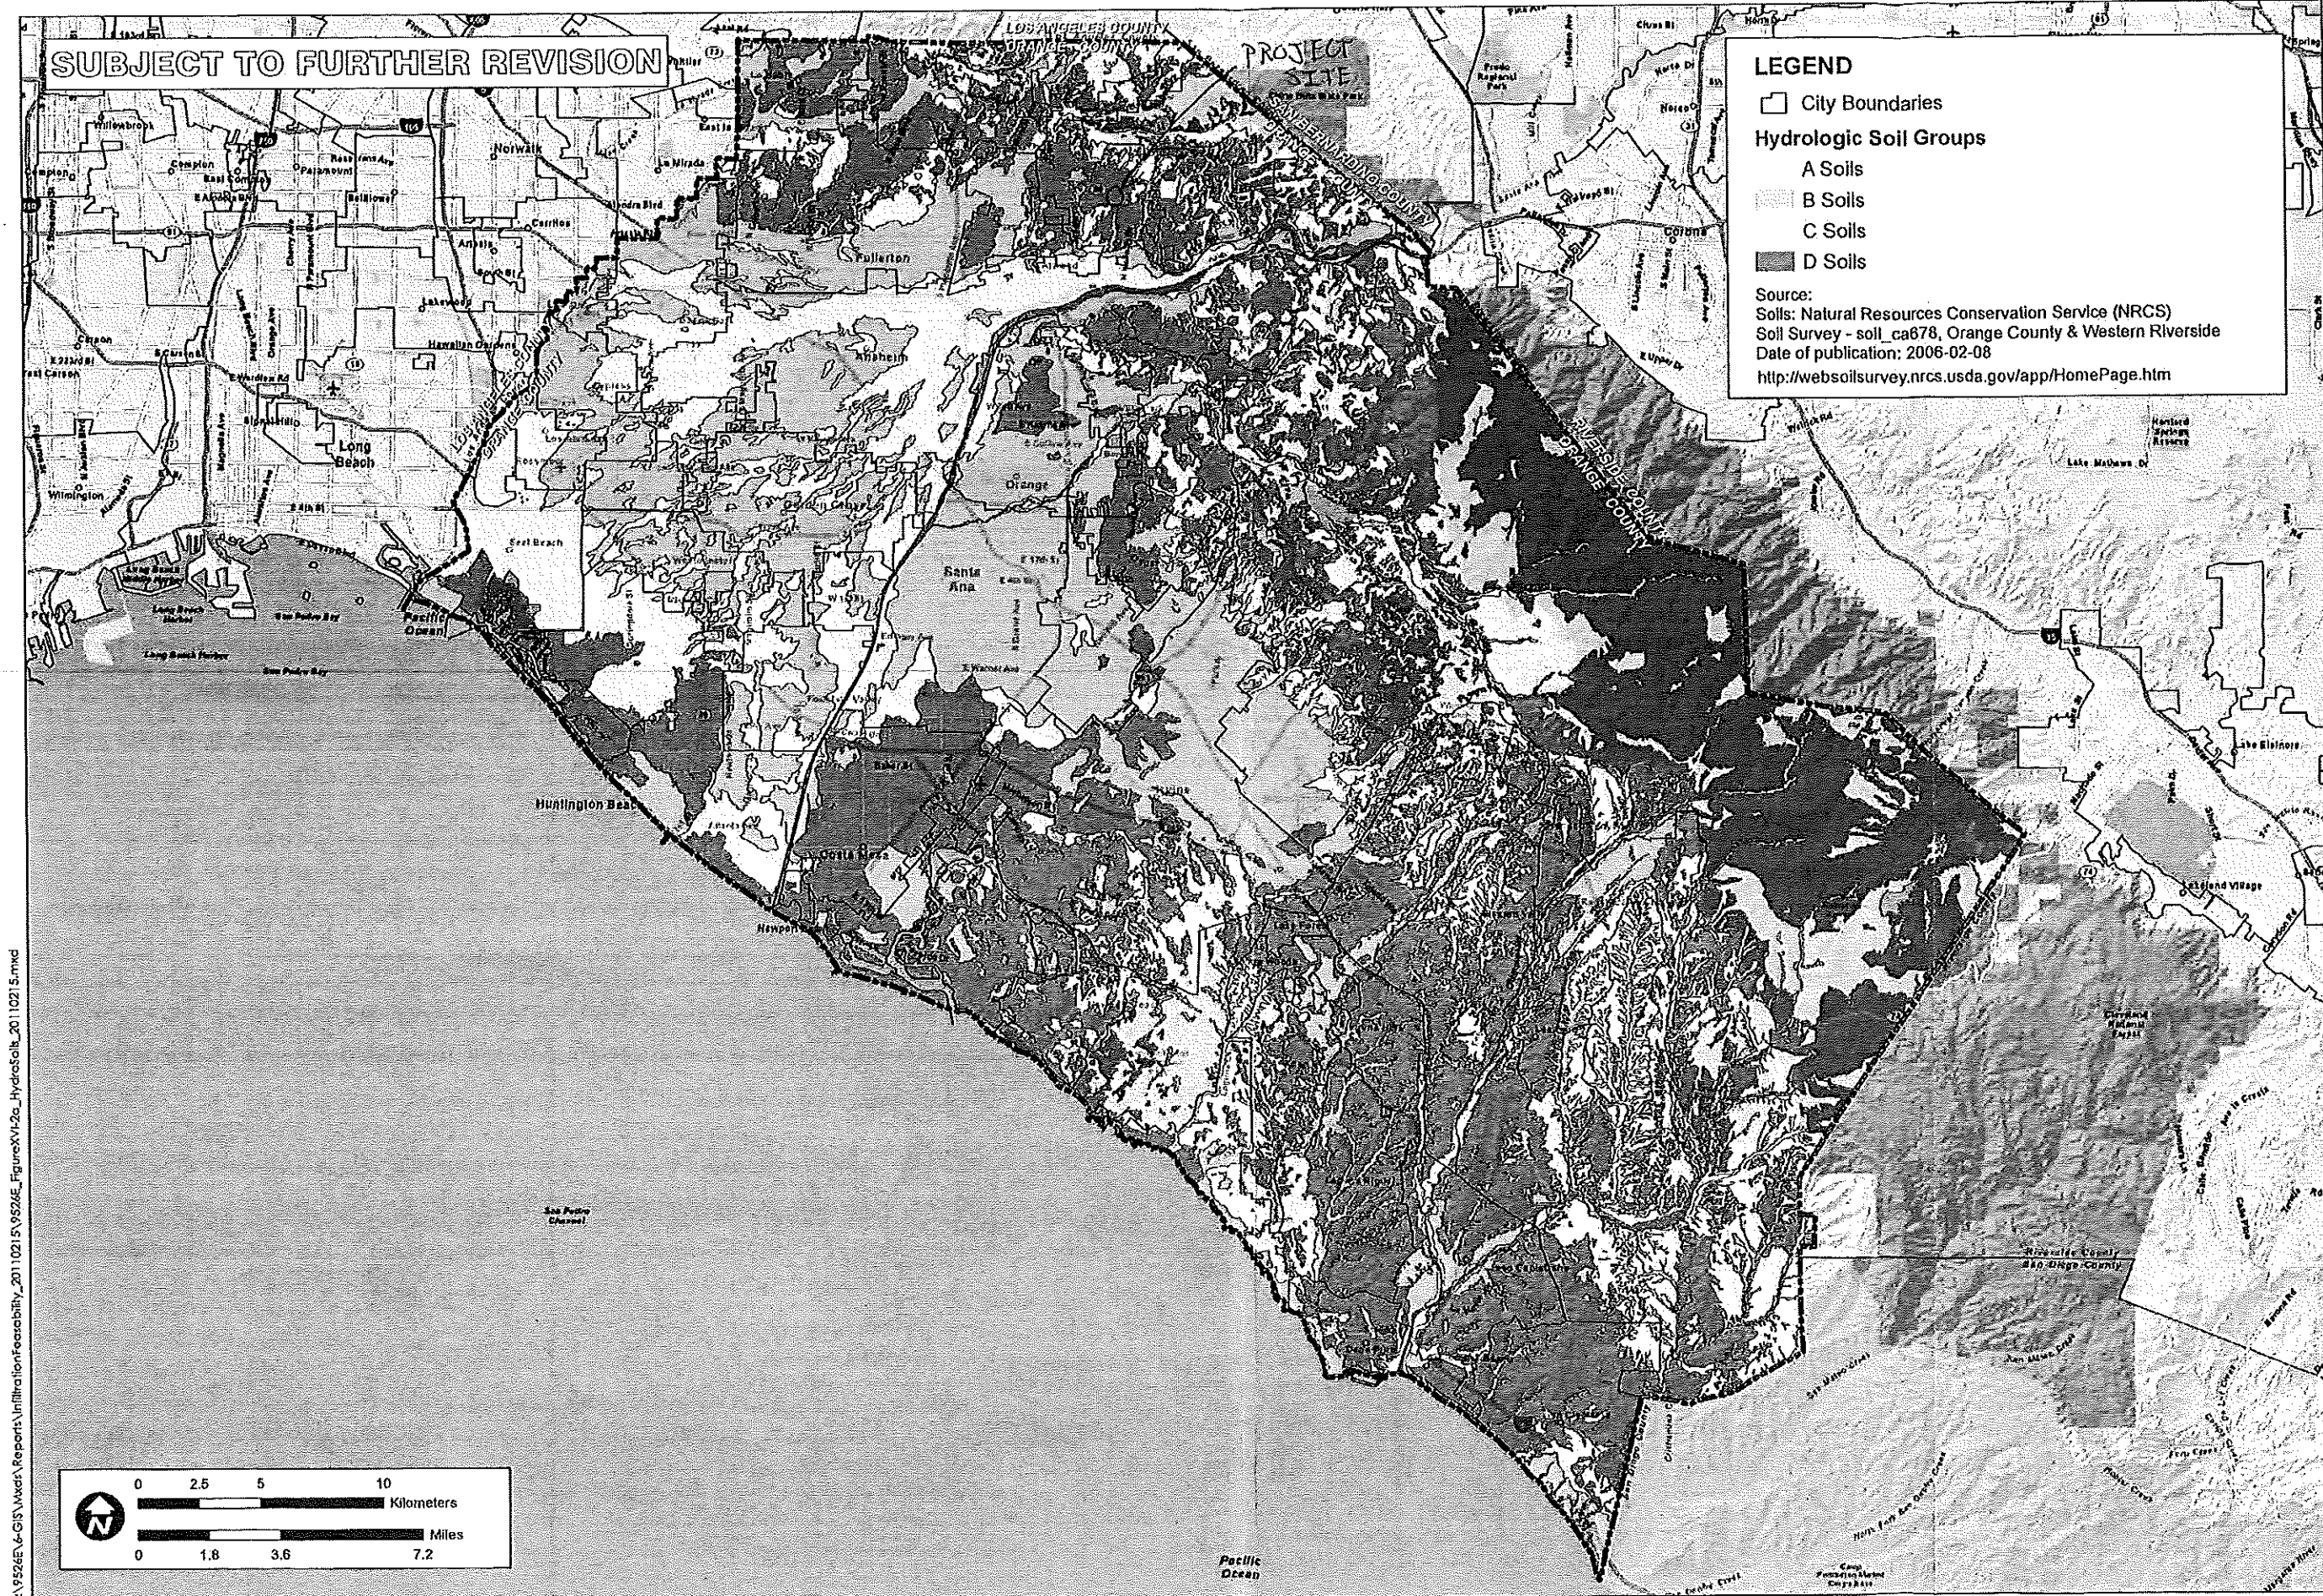

SUBJECT TO FURTHER REVISION


LEGEND

City Boundaries

Hydrologic Soil Groups

- A Soils
- B Soils
- C Soils
- D Soils

Source:
Soils: Natural Resources Conservation Service (NRCS)
Soil Survey - soil_ca678, Orange County & Western Riverside
Date of publication: 2006-02-08
<http://websoilsurvey.nrcs.usda.gov/app/HomePage.htm>

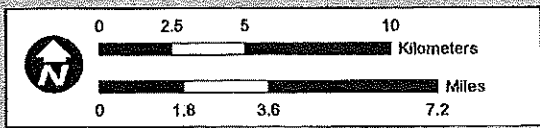

NRCS HYDROLOGIC
SOILS GROUPS

ORANGE COUNTY
INFILTRATION STUDY

CA



ORANGE CO.

SCALE	1" = 1.8 Miles
DESIGNED	TH
DRAWING	TH
CHECKED	BMF
DATE	02/08/11
JOB NO.	9524-E



FIGURE
XVI-2a

P:\9524E\4-GIS\Maps\Reports\InfiltrationFeasibility_2010215\9524E_FigureXVI-2a_HydroSoils_2010215.mxd

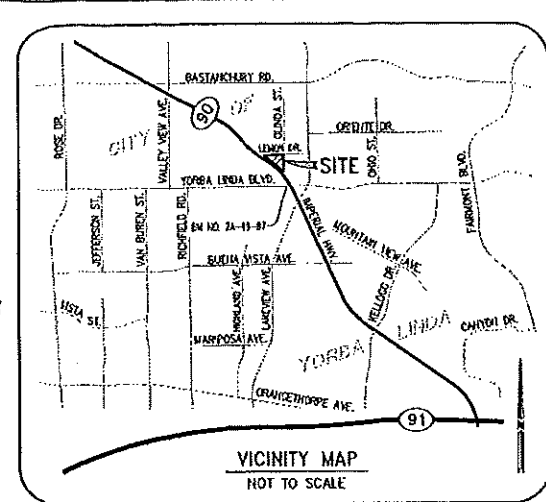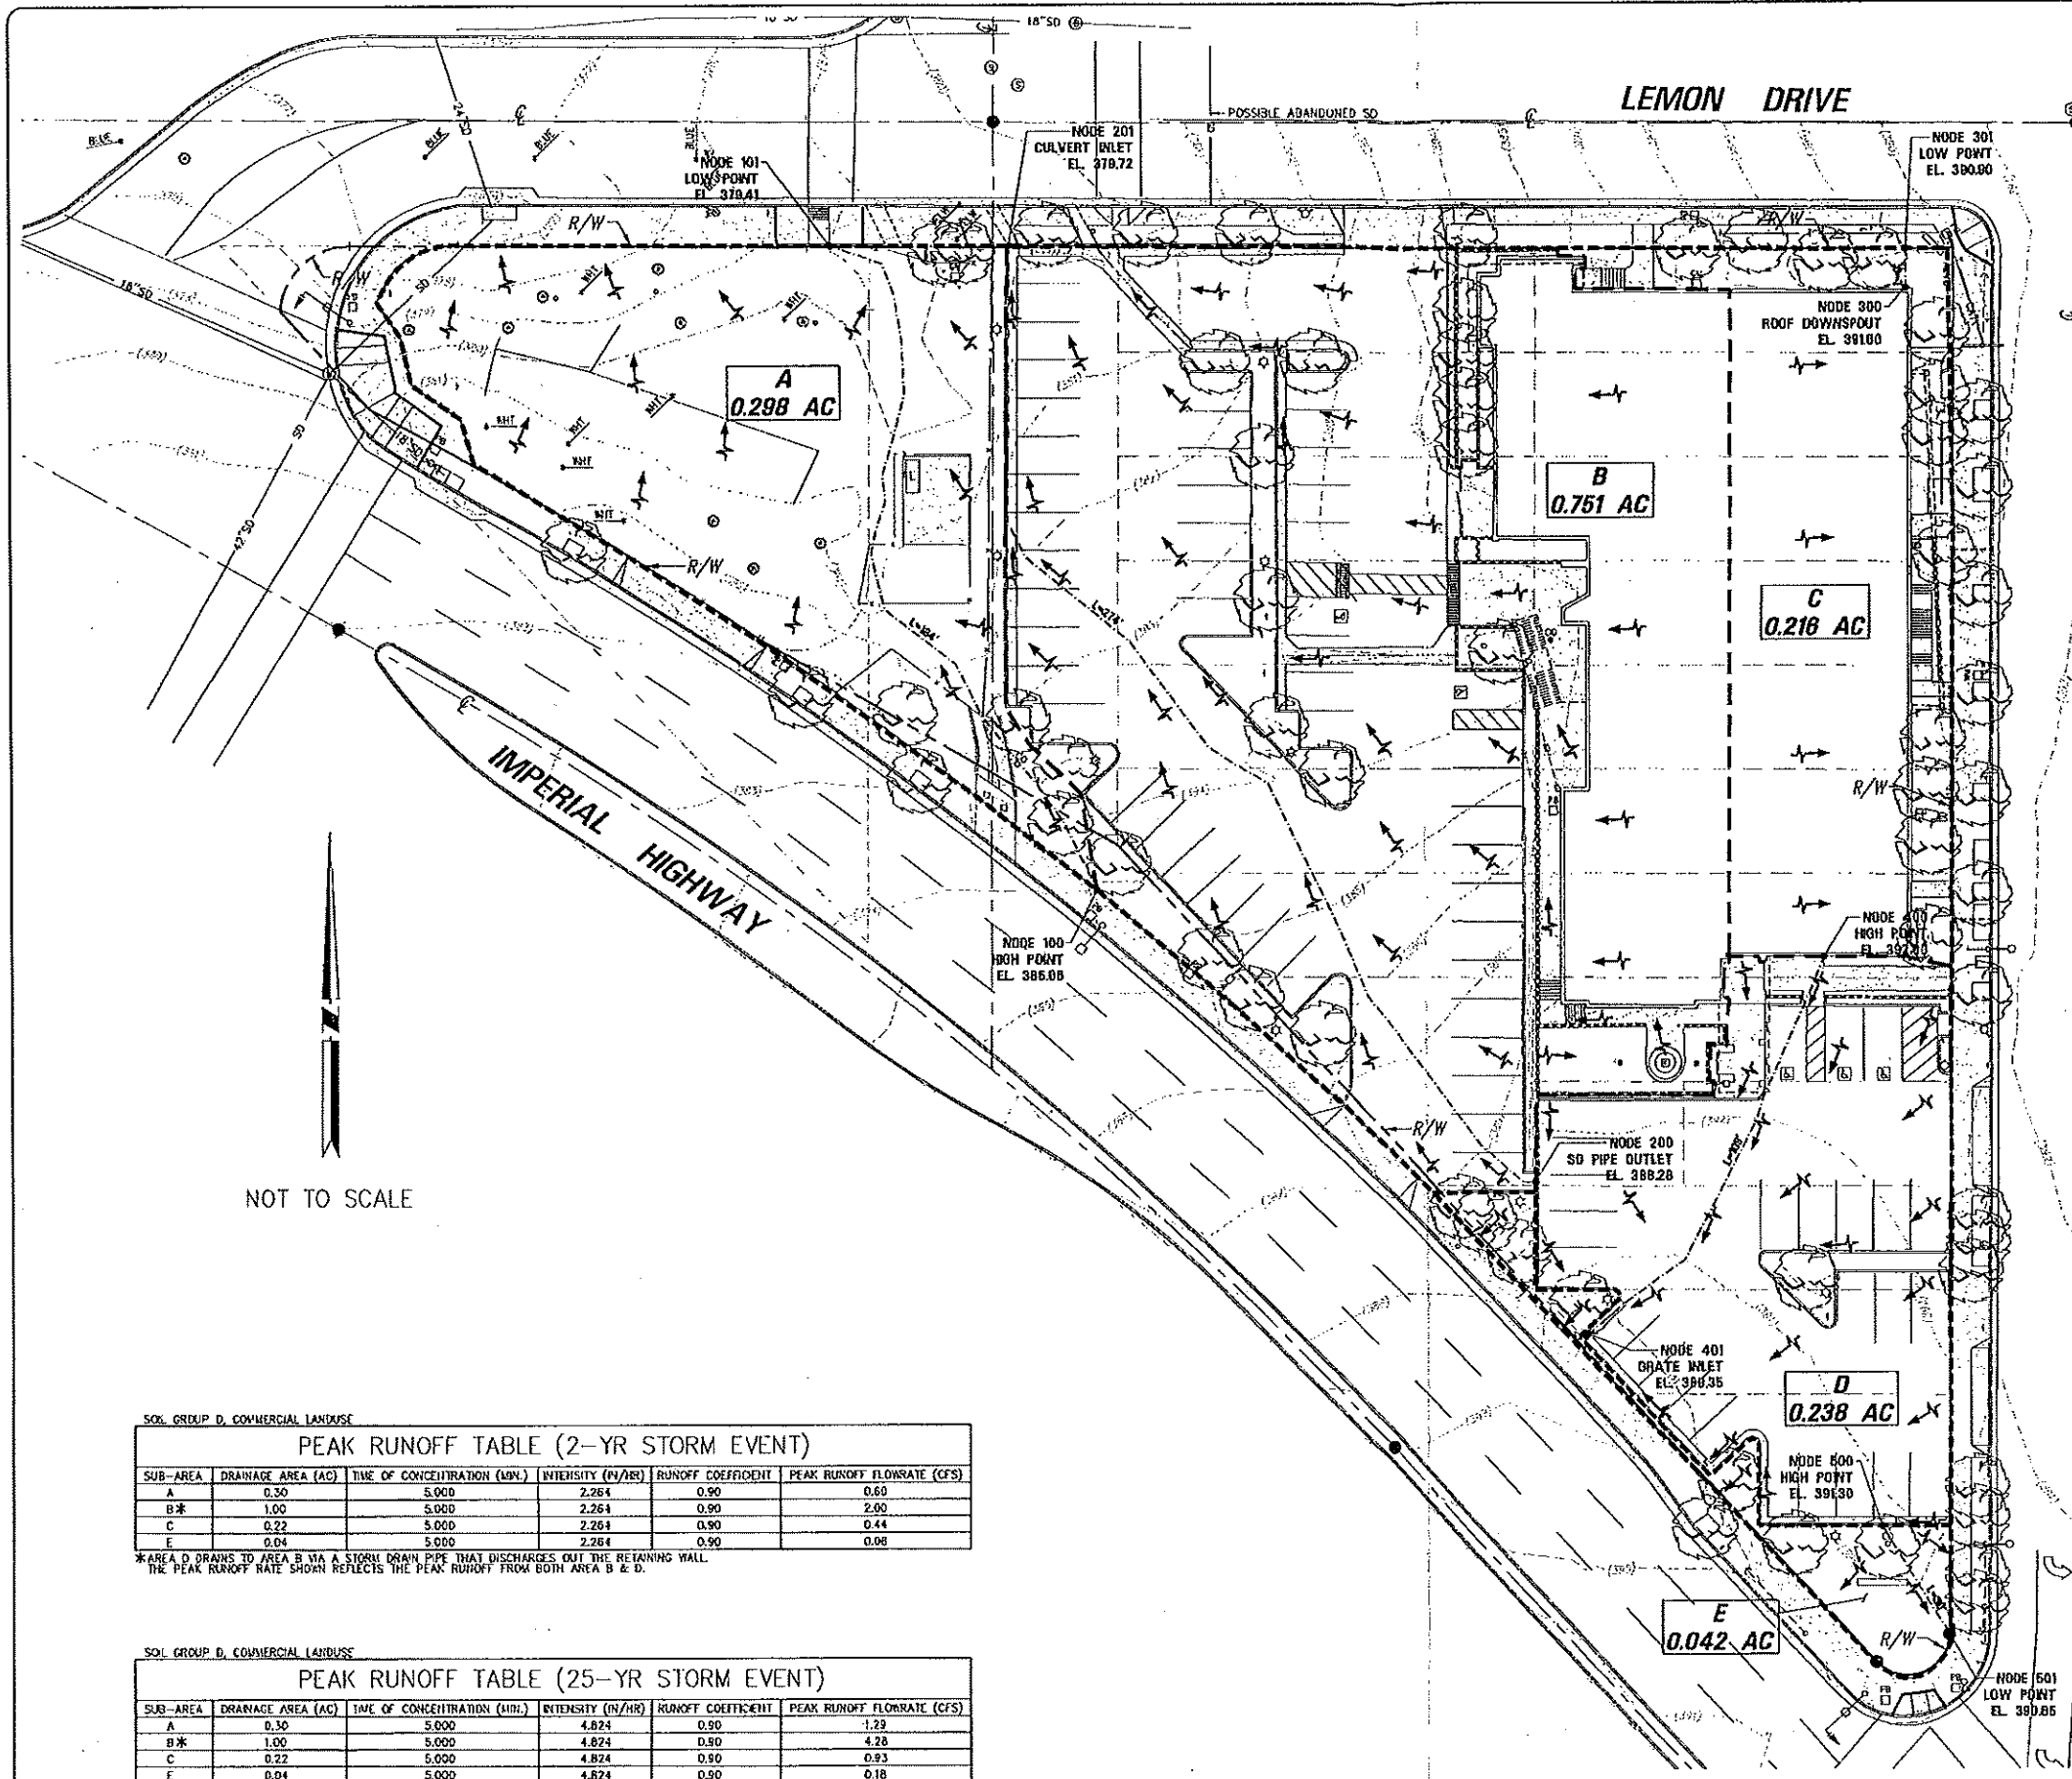

- LEGEND**
- DRAINAGE BOUNDARY
 - DRAINAGE SUB-AREA BOUNDARY
 - 101 — NODE
 - HIGHT POINT 450 — NODE DESCRIPTION ELEVATION
 - A — SUB-AREA NAME
 - 0.400 AC — DRAINAGE AREA IN ACRES
 - PATH OF FLOW

SOL GROUP D, COMMERCIAL LANDUSE

PEAK RUNOFF TABLE (2-YR STORM EVENT)

SUB-AREA	DRAINAGE AREA (AC)	TIME OF CONCENTRATION (MIN.)	INTENSITY (IN/HR)	RUNOFF COEFFICIENT	PEAK RUNOFF FLOWRATE (CFS)
A	0.30	5.000	2.264	0.90	0.60
B*	1.00	5.000	2.264	0.90	2.00
C	0.22	5.000	2.264	0.90	0.44
E	0.04	5.000	2.264	0.90	0.08

*AREA D DRAINS TO AREA B VIA A STORM DRAIN PIPE THAT DISCHARGES OUT THE RETAINING WALL. THE PEAK RUNOFF RATE SHOWN REFLECTS THE PEAK RUNOFF FROM BOTH AREA B & D.

SOL GROUP D, COMMERCIAL LANDUSE


PEAK RUNOFF TABLE (25-YR STORM EVENT)

SUB-AREA	DRAINAGE AREA (AC)	TIME OF CONCENTRATION (MIN.)	INTENSITY (IN/HR)	RUNOFF COEFFICIENT	PEAK RUNOFF FLOWRATE (CFS)
A	0.30	5.000	4.824	0.90	1.29
B*	1.00	5.000	4.824	0.90	4.28
C	0.22	5.000	4.824	0.90	0.93
E	0.04	5.000	4.824	0.90	0.18

*AREA D DRAINS TO AREA B VIA A STORM DRAIN PIPE THAT DISCHARGES OUT THE RETAINING WALL. THE PEAK RUNOFF RATE SHOWN REFLECTS THE PEAK RUNOFF FROM BOTH AREA B & D.



NO.	REVISIONS	DATE

Prepared by: **Joseph C. Truxaw and Associates, Inc.**
Civil Engineers and Land Surveyors
265 S. Anita Dr., Suite 111, Orange, CA 92668 (714) 935-0265 Fax: (714) 935-0106



**PRE-DEVELOPMENT
HYDROLOGY PLAN**
IN-N-OUT BURGER
18181 IMPERIAL HWY
IN THE CITY OF YORBA LINDA
ORANGE COUNTY, STATE OF CALIFORNIA

DATE 1-18-19
DRAWN BY PJS/MDR
CHECKED BY SMH/CD
JOB NO. IND18021
SHEET NO. 1
OF 2 SHEETS

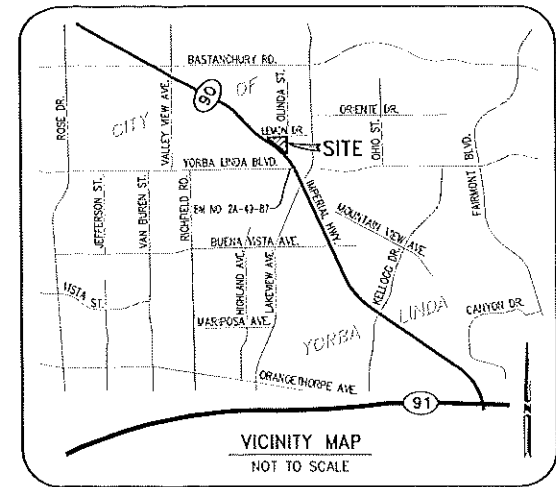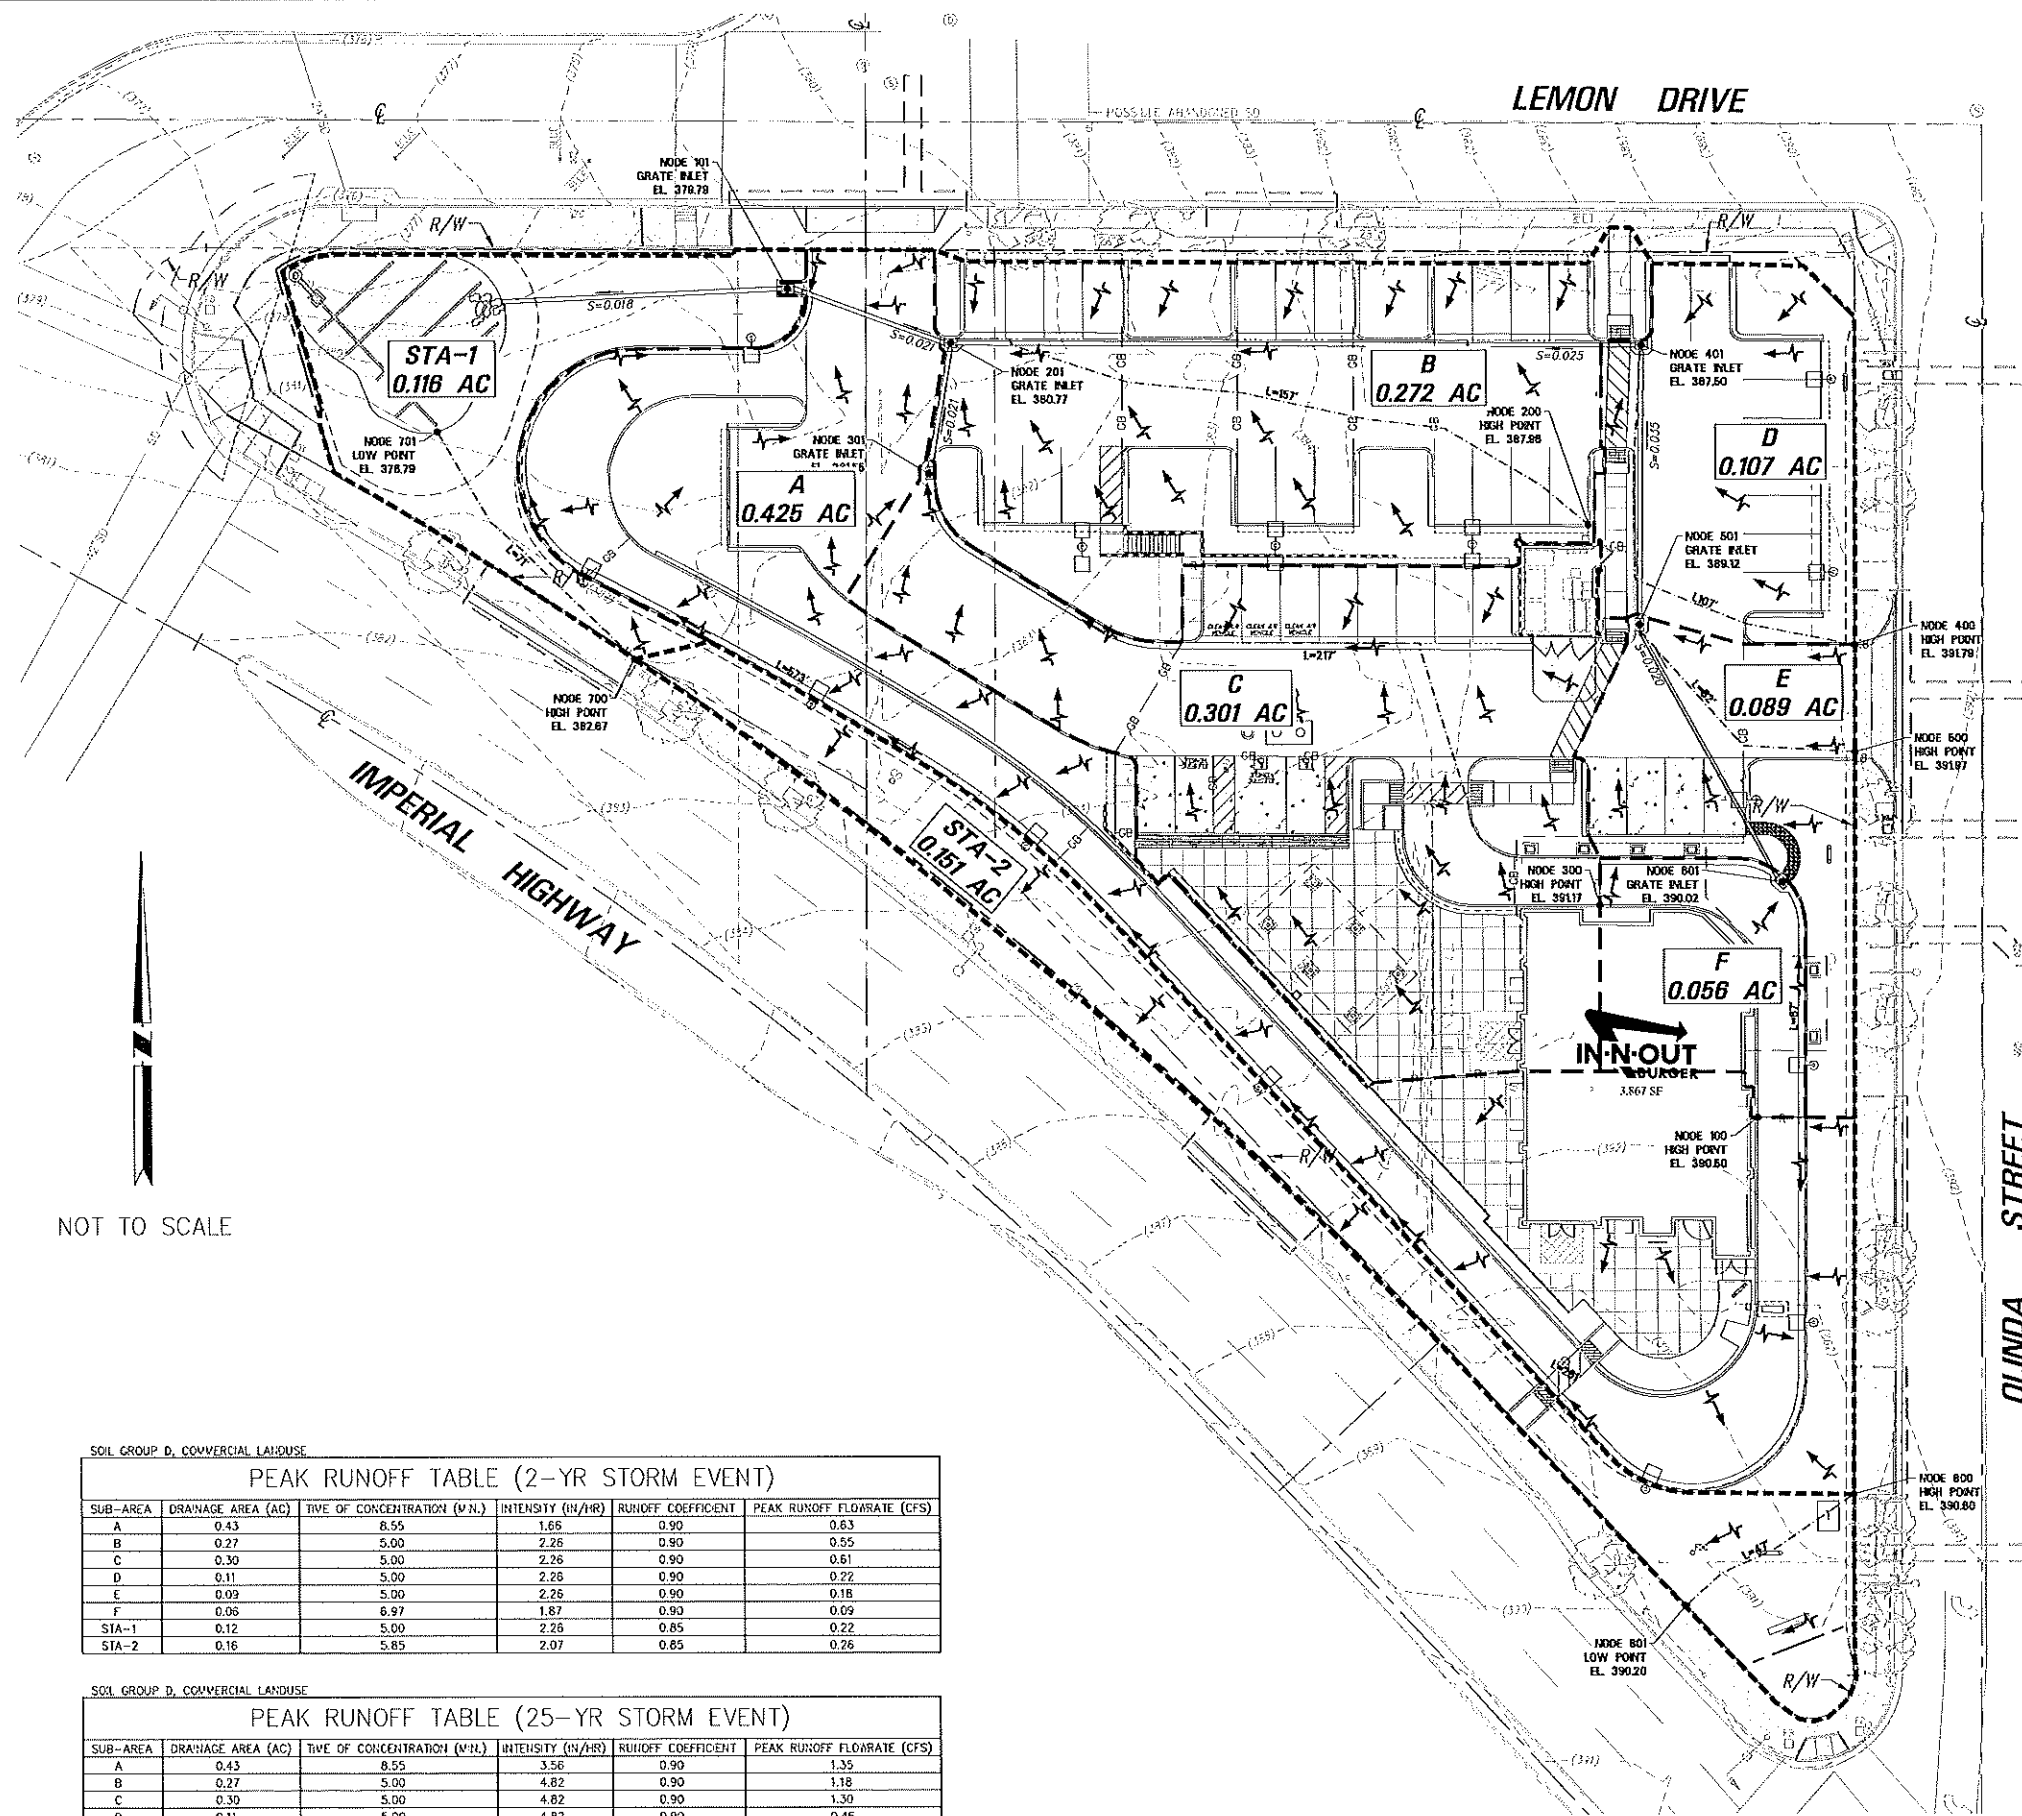

- LEGEND**
- DRAINAGE BOUNDARY
 - DRAINAGE SUB-AREA BOUNDARY
 - 101 NODE
 - HIGHT POINT 450
 - NODE DESCRIPTION ELEVATION
 - A SUB-AREA NAME
 - D.400 AC DRAINAGE AREA IN ACRES
 - ← PATH OF FLOW

SOIL GROUP D, COMMERCIAL LANDUSE

PEAK RUNOFF TABLE (2-YR STORM EVENT)

SUB-AREA	DRAINAGE AREA (AC)	TIME OF CONCENTRATION (MIN.)	INTENSITY (IN/HR)	RUNOFF COEFFICIENT	PEAK RUNOFF FLOWRATE (CFS)
A	0.43	8.55	1.65	0.90	0.83
B	0.27	5.00	2.26	0.90	0.55
C	0.30	5.00	2.26	0.90	0.61
D	0.11	5.00	2.26	0.90	0.22
E	0.09	5.00	2.26	0.90	0.18
F	0.06	6.97	1.87	0.90	0.09
STA-1	0.12	5.00	2.26	0.85	0.22
STA-2	0.16	5.85	2.07	0.85	0.26

SOIL GROUP D, COMMERCIAL LANDUSE

PEAK RUNOFF TABLE (25-YR STORM EVENT)

SUB-AREA	DRAINAGE AREA (AC)	TIME OF CONCENTRATION (MIN.)	INTENSITY (IN/HR)	RUNOFF COEFFICIENT	PEAK RUNOFF FLOWRATE (CFS)
A	0.43	8.55	3.56	0.90	1.35
B	0.27	5.00	4.82	0.90	1.18
C	0.30	5.00	4.82	0.90	1.30
D	0.11	5.00	4.82	0.90	0.46
E	0.09	5.00	4.82	0.90	0.38
F	0.06	6.97	4.00	0.90	0.19
STA-1	0.12	5.00	4.82	0.85	0.49
STA-2	0.16	5.85	4.42	0.85	0.58

NOTICE TO CONTRACTOR

THE CONTRACTOR SHALL ASCERTAIN THE TRUE VERTICAL AND HORIZONTAL LOCATION AND SIZE OF ALL UTILITIES, PILES, AND/OR STRUCTURES AND SHALL BE RESPONSIBLE FOR DAMAGE TO ANY PUBLIC OR PRIVATE UTILITIES, SHOWN OR NOT SHOWN HEREON.


IMPORTANT NOTICE

Section 415.6 of the Government Code requires a City and Identification Number be filed before a "March to Occupancy" will be void. For your City and ID Number call Underground Service Alert (USA) 811 Two working days before you dig.

THIS PLAN IS:
PRELIMINARY
(NOT FOR CONSTRUCTION)

NO.	REVISIONS	DATE

Prepared by:
Joseph C. Truxaw and Associates, Inc.
Civil Engineers and Land Surveyors
265 S. Anita Dr., Suite 111, Orange, CA 92668 (714) 935-0265 fax (714) 935-0106



POST-DEVELOPMENT
HYDROLOGY PLAN
IN-N-OUT BURGER
18181 IMPERIAL HWY
IN THE CITY OF YORBA LINDA
ORANGE COUNTY, STATE OF CALIFORNIA

DATE 04-16-20
DRAWN BY PJS/MDR
CHECKED BY SMH/CD
JOB NO. 1018021
SHEET NO. 2
OF 2 SHEETS

Attachment C

**Worksheet B: Simple Design Capture Volume
Sizing Method**

Worksheet B: Simple Design Capture Volume Sizing Method

Step 1: Determine the design capture storm depth used for calculating volume				
1	Enter design capture storm depth from Figure III.1, d (inches)	$d =$	0.85	inches
2	Enter the effect of provided HSCs, d_{HSC} (inches) (Worksheet A)	$d_{HSC} =$	-	inches
3	Calculate the remainder of the design capture storm depth, $d_{remainder}$ (inches) (Line 1 - Line 2)	$d_{remainder} =$	0.85	inches
Step 2: Calculate the DCV				
1	Enter Project area tributary to BMP (s), A (acres)	$A =$	1.25	acres
2	Enter Project Imperviousness, imp (unitless)	$imp =$	0.803	
3	Calculate runoff coefficient, $C = (0.75 \times imp) + 0.15$	$C =$	0.75	
4	Calculate runoff volume, $V_{design} = (C \times d_{remainder} \times A \times 43560 \times (1/12))$	$V_{design} =$	2.893	cu-ft
Step 3: Design BMPs to ensure full retention of the DCV				
Step 3a: Determine design infiltration rate				
1	Enter measured infiltration rate, $K_{observed}$ (in/hr) (Appendix VII)	$K_{observed} =$		In/hr
2	Enter combined safety factor from Worksheet H, S_{total} (unitless)	$S_{total} =$		
3	Calculate design infiltration rate, $K_{design} = K_{observed} / S_{total}$	$K_{design} =$		In/hr
Step 3b: Determine minimum BMP footprint				
4	Enter drawdown time, T (max 48 hours)	$T =$		Hours
5	Calculate max retention depth that can be drawn down within the drawdown time (feet), $D_{max} = K_{design} \times T \times (1/12)$	$D_{max} =$		feet
6	Calculate minimum area required for BMP (sq-ft), $A_{min} = V_{design} / d_{max}$	$A_{min} =$		sq-ft

¹ $K_{observed}$ is the vertical infiltration measured in the field, before applying a factor of safety. If field testing measures a rate that is different than the vertical infiltration rate (for example, three-dimensional borehole percolation rate), then this rate must be adjusted by an acceptable method (for example, Porchet method) to yield the field estimate of vertical infiltration rate, $K_{observed}$. See Appendix VII.

Attachment D Soils Report

**GEOTECHNICAL ENGINEERING INVESTIGATION
PROPOSED IN-N-OUT BURGER RESTAURANT
18181 IMPERIAL
YORBA LINDA, CALIFORNIA**

**PROJECT NO. 112-18047
MAY 9, 2018**

PREPARED FOR:

**IN-N-OUT BURGER, A CALIFORNIA CORPORATION
13502 HAMBURGER LANE
BALDWIN PARK, CA 91706**

ATTENTION: MS. MICHELLE BENNETT

PREPARED BY:

**KRAZAN & ASSOCIATES, INC.
1100 OLYMPIC DRIVE, SUITE 103
CORONA, CALIFORNIA 92881
(951) 273-1011**

**GEOTECHNICAL ENGINEERING INVESTIGATION
PROPOSED IN-N-OUT BURGER RESTAURANT
18181 IMPERIAL HIGHWAY
YORBA LINDA, CALIFORNIA**

TABLE OF CONTENTS

INTRODUCTION	1
PURPOSE AND SCOPE OF SERVICES	1
PROPOSED CONSTRUCTION	2
SITE LOCATION AND SITE DESCRIPTION	2
GEOLOGIC SETTING	3
SEISMICITY AND LIQUEFACTION POTENTIAL	4
FAULT RUPTURE HAZARD ZONES	5
SITE COEFFICIENT	6
FIELD AND LABORATORY INVESTIGATIONS	6
SOIL PROFILE AND SUBSURFACE CONDITIONS	7
GROUNDWATER	7
SOIL CORROSIVITY	8
INFILTRATION TESTING	8
CONCLUSIONS AND RECOMMENDATIONS	9
ADMINISTRATIVE SUMMARY	9
GROUNDWATER INFLUENCE ON STRUCTURES/CONSTRUCTION	10
SEISMIC CONSIDERATIONS	10
Ground Shaking	10
Seismic Induced Settlement	10
EARTHWORK	10
Site Preparation – Clearing and Stripping	10
Overexcavation and Recompaction	11
Fill Placement	11
ENGINEERED FILL	12
FOUNDATIONS	12
Settlement	13
Lateral Load Resistance	13
FLOOR SLABS AND EXTERIOR FLATWORK	13
RETAINING WALLS	14

TEMPORARY EXCAVATION STABILITY	15
UTILITY TRENCH LOCATION, CONSTRUCTION AND BACKFILL.....	15
COMPACTED MATERIAL ACCEPTANCE	16
SURFACE DRAINAGE AND LANDSCAPING	16
PAVEMENT DESIGN	16
Portland Cement Concrete (Rigid) Pavement	18
INFILTRATION TESTING	19
SOIL CORROSIVITY	19
ADDITIONAL SERVICES.....	19
LIMITATIONS.....	20

FIGURES

FIGURE 1	VICINITY MAP
FIGURE 2	SITE PLAN
FIGURE 3	EARTHQUAKE ZONES OF REQUIRED INVESTIGATION MAP
FIGURE 4	HISTORICAL GROUNDWATER
FIGURE 5	GEOLOGIC MAP
APPENDIX A	BORING LOG LEGEND
	BORING LOGS
	LABORATORY TEST RESULTS
APPENDIX B	GENERAL EARTHWORK SPECIFICATIONS
APPENDIX C	GENERAL PAVEMENT SPECIFICATIONS

May 9, 2018

KA Project No. 112-18047

**GEOTECHNICAL ENGINEERING INVESTIGATION
PROPOSED IN-N-OUT BURGER RESTAURANT
18181 IMPERIAL HIGHWAY
YORBA LINDA, CALIFORNIA**

INTRODUCTION

This report presents the results of our Geotechnical Engineering Investigation for the proposed development that will include construction of an approximately 3,867 square foot In-N-Out Burger Restaurant. It is anticipated that the proposed construction will include a drive-thru area, patio area, trash enclosure, associated parking and drive areas, and localized landscaped areas. Discussions regarding site conditions are presented herein, together with conclusions and recommendations pertaining to site preparation, grading, utility trench backfill, drainage and landscaping, foundations, concrete floor slabs and exterior concrete flatwork, retaining walls, soil corrosivity, and pavement design.

A Vicinity Map showing the location of the site is presented on Figure 1. A Site Plan showing the approximate boring locations is presented on Figure 2. Descriptions of the field and laboratory investigations, boring log legend and boring logs are presented in Appendix A. Appendix A contains a description of the laboratory-testing phase of this study, along with the laboratory test results. Appendices B and C contain guide specifications for earthwork and flexible pavements, respectively. If conflicts in the text of the report occur with the general specifications in the appendices, the recommendations in the text of the report have precedence.

PURPOSE AND SCOPE OF SERVICES

This geotechnical investigation was conducted to evaluate subsurface soil and groundwater conditions at the project site. Engineering analysis of the field and laboratory data was performed for the purpose of developing and providing geotechnical recommendations for use in the design and construction of the earthwork, foundation and pavement aspects of the project.

Our scope of services was outlined in our proposal dated March 14, 2018 (KA Proposal No. G18041CAC) and included the following:

- A site reconnaissance by a member of our engineering staff to evaluate the surface conditions at the project site.

- Review of selected published geologic maps, reports and literature pertinent to the site and surrounding area.
- A field investigation consisting of drilling six (6) borings to depths ranging from approximately ten (10) to twenty (20) feet below the existing ground surface for evaluation of the subsurface conditions at the project site.
- Performance of two (2) infiltration tests at the subject site in order to determine an estimated infiltration rate for the near surface soil.
- Performance of laboratory tests on representative soil samples obtained from the borings to evaluate the physical and index properties of the subsurface soils.
- Evaluation of the data obtained from the investigation and engineering analyses of the data with respect to the geotechnical aspects of structural design, site grading and paving.
- Preparation of this report summarizing the findings, results, conclusions and recommendations of our investigation.

Environmental services, such as a chemical analysis of soil and groundwater for possible environmental contaminants, were not in our scope of services.

PROPOSED CONSTRUCTION

Based on our review of the site plan and our discussions with the project representative, we understand that the proposed development will include construction of an approximately 3,867 square foot In-N-Out Burger Restaurant. The proposed restaurant will be of wood frame/stucco construction with a slab-on-grade floor. The proposed development will include a drive-thru area, patio area, trash enclosure, associated parking and drive areas, and localized landscaped areas. It is anticipated that the proposed structure will be supported on a shallow foundation system.

In the event these structural or grading details are inconsistent with the final design criteria, we should be notified so that we can evaluate the potential impacts of the changes on the recommendations presented in this report and provide an updated report as necessary.

SITE LOCATION AND SITE DESCRIPTION

The site is a roughly triangular shaped parcel located along the northeast of Imperial Highway, in the city of Yorba Linda, California. The subject site is located at the physical address of 18181 Imperial Highway, Yorba Linda, California. Presently, the site is occupied by a three-story, wood framed Yorba Linda Public Library building and associated asphalt and concrete pavements, and localized landscape areas. The site is bound to the north by Lemon Drive and a mix of residential and commercial buildings beyond, to the east by Olinda Street and commercial buildings beyond, and to the west and south by Imperial Highway and commercial buildings beyond. The site is relatively flat and level, with no major changes in elevation with the exception of the eastern portion of the site which sits approximately 3 feet higher than the western side.

GEOLOGIC SETTING

The subject site is located within the Puente Hills with the San Gabriel Valley to the north and the Eastern Basin of the Los Angeles Coastal Plain to the south, within the Peninsular Ranges Geomorphic Province of California. The Eastern Basin of the Los Angeles Coastal Plain is situated between the Santa Monica Mountains to the northwest, the San Gabriel Valley and Mountains to the north, the Santa Ana Mountains to the southeast, and the Pacific Ocean to the west and south. The Los Angeles Basin and San Gabriel Valley are dominated by northwest-trending faults and adjacent anticlinal uplifts. The intervening deep synclinal troughs are filled with poorly consolidated Upper Pleistocene and unconsolidated Holocene sediments. Tectonism of the region is dominated by the interaction of the East Pacific Plate and the North American Plate along a transform boundary.

The near-surface deposits in the vicinity of the subject site are indicated to be comprised of recent alluvium consisting of unconsolidated sands, silt, and clays derived from erosion of the Puente Hills. Deposits encountered on the subject site during exploratory drilling are discussed in detail in this report.

The Puente Hills are composed of several Geologic Formations. The San Fernando formation is comprised of interbedded light brown fine to medium grained sandstone and dark brown to tan siltstone beds. The Dibblee (1999) Geologic Map shows the site to be underlain by Qg - Holocene gravel and sand of major streams and Qoa-uplifted remnants of alluvial sand and gravel, north of hill areas. These surficial sediments are underlain by Tfps - the Pliocene Fernando Formation - "Pico" silty sandstone facies at the southwest end of Puente Hills, composed of very fine grained silty sandstone to siltstone, vaguely bedded.

Numerous moderate to large earthquakes have affected the area of the subject site within historic time. Based on the proximity of several dominant active faults and seismogenic structures, as well as the historic seismic record, the area of the subject site is considered subject to relatively moderate to high seismicity.

The Puente Hills, which includes the project site, are located, in the vicinity of the Elsinore, Puente Hills, and Chino Faults. These faults are significant seismic sources. The Elsinore, Puente Hills, and Chino Faults are located approximately 1.6, 3.1, and 8.0 miles from the subject site, respectively. Therefore, the proposed project should be designed in accordance with the seismic parameters and recommendation presented in this Geotechnical Engineering Investigation report.

SEISMIC HAZARDS ZONES

In 1990, the California State Legislature passed the Seismic Hazard Mapping Act to protect public safety from the effects of strong shaking, liquefaction, landslides, or other ground failure, and other hazards caused by earthquakes. The Act requires that the State Geologist delineate various seismic hazards zones on Seismic Hazard Zones Maps. Specifically, the maps identify areas where soil liquefaction and earthquake-induced landslides are most likely to occur. A site-specific geotechnical evaluation is required prior to permitting most urban developments within the mapped zones. The Act also requires sellers of real property within the zones to disclose this fact to potential buyers. The subject site is located on the State of California, Seismic Hazard Zones Map, Yorba Linda Quadrangle, dated August

11, 2005. The subject site is not located in and area designated by the State of California as a Liquefaction Hazard Zone.

SEISMICITY AND LIQUEFACTION POTENTIAL

Seismicity is a general term relating to the abrupt release of accumulated strain energy in the rock materials of the earth's crust in a given geographical area. The recurrence of accumulation and subsequent release of strain have resulted in faults and fault systems. Fault patterns and density reflect relative degrees of regional stress through time, but do not necessarily indicate recent seismic activity; therefore, the degree of seismic risk must be determined or estimated by the seismic record in any given region. The Puente Hills, Elsinore, and San Jose Faults are located approximately 1.5, 1.9, and 8.8 miles from the subject site, respectively.

Soil liquefaction is a state of soil particle suspension caused by a complete loss of strength when the effective stress drops to zero. Liquefaction normally occurs under saturated conditions in soils such as sand in which the strength is purely frictional. However, liquefaction has occurred in soils other than clean sand. Liquefaction usually occurs under vibratory conditions such as those induced by seismic events. To evaluate the liquefaction potential of the site, the following items were evaluated:

- 1) Soil type
- 2) Groundwater depth
- 3) Relative density
- 4) Initial confining pressure
- 5) Intensity and duration of ground shaking

The subject site is located on the State of California, Seismic Hazard Zones Map, Yorba Linda Quadrangle, dated August 11, 2005. The subject site is not located in and area designated as a liquefaction hazard zone. The subsurface soil conditions encountered at the site consist of medium dense to dense silty sand and hard clayey silt with varying fine sand content. Groundwater in the vicinity of the site was not encountered in any of the boring locations as part of this site investigation. Available groundwater depth mapping, as well as our experience in the area, indicates that historically groundwater has been located at depths in excess of fifty (50) feet below grade in the general vicinity of the site.

Based on the conditions encountered at the subject site, liquefaction is not considered a significant concern for the subject site. As such, mitigation measures associated with liquefaction are not considered warranted.

FAULT RUPTURE HAZARD ZONES

The Alquist-Priolo Geologic Hazards Zones Act went into effect in March, 1973. Since that time, the Act has been amended 11 times (Hart, 2007). The purpose of the Act, as provided in California Geologic Survey (CGS) Special Publication 42 (SP 42), is to prohibit the location of most structures for human occupancy across the traces of active faults and to mitigate thereby the hazard of fault-rupture". The Act was renamed the Alquist-Priolo Earthquake Fault Zoning Act in 1994, and at that time, the originally designated "Special Studies Zones" was renamed the "Earthquake Fault Zones."

The subject site is located on the State of California, Seismic Hazard Zones Map, Yorba Linda Quadrangle, dated November 1, 1991. The site is not within a Fault-Rupture Hazard Zone. The Elsinore, Puente Hills, and Chino Faults are located approximately 1.6, 3.1, and 8.0 miles from the subject site, respectively.

OTHER HAZARDS

Rockfall, Landslide, Slope Instability, Debris Flow: The subject site is relatively flat and level. It is our understanding that there are no significant slopes proposed as part of the proposed development. Provided the recommendations presented in this report are implemented into the design and construction of the anticipated development, rockfalls, landslides, slope instability, and debris flows are not anticipated to pose a hazard to the subject site.

Seiches: Seiches are large waves generated within enclosed bodies of water. The site is not located in close proximity to any lakes or reservoirs. As such, seiches are not anticipated to pose a hazard to the subject site.

Tsunamis: Tsunamis are tidal waves generated by fault displacement or major ground movement. The site is several miles from the ocean. As such, tsunamis are not anticipated to pose a hazard to the subject site.

Hydroconsolidation: The near surface soils encountered at the subject site were found to be medium dense to dense. Provided remedial grading recommendations presented in this report are incorporated in the design and construction, hydroconsolidation is not anticipated to be a significant concern for the subject site.

SITE COEFFICIENT

The site class, per Table 1613.5.2, 2016 CBC, is based upon the site soil conditions. It is our opinion that a Site Class D is appropriate for building design at this site. Site coordinates of 33.891099 and 117.815394 were used to determine the recommended seismic design values. For seismic design of the structures, in accordance with the seismic provisions of the 2016 CBC, we recommend the following parameters:

2016 CALIFORNIA BUILDING CODE		
Seismic Item	Value	CBC Reference
Site Class	D	Table 1613.5.2
Fa	1.000	Table 1613.5.3 (1)
Ss	1.981	Figure 1613.5 (3)
SMS	1.981	Section 1613.5.3
SDS	1.321	Section 1613.5.4
Fv	1.500	Table 1613.5.3 (2)
S1	0.733	Figure 1613.5 (4)
SM1	1.100	Section 1613.5.3
SD1	0.733	Section 1613.5.4
Peak Horizontal Acceleration	0.750 g	Figure 22.7

The seismic hazard most likely to impact the site is ground shaking due to a large earthquake on one of the major active regional faults. The Elsinore, Puente Hills, and Chino Faults are located approximately 1.6, 3.1, and 8.0 miles from the subject site, respectively. Because of the proximity to the subject site and the maximum probable events for these faults, it appears that a maximum probable event along these fault zones could produce a peak horizontal acceleration of approximately 0.750g when uncertainty is used. With respect to this hazard, the site is comparable to others in this general area within similar geologic settings.

FIELD AND LABORATORY INVESTIGATIONS

Subsurface soil conditions were explored by drilling six (6) borings using a truck-mounted drill rig to depths ranging from approximately ten (10) feet to twenty (20) feet below existing site grades. Bulk subgrade soil samples were also obtained for laboratory testing. The approximate boring and bulk sample locations are shown on the Site Plan, Figure 2. These approximate boring and sample locations were estimated in the field based on pacing and measuring from the limits of existing site features. During drilling operations, penetration tests were performed at regular intervals to evaluate the soil consistency and to obtain information regarding the engineering properties of the subsurface soils. Soil samples were retained for laboratory testing. The soils encountered were continuously examined and visually classified in accordance with the Unified Soil Classification System. A more detailed description of the field investigation is presented in Appendix A.

Laboratory tests were performed on selected soil samples to evaluate their physical characteristics and engineering properties. The laboratory-testing program was formulated with emphasis on the evaluation of natural in-situ moisture and density, gradation, R-Value, maximum dry density, resistivity, pH value, sulfate- and chloride-contents of the materials encountered. Details of the laboratory-testing program are discussed in Appendix A. The results of the laboratory tests are presented on the boring logs or on the test reports, which are also included in Appendix A. This information, along with the field observations, was used to prepare the final boring logs in Appendix A.

SOIL PROFILE AND SUBSURFACE CONDITIONS

Based on our findings, the subsurface conditions encountered appear typical of those found in the geologic region of the site. Ground surface at each of the boring locations consisted of approximately three (3) to (6) six inches of asphalt pavement underlain by approximately six (6) to seven (7) inches of discernable base material. The subsurface soil conditions encountered at the site generally consisted of fill soil to depths of up to ten (10) feet below existing site grades. The fill material appears to be uniform and consistent throughout the site. The fill material consisted of medium dense to dense silty sand. Below the near surface fill material, interbedded layers of medium dense to dense silty sands and hard clayey silts with varying sand content were encountered from depths of approximately 3 feet below site grades to the maximum depth explored, twenty (20) feet below site grades. Thicker fill materials may be present at the site between our boring locations. Verification of any fill material should be determined during site grading.

Field and laboratory tests suggest that the soils encountered are moderately strong and slightly compressible. Penetration resistance, measured by the number of blows required to drive a Modified California sampler or a Standard Penetration Test (SPT) sampler, ranged from 18 to 67 blows per foot. Dry densities ranged from approximately 107 to 127 pcf. Representative soil samples had angles of internal friction of 30 degrees.

The above is a general description of soil conditions encountered at the site in the borings drilled for this investigation. For a more detailed description of the soil conditions encountered, please refer to the boring logs in Appendix A.

GROUNDWATER

Test boring locations were checked for the presence of groundwater during and immediately following the drilling operations. Groundwater was not encountered in any of the boring locations as part of this site investigation. Based on a review of the Seismic Hazard Evaluation Report for the Yorba Linda Quadrangle, historic high groundwater depths for the vicinity of the subject site are estimated to be at depths in excess of fifty (50) feet below ground surface.

It should be recognized that water table elevation might fluctuate with time. The depth to groundwater can be expected to fluctuate both seasonally and from year to year. Fluctuations in the groundwater level may occur due to variations in precipitation, irrigation practices at the site and in the surrounding areas, climatic conditions, flow in adjacent or nearby canals, pumping from wells and possibly as the result of

other factors that were not evident at the time of our investigation. Therefore, water level observations at the time of our field investigation may vary from those encountered during the construction phase of the project. The evaluation of such factors is beyond the scope of this report. Long-term monitoring in observation wells, sealed from the influence of surface water, is often required to more accurately define the potential range of groundwater conditions on a site.

SOIL CORROSIVITY

Corrosion tests were performed to evaluate the soil corrosivity to the buried structures. The tests consisted of minimum resistivity, sulfate content and chloride content, and the results of the tests are included as follows:

Parameter	Results	Test Method
Sulfate	197 ppm	CA 417
Min Resistivity	2,100 ohm-cm	CA 643
Chloride	29 ppm	CA 422
pH Value	7.5	EPA 9045C

INFILTRATION TESTING

Estimated infiltration rates were determined using the results of open borehole percolation testing performed at the subject site. Infiltration testing was performed in accordance with the Technical Guidance Document for Orange County. The percolation testing indicated that the near surface silty sand soil was found to have infiltration rates of approximately 0.21 and 0.28 inch per hour.

In order to perform the infiltration tests, two borings were drilled to approximately five feet below existing site grades. Infiltration testing was performed at each of the two boring locations. Infiltration testing has been performed using open borehole percolation testing in accordance with the County of Orange Best Management Guidance document. Prior to infiltration testing, approximately four inches of gravel was placed at the bottom of each borehole. The boreholes were pre-soaked prior to testing using clean water. The depth of each borehole was measured at each reading to verify the overall depth. The depth of water in the borehole was measured using a water level indicator or well sounder. Infiltration rates have been calculated using the Inverse Borehole procedures.

Based on the very low infiltration rates, the subsurface conditions encountered at the subject site are not considered conducive to infiltration. Detailed results of the infiltration testing are included in Appendix A in tabular format.

CONCLUSIONS AND RECOMMENDATIONS

Based on the findings of our field and laboratory investigations, along with previous geotechnical experience in the project area, the following is a summary of our evaluations, conclusions, and recommendations.

ADMINISTRATIVE SUMMARY

In brief, the subject site and soil conditions appear to be conducive to the development of the project. Based on the data collected during this investigation and from a geotechnical engineering standpoint, it is our opinion that the proposed improvements may be made as anticipated provided that the recommendations presented in this report are considered in the design and construction of the project.

To reduce post-construction soil movement, provide uniform support for the proposed building, and address anticipated disturbed material resulting from demolition activities, overexcavation and recompaction within the proposed building footprint area should be performed to a minimum depth of three (3) feet below existing grades or two (2) feet below the bottom of the proposed footings, whichever is deeper. The actual depth of the overexcavation and recompaction should be determined by our field representative during construction. The overexcavation and recompaction should also extend laterally five (5) feet beyond edges of the proposed footings or building limits. Any undocumented fill encountered during grading should be removed and replaced with Engineered Fill.

Within the proposed exterior flatwork and pavement areas, the overexcavation and recompaction should be performed to a depth of at least one (1) foot below existing grade or finish subgrade, whichever is deeper. This compaction effort should stabilize the surface soils and locate any unsuitable or pliant areas not found during our field investigation.

Fill material should be compacted to a minimum of 90 percent of the maximum dry density based on ASTM Test Method D1557. All fill material should be moisture-conditioned to at least 2 percent above optimum moisture-content.

The limit of grading and the proposed building footprint should be established in the field prior to construction. Additional remedial grading will be required if the building edges exceed the grading limit. The grading envelope should be at least 5 feet beyond the outer edges of the building footprint.

The proposed structures, including walls and other foundation elements may be supported on a shallow foundation system bearing on a minimum of one foot of newly placed Engineered Fill. Spread and continuous footings can be designed for a maximum allowable soil bearing pressure, dead plus live load, of 2,600 psf.

Infiltration rates were determined using the results of open borehole infiltration testing performed at the subject site. Infiltration testing performed on the near surface silty sand soil indicates infiltration rates of approximately 0.21 and 0.28 inch per hour. Based on the very low infiltration rates, the subsurface conditions encountered at the site are not considered conducive to infiltration.

GROUNDWATER INFLUENCE ON STRUCTURES/CONSTRUCTION

Based on our findings and historical records, it is not anticipated that groundwater will rise within the zone of structural influence or affect the construction of foundations and pavements for the project. However, if earthwork is performed during or soon after periods of precipitation, the subgrade soils may become saturated, "pump," or not respond to densification techniques. Typical remedial measures include: discing and aerating the soil during dry weather; mixing the soil with dryer materials; removing and replacing the soil with an approved fill material; or mixing the soil with an approved lime or cement product. Our firm should be consulted prior to implementing remedial measures to observe the unstable subgrade conditions and provide appropriate recommendations.

SEISMIC CONSIDERATIONS

Ground Shaking

Although ground rupture is not considered to be a major concern at the subject site, the site will likely be subject to at least one moderate to severe earthquake and associated seismic shaking during its lifetime, as well as periodic slight to moderate earthquakes. Some degree of structural damage due to stronger seismic shaking should be expected at the site, but the risk can be reduced through adherence to seismic design codes.

Seismic Induced Settlement

One of the most common phenomena during seismic shaking accompanying any earthquake is the induced settlement of loose unconsolidated soils. Based on site subsurface conditions and the moderate to high seismicity of the region, any loose fill materials at the site could be vulnerable to this potential hazard. However, this hazard can be mitigated by following the design and construction recommendations of the Geotechnical Engineering Investigation Report.

EARTHWORK

Site Preparation – Clearing and Stripping

General site clearing should include removal of vegetation and existing utilities, structures (footings and slabs); existing pavements; trees and associated root systems; rubble; rubbish; and any loose and/or saturated materials. Site stripping should extend to a minimum depth of 2 to 4 inches, or until all organics in excess of 3 percent by volume are removed. Deeper stripping may be required in localized areas. These materials will not be suitable for reuse as Engineered Fill. However, stripped topsoil may be stockpiled and reused in landscape or non-structural areas.

Any excavations that result from clearing operations should be backfilled with Engineered Fill. Krazan & Associates' field staff should be present during site clearing operations to enable us to locate areas where depressions or disturbed soils are present and to allow our staff to observe and test the backfill as it is placed. If site clearing and backfilling operations occur without appropriate observation and testing by a qualified geotechnical consultant, there may be the need to over-excavate the building area to identify uncontrolled fills prior to mass grading of the building pad.

As with site clearing operations, any buried structures encountered during construction should be properly removed and backfilled. The resulting excavations should be backfilled with Engineered Fill.

Overexcavation and Recomaction

To reduce post-construction soil movement, provide uniform support for the proposed building, and address anticipated disturbed material resulting from demolition activities, overexcavation and recompaction within the proposed building footprint area should be performed to a minimum depth of three (3) feet below existing grades or two (2) feet below the bottom of the proposed footings, whichever is deeper. The actual depth of the overexcavation and recompaction should be determined by our field representative during construction. The overexcavation and recompaction should also extend laterally five (5) feet beyond edges of the proposed footings or building limits. Any undocumented fill encountered during grading should be removed and replaced with Engineered Fill.

Within the proposed exterior flatwork and pavement areas, the overexcavation and recompaction should be performed to a depth of at least one (1) foot below existing grade or finish subgrade, whichever is deeper. This compaction effort should stabilize the surface soils and locate any unsuitable or pliant areas not found during our field investigation.

The upper soils, during wet winter months, become very moist due to the absorptive characteristics of the soil. Earthwork operations performed during winter months may encounter very moist unstable soils which may require removal to grade a stable building foundation. Project site winterization consisting of placement of aggregate base and protecting exposed soils during the construction phase should be performed.

A representative of our firm should be present during all site clearing and grading operations to test and observe earthwork construction. This testing and observation is an integral part of our service as acceptance of earthwork construction is dependent upon compaction of the material and the stability of the material. The Soils Engineer may reject any material that does not meet compaction and stability requirements. Further recommendations of this report are predicated upon the assumption that earthwork construction will conform to recommendations set forth in this section and the Engineered Fill section.

Fill Placement

Prior to placement of fill soils, the upper 12 inches of native subgrade soils should be scarified, moisture-conditioned to at least 2 percent above optimum moisture-content, and recompacted to a minimum of 90 percent of the maximum dry density based on ASTM Test Method D1557. Fill material should be compacted to a minimum of 90 percent of the maximum dry density based on ASTM Test Method D1557.

The upper soils, during wet winter months, may become very moist due to the absorptive characteristics of the soil. Earthwork operations performed during winter months may encounter very moist unstable soils, which may require removal to grade a stable building foundation. Project site winterization consisting of placement of aggregate base and protecting exposed soils during the construction phase should be performed.

ENGINEERED FILL

The organic-free, on-site, native and fill soils are predominately silty sand with traces of clay content at some areas of the site. These soils will be suitable for reuse as Engineered Fill, provided they are cleansed of excessive organics and debris and have very minimal clay content.

The preferred materials specified for Engineered Fill are suitable for most applications with the exception of exposure to erosion. Project site winterization and protection of exposed soils during the construction phase should be the sole responsibility of the contractor, since they have complete control of the project site at that time.

Imported Fill material should be predominately non-expansive granular material. This material should be approved by the Geotechnical Engineer prior to use and should typically possess the following characteristics:

NON-EXPANSIVE FILL PROPERTIES	
Percent Passing No. 200 Sieve	10 to 50
Plasticity Index (PI)	12 maximum
Liquid Limit	35 maximum
UBC Standard 29-2 Expansion Index	20 maximum

Imported Fill should be free from rocks and clods greater than 4 inches in diameter. All Imported Fill material should be submitted to the Soils Engineer for approval at least 48 hours prior to delivery to the site. Fill soils should be placed in lifts approximately 6 inches thick, moisture-conditioned to at least optimum moisture-content, and compacted to achieve at least 90 percent of maximum dry density as determined by ASTM Test Method D1557. Additional lifts should not be placed if the previous lift did not meet the required dry density or if soil conditions are not stable.

FOUNDATIONS

The proposed structures, including walls and other foundation elements may be supported on a shallow foundation system bearing on a minimum of two (2) feet of newly placed Engineered Fill. Spread and continuous footings can be designed for the following maximum allowable soil bearing pressures:

Load	Allowable Loading
Dead Load Only	2,000 psf
Dead-Plus-Live Load	2,600 psf
Total Load, including wind or seismic loads	3,500 psf

The footings should have a minimum depth of 18 inches below pad subgrade (soil grade) or adjacent exterior grade, whichever is deeper. Minimum footing widths should be 15 inches for continuous footings and 24 inches for isolated footings. The footing excavations should not be allowed to dry out any time prior to placement of concrete.

It is recommended that the foundation for the proposed structure be placed entirely within compacted fill materials or entirely within alluvium or bedrock. Footings shall not transition from one bearing material to another. It is recommended that all foundations contain steel reinforcement of at least two (2) number four (#4) bars, one (1) top and one (1) bottom.

It is recommended that all foundations be set back a minimum of five (5) feet from the top of all adjacent slopes or deepened to maintain at least five (5) feet between the bottom of the footing and the slope face. Additionally, all footing set back criteria, should conform to 2016 CBC Section 1805.3.2 and Figure 1805.3.1. It is recommended that all footings be cleared of all loose soil and construction debris prior to pouring concrete.

Settlement

Provided the site is prepared as recommended and that the foundations are designed and constructed in accordance with our recommendations, the total settlement due to foundation loads is not expected to exceed 1 inch. The differential settlement resulting from foundation loads is anticipated to be less than ½ inch in 30 feet. Most of the settlement is expected to occur during construction as the loads are applied. However, additional post-construction settlement may occur if the foundation soils are flooded or saturated.

Lateral Load Resistance

Resistance to lateral footing displacement can be computed using an allowable friction factor of 0.25 acting between the base of foundations and the supporting subgrade. Where a vapor barrier material is used below concrete slabs-on-grade, a coefficient of friction should be provided by the vapor barrier manufacturer. Lateral resistance for footings can alternatively be developed using an allowable equivalent fluid passive pressure of 200 pounds per cubic foot acting against the appropriate vertical footing faces. Where equivalent fluid pressure against the sides of the footings or embedded slab edge are to be used, the footing or slab edge must be cast directly against undisturbed soils or the soils surrounding the structure must be recompacted to the requirements for Engineered Fill presented above. The frictional and passive resistance of the soil may be combined without reduction in determining the total lateral resistance. A one-third increase in the value above may be used for short duration, wind, or seismic loads.

FLOOR SLABS AND EXTERIOR FLATWORK

The interior slabs-on-grade should be designed at least five inches (5") in thickness. It is recommended that the slabs be reinforced with number three (#3) bars, eighteen inches (18") on center in both directions.

Exterior slabs-on-grade should be designed at least five inches (5") in thickness. It is recommended that the slabs be reinforced with number three (#3) bars, eighteen inches (18") on center in both directions. The exterior floors should be poured separately in order to act independently of the walls and foundation system. All fills required to bring the building pads to grade should be Engineered Fills.

It is recommended that the slabs should be underlain by six inches (6") of compacted Class 2 Aggregate Base with a minimum 15 mil polyolefin membrane vapor barrier (i.e. Stego Wrap or equivalent) placed with two inches (2") of clean sand on top of the vapor barrier. As an alternative, well graded non-expansive compacted fill may be used directly below the slab on grade.

Moisture within the structure may be derived from water vapors, which were transformed from the moisture within the soils. This moisture vapor can travel through the vapor membrane and penetrate the slab-on-grade. This moisture vapor penetration can affect floor coverings and produce mold and mildew in the structure. To minimize moisture vapor intrusion, it is recommended that a vapor retarder be installed in accordance with ASTM guidelines. It is recommended that the utility trenches within the structure be compacted, as specified in our report, to minimize the transmission of moisture through the utility trench backfill. Special attention to the immediate drainage and irrigation around the building is recommended. Positive drainage should be established away from the structure and should be maintained throughout the life of the structure. Ponding of water should not be allowed adjacent to the structure. Over-irrigation within landscaped areas adjacent to the structure should not be performed. In addition, ventilation of the structure (i.e. ventilation fans) is recommended to reduce the accumulation of interior moisture.

RETAINING WALLS

For retaining walls with level ground surface behind the walls, we recommend that retaining walls capable of deflecting a minimum of 0.1 percent of its height at the top be designed using an equivalent fluid active pressure of 40 pounds per square foot per foot of depth. Walls that are incapable of this deflection or walls that are fully constrained against deflection may be designed for an equivalent fluid at-rest pressure of 60 pounds per square foot per foot of depth. This is anticipated to apply to the loading dock walls. A passive lateral pressure of 200 pounds per square foot may be used to calculate sliding resistance. If walls are to be constructed above descending slopes, our office should be contacted to discuss further reduction in allowable passive pressures for resistance of lateral forces, and for overall retaining wall foundation design.

The surcharge effect from loads adjacent to the walls should be included in the wall design. The surcharge load for walls capable of deflecting (cantilever walls), we recommend applying a uniform surcharge pressure equal to one-third of the applied load over the full height of the wall. Where walls are restrained the surcharge load should be based on one-half of the applied load above the wall, also distributed over the full height of the wall. For other surcharges, such as from adjacent foundations, point loads or line loads, Krazan & Associates should be consulted.

Expansive soils should not be used for backfill against walls. The zone of non-expansive backfill material should extend from the bottom of each retaining wall laterally back a distance equal to the height of the wall, to a maximum of five (5) feet.

The active and at-rest earth pressures do not include hydrostatic pressures. To reduce the build-up of hydrostatic pressures, drainage should be provided behind the retaining walls. Wall drain should consist of a minimum 12-inch wide zone of drainage material, such as ¾-inch by ½-inch drain rock wrapped in a non-woven polypropylene geotextile filter fabric such as Mirafi 140N or equivalent. Alternatively,

drainage may be provided by the placement of a commercially produced composite drainage blanket, such as Miradrain, extending continuously up from the base of the wall. The drainage material should extend from the base of the wall to finished subgrade in paved areas and to within about 12 inches below the top of the wall in landscape areas. In landscape areas the top 12 inches should be backfilled with compacted native soil. A 4-inch minimum diameter, perforated, Schedule 40 PVC drain pipe should be placed with holes facing down in the lower portion of the wall drainage material, surrounded with drain rock wrapped in filter fabric. A solid drainpipe leading to a suitable discharge point should provide drainage outlet. As an alternative, weep holes may be used to provide drainage. If weep holes are used, the weep holes should be 3 inches in diameter and spaced about 8 feet on centers. The backside of the weep holes should be covered with a corrosion-resistant mesh to prevent loss of backfill and/or drainage material.

TEMPORARY EXCAVATION STABILITY

All excavations should comply with the current requirements of Occupational Safety and Health Administration (OSHA). All cuts greater than 5 feet in depth should be sloped or shored. Temporary excavations should be sloped at 1:1 (horizontal to vertical) or flatter, up to a maximum depth of 10 feet, and at 2:1 (horizontal to vertical) for cuts greater than 10 feet. Heavy construction equipment, building materials, excavated soil, and vehicular traffic should not be allowed within five feet of the top (edge) of the excavation. Where sloped excavations are not feasible due to site constraints, the excavations may require shoring. The design of the shoring system is normally the responsibility of the contractor or shoring designer, and therefore, is outside the scope of this report. The design of the temporary shoring should take into account lateral pressures exerted by the adjacent soil, and, where anticipated, surcharge loads due to adjacent buildings and any construction equipment or traffic expected to operate alongside the excavation.

The excavation/shoring recommendations provided herein are based on soil characteristics derived from our test borings within the area. Variations in soil conditions will likely be encountered during the excavations. Krazan & Associates, Inc. should be afforded the opportunity to provide field review to evaluate the actual conditions and account for field condition variations, not otherwise anticipated in the preparation of this recommendation.

Local building codes may restrict vertical cuts or shoring types used during construction. This may include limitations adjacent to existing improvements or public right of ways.

UTILITY TRENCH LOCATION, CONSTRUCTION AND BACKFILL

To maintain the desired support for existing or new foundations, new utility trenches should be located such that the base of the trench excavation is located above an imaginary plane having an inclination of 1.0 horizontal to 1.0 vertical, extending downward from the bottom edge of the adjacent footing.

Utility trenches should be excavated according to accepted engineering practices following OSHA standards by a contractor experienced in such work. The responsibility for the safety of open trenches should be borne by the contractor. Traffic and vibration adjacent to trench walls should be kept to a minimum; cyclic wetting and drying of excavation side slopes should be avoided. Depending upon the location and depth of some utility trenches, groundwater flow into open excavations could be

experienced, especially during or shortly following periods of precipitation. For purposes of this section of the report, backfill is defined as material placed in a trench starting one foot above the pipe; bedding and shading (also referred to as initial backfill) is all material placed in a trench below the backfill. With the exception of specific requirements of the local utility companies or building department, pipe bedding and shading should consist of clean medium-grained sand. The sand should be placed in a damp state and should be compacted by mechanical means prior to the placement of backfill soils. Above the pipe zone, underground utility trenches may be backfilled with either free-draining sand, on-site soil or imported soil. The trench backfill should be compacted to at least 90 percent relative compaction.

COMPACTED MATERIAL ACCEPTANCE

Compaction specifications are not the only criteria for acceptance of the site grading or other such activities. However, the compaction test is the most universally recognized test method for assessing the performance of the Grading Contractor. The numerical test results from the compaction test cannot be solely used to predict the engineering performance of the compacted material. Therefore, the acceptance of compacted materials will also be dependent on the moisture-content and the stability of that material. The Geotechnical Engineer has the option of rejecting any compacted material regardless of the degree of compaction if that material is considered to be too dry or excessively wet, unstable or if future instability is suspected. A specific example of rejection of fill material passing the required percent compaction is a fill which has been compacted with in-situ moisture-content significantly less than optimum moisture. Where expansive soils are present, heaving of the soils may occur with the introduction of water. Where the material is a lean clay or silt, this type of dry fill (brittle fill) is susceptible to future settlement if it becomes saturated or flooded.

SURFACE DRAINAGE AND LANDSCAPING

The ground surface should slope away from building and pavement areas toward appropriate drop inlets or other surface drainage devices. We recommended that adjacent paved exterior grades be sloped a minimum of 2 percent for a minimum distance of 5 feet away from structures. Ideally, asphalt concrete pavement areas should be sloped at a minimum of 2 percent, with Portland cement concrete sloped at a minimum of one percent toward drainage structures. These grades should be maintained for the life of the project. Roof drains should be designed to avoid discharging into landscape areas adjacent to the building. Downspouts should be directed to discharge directly onto paved surfaces to allow for surface drainage into the storm systems or should be connected directly to the on-site storm drain.

PAVEMENT DESIGN

Based on the established standard practice of designing flexible pavements in accordance with State of California Department of Transportation (Caltrans) for projects within California, we have developed pavement sections in accordance with the procedure presented in Caltrans Standard Test Method 301. This pavement design procedure is based on the volume of traffic (Traffic Index) and the soil resistance "R" value (R-Value).

Asphalt Concrete (Flexible) Pavements

One (1) near-surface soil sample was obtained from the soil borings at the project site for laboratory R-Value testing. The sample was tested in accordance with California Test 301. Results of the test are as follows:

R-VALUE TEST RESULTS			
Sample Number	Sample Depth (ft)	Description	R-Value at Equilibrium
RV #1	0-3'	Silty Sand	30

The Civil Engineer should consult with the client to confirm the truck count prior to assigning the Traffic Index and selecting the pavement sections for incorporation into the project plans.

Based on our understanding of the project specifications, a Traffic Index of 5.5 has been used for design of pavements for automobile parking lots and drive lanes.

Based on a review of the boring logs and the R-Value data presented above, the near surface soil of the site consists of silty sand with an R-Value of 30. If site grading exposes soil other than that assumed, we should perform additional tests to confirm or revise the recommended pavement sections for actual field conditions. Various alternative pavement sections based on the Caltrans Flexible Pavement Design Method are presented below:

ASPHALT CONCRETE (FLEXIBLE) PAVEMENTS				
Subgrade R-Value = 30				
Traffic / Pavement Designation	Traffic Index	Asphalt Concrete (inches)	Class 2 Aggregate Base (inches)	Depth of Compacted Subgrade (in)
STANDARD DUTY	5.5	4.0	6.0	12.0

We recommend that the subgrade soil be prepared as discussed in this report. The compacted subgrade should be non-yielding when proof-rolled with a loaded ten-wheel truck, such as a water truck or dump truck, prior to pavement construction. Subgrade preparation should extend a minimum of 2 feet laterally behind the edge of pavement or back of curbs.

Pavement areas should be sloped and drainage gradients maintained to carry all surface water off the site. A cross slope of 2 percent is recommended in asphalt concrete pavement areas to provide good surface drainage and to reduce the potential for water to penetrate into the pavement structure.

Unless otherwise required by local jurisdictions, paving materials should comply with the materials specifications presented in the Caltrans Standard Specifications Section. Class 2 aggregate should comply with the materials requirements for Class 2 base found in Section 26.

The mineral aggregate shall be Type B, ½-inch or ¾-inch maximum, medium grading, for the wearing course and ¾-inch maximum, medium grading for the base course, and shall conform to the requirements set forth in Section 39 of the Standard Specifications. The asphalt concrete materials should comply with and be placed in accordance with the specifications presented in Section 39 of the Caltrans Standard

Specifications, latest edition. Asphalt concrete should be compacted to a minimum of 96 percent of the maximum laboratory compacted (kneading compactor) unit weight.

ASTM Test procedures and should be used to assess the percent relative compaction of soils, aggregate base and asphalt concrete. Aggregate base and subbase, and the upper 12 inches of subgrade should be compacted to at least 95 percent based on the Modified Proctor maximum compacted unit weight obtained in accordance with ASTM Test Method D1557. Compacted aggregate base should also be stable and unyielding when proof-rolled with a loaded ten-wheel water truck or dump truck.

Portland Cement Concrete (Rigid) Pavement

A six-inch layer of compacted Class 2 Aggregate Base should be placed over the prepared subgrade prior to placement of the concrete. Based on soil conditions and project specifications, we recommend that the rigid pavement be a minimum of five (5) inches thick. The final rigid pavement design and section should be determined by the project Structural Engineer.

RIGID PAVEMENT			
Traffic/Pavement Designation	Portland Cement Concrete (inches)	Class 2 Aggregate Base (inches)	Compacted Subgrade (inches)
Standard Duty	5.0	6.0	12.0

Prior to the construction of any rigid pavement, we recommend that concrete mix histories with flexural strength data be obtained from the proposed supplier. In the absence of flexural strength history, we recommend that laboratory trial batching and testing be performed to allow for confirmation that the proposed concrete mix is capable of producing the required flexural strength.

The concrete pavements should be designed with both longitudinal and transverse joints. The saw-cut or formed joints should extend to a minimum depth on one-fourth of the pavement thickness plus $\frac{1}{4}$ inch. Joint spacing should not exceed 15 feet. Steel reinforcement of all rigid pavements is recommended to keep the joints tight and to control temperature cracking.

Keyed joints are recommended at all construction joints to transfer loads across the joints. Joints should be reinforced with a minimum of $\frac{1}{2}$ inch diameter by 48-inch long deformed reinforcing steel placed at mid-slab depth on 18-inch center-to-center spacing to keep the joints tight for load transfer. The joints should be filled with a flexible sealer. Expansion joints should be constructed only where the pavements abut structures or fixed objects.

Smooth bar dowels, with a diameter of $d/8$, where d equals the thickness of the concrete, at least 14 inches in length, placed at a spacing of 12 inches on centers, may also be considered for construction joints to transfer loads across the joints. The dowels should be centered across the joints with one side of the dowel lubricated to reduce the bond strength between the dowel and the concrete and fitted with a plastic cap to allow for bar expansion.

INFILTRATION TESTING

The shallow soil conditions present at the subject site were evaluated by drilling shallow borings in the vicinity of the infiltration tests. The borings drilled at the site indicated the subsurface soil conditions consisted of dense silty sand.

Infiltration rates were determined using the results of open borehole infiltration testing performed at the subject site. Infiltration testing performed on the near surface silty sand soil indicates infiltration rates of approximately 0.21 and 0.28 inch per hour. Based on the very low infiltration rates, the subsurface conditions encountered at the site are not considered conducive to infiltration. Detailed results of the percolation test and infiltration rate are attached in tabular format.

SOIL CORROSIVITY

Excessive sulfate in either the soil or native water may result in an adverse reaction between the cement in concrete (or stucco) and the soil. HUD/FHA and UBC have developed criteria for evaluation of sulfate levels and how they relate to cement reactivity with soil and/or water.

A soil sample was obtained from the site and tested in accordance with State of California Materials Manual Test Designation 417. The sulfate concentration detected in the soil sample indicated a moderate potential for exposure to sulfate based on allowable values established by HUD/FHA and UBC. Portland cement concrete in contact with soil should contain Type II cement and possess a compressive strength of at least 4,000 psi to compensate for sulfate reactivity with the cement.

Electrical resistivity testing of the soil indicates that the onsite soils may have a moderate potential for metal loss from electrochemical corrosion process. A qualified corrosion engineer should be consulted regarding the corrosion effects of the onsite soils on underground metal utilities.

ADDITIONAL SERVICES

Krazan & Associates should be retained to review your final foundation and grading plans, and specifications. It has been our experience that this review provides an opportunity to detect misinterpretation or misunderstandings with respect to the recommendations presented in this report prior to the start of construction.

Variations in soil types and conditions are possible and may be encountered during construction. In order to permit correlation between the soil data obtained during this investigation and the actual soil conditions encountered during construction, a representative of Krazan & Associates, Inc. should be present at the site during the earthwork and foundation construction activities to confirm that actual subsurface conditions are consistent with those contemplated in our development of this report. This will allow us the opportunity to compare actual conditions exposed during construction with those encountered in our investigation and to expedite supplemental recommendations if warranted by the exposed conditions. This activity is an integral part of our service, as acceptance of earthwork construction is dependent upon compaction testing and stability of the material. Krazan & Associates, Inc. will not be responsible for grades or staking, since this is the responsibility of the Prime Contractor.

All earthworks should be performed in accordance with the recommendations presented in this report, or as recommended by Krazan & Associates during construction. Krazan & Associates should be notified at least five working days prior to the start of construction and at least two days prior to when observation and testing services are needed. Krazan & Associates, Inc. will not be responsible for grades or staking, since this is the responsibility of the Prime Contractor.

The review of plans and specifications, and the observation and testing of earthwork related construction activities by Krazan & Associates are important elements of our services if we are to remain in the role of Geotechnical Engineer-Of-Record. If Krazan & Associates is not retained for these services, the client and the consultants providing these services will be assuming our responsibility for any potential claims that may arise during or after construction.

LIMITATIONS

Geotechnical Engineering is one of the newest divisions of Civil Engineering. This branch of Civil Engineering is constantly improving as new technologies and understanding of earth sciences advance. Although your site was analyzed using appropriate and current techniques and methods, undoubtedly there will be substantial future improvements in this branch of engineering. In addition to advancements in the field of Geotechnical Engineering, physical changes in the site due to site clearing or grading activities, new agency regulations, or possible changes in the proposed structure or development after issuance of this report will result in the need for professional review of this report. Updating or revisions to the recommendations report, and possibly additional study of the site may be required at that time. In light of this, the Owner should be aware that there is a practical limit to the usefulness of this report without critical review. Although the time limit for this review is strictly arbitrary, it is suggested that two years be considered a reasonable time for the usefulness of this report.

Foundation and earthwork construction is characterized by the presence of a calculated risk that soil and groundwater conditions have been fully revealed by the original foundation investigation. This risk is derived from the practical necessity of basing interpretations and design conclusions on limited sampling of the earth. The recommendations made in this report are based on the assumption that soil conditions do not vary significantly from those disclosed during our field investigation. The logs of the exploratory borings do not provide a warranty as to the conditions that may exist beneath the entire site. The extent and nature of subsurface soil and groundwater variations may not become evident until construction begins. It is possible that variations in soil conditions and depth to groundwater could exist beyond the points of exploration that may require additional studies, consultation, and possible design revisions. If conditions are encountered in the field during construction, which differ from those described in this report, our firm should be contacted immediately to provide any necessary revisions to these recommendations.

This report presents the results of our Geotechnical Engineering Investigation, which was conducted for the purpose of evaluating the soil conditions in terms of foundation and retaining wall design, and grading and paving of the site. This report does not include reporting of any services related to environmental studies conducted to assess the presence or absence of hazardous and/or toxic materials in the soil, groundwater, or atmosphere, or the presence of wetlands. Any statements in this report or on any boring log regarding odors, unusual or suspicious items, or conditions observed, are

strictly for descriptive purposes and are not intended to convey professional judgment regarding the presence of potentially hazardous or toxic substances. Conversely, the absence of statements in this report or on any boring log regarding odors, unusual or suspicious items, or conditions observed, does not constitute our rendering professional judgment regarding the absence of potentially hazardous or toxic substances.


The conclusions of this report are based on the information provided regarding the proposed construction. We emphasize that this report is valid for the project as described in the text of this report and it should not be used for any other sites or projects. The geotechnical engineering information presented herein is based upon our understanding of the proposed project and professional interpretation of the data obtained in our studies of the site. It is not warranted that such information and interpretation cannot be superseded by future geotechnical engineering developments. The Geotechnical Engineer should be notified of any changes to the proposed project so the recommendations may be reviewed and re-evaluated. The work conducted through the course of this investigation, including the preparation of this report, has been performed in accordance with the generally accepted standards of geotechnical engineering practice, which existed in geographic area of the project at the time the report was written. No other warranty, express or implied, is made. This report is issued with the understanding that the owner chooses the risk they wish to bear by the expenditures involved with the construction alternatives and scheduling that are chosen. If you have any questions, or if we may be of further assistance, please do not hesitate to contact our office at (951) 273-1011.

Respectfully submitted,
KRAZAN & ASSOCIATES, INC.


James M. Kellogg, PE, GE


Managing Engineer



RCE No. 65092 RGE No. 2902

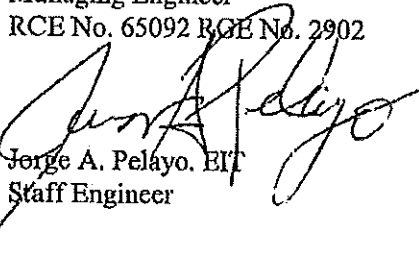

Jorge A. Pelayo, EIT
Staff Engineer


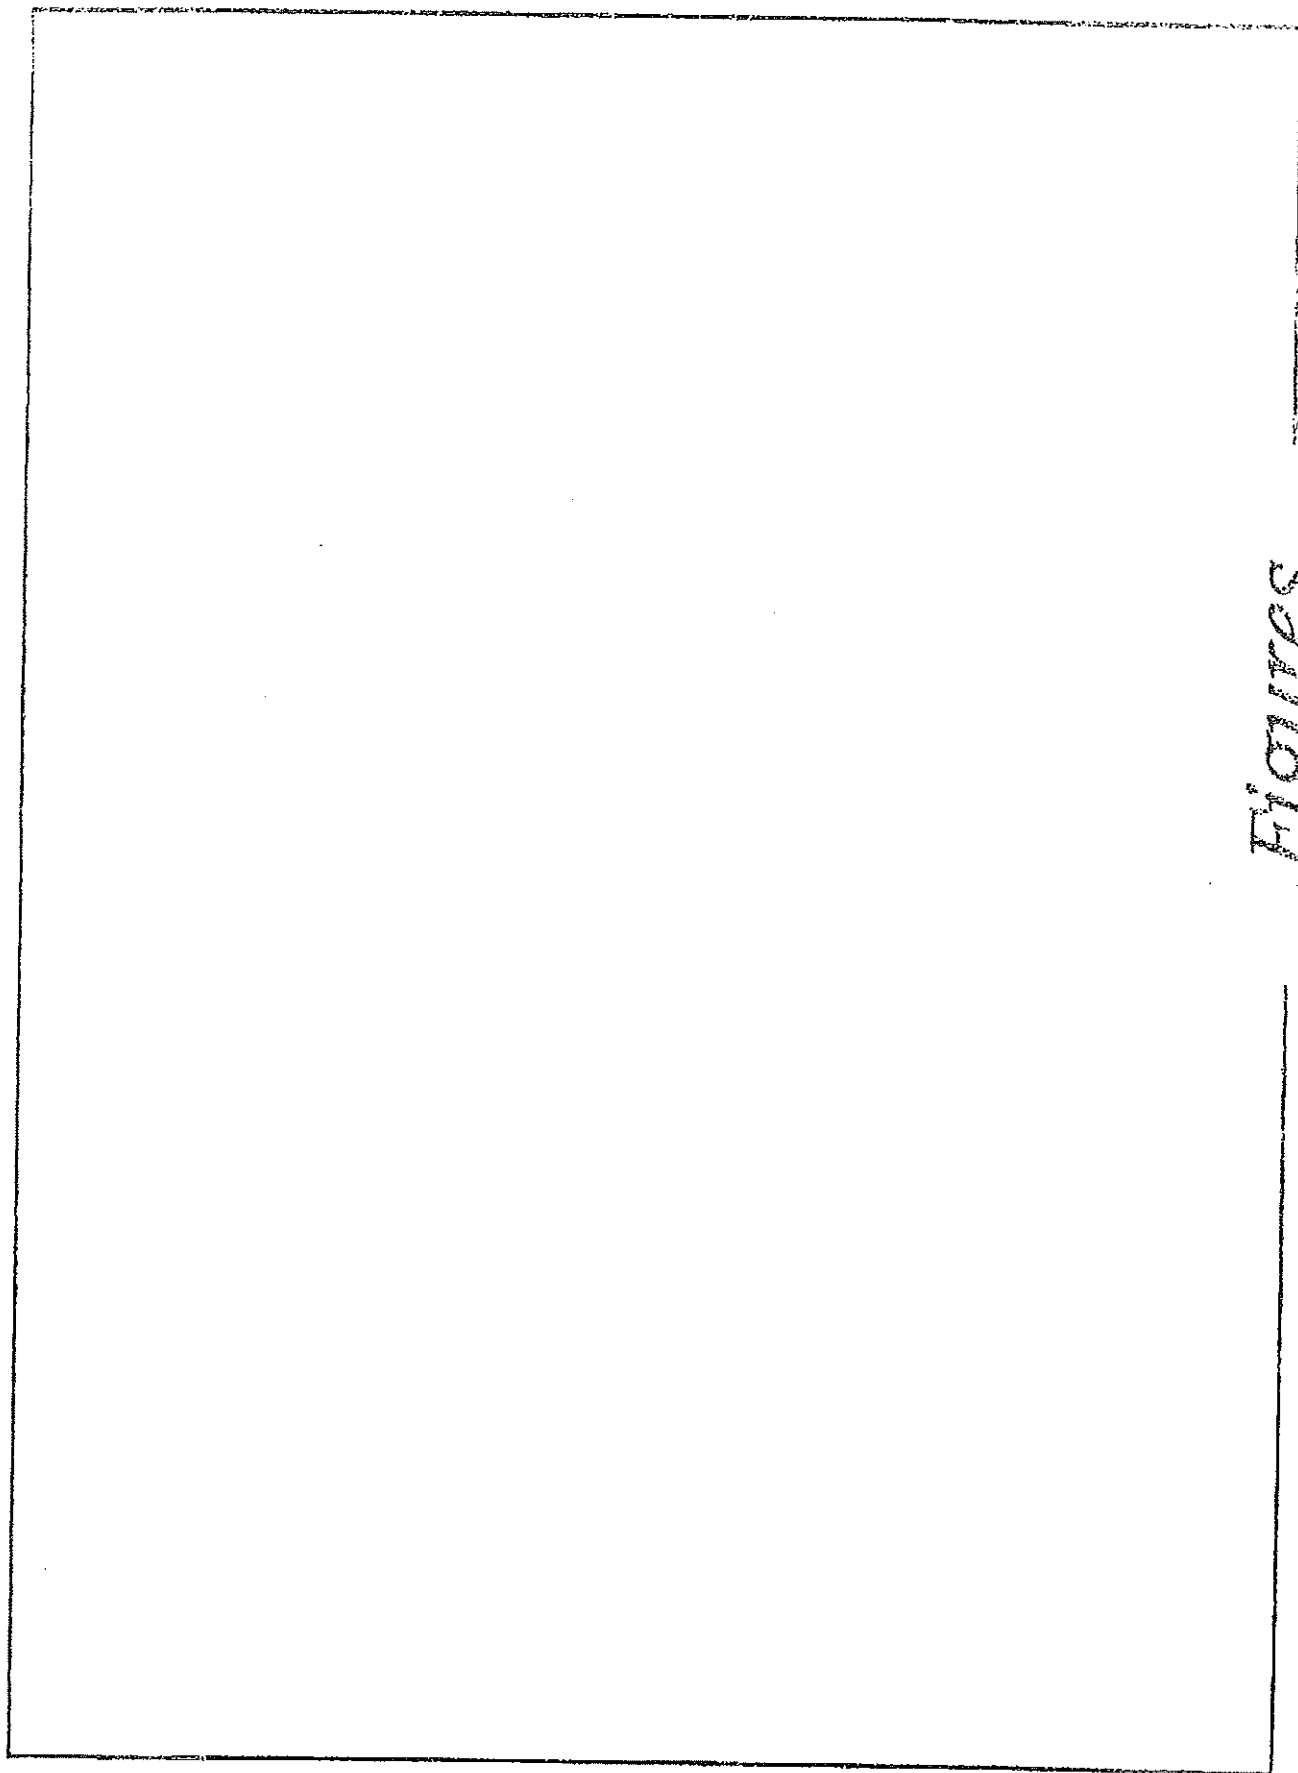


Figures

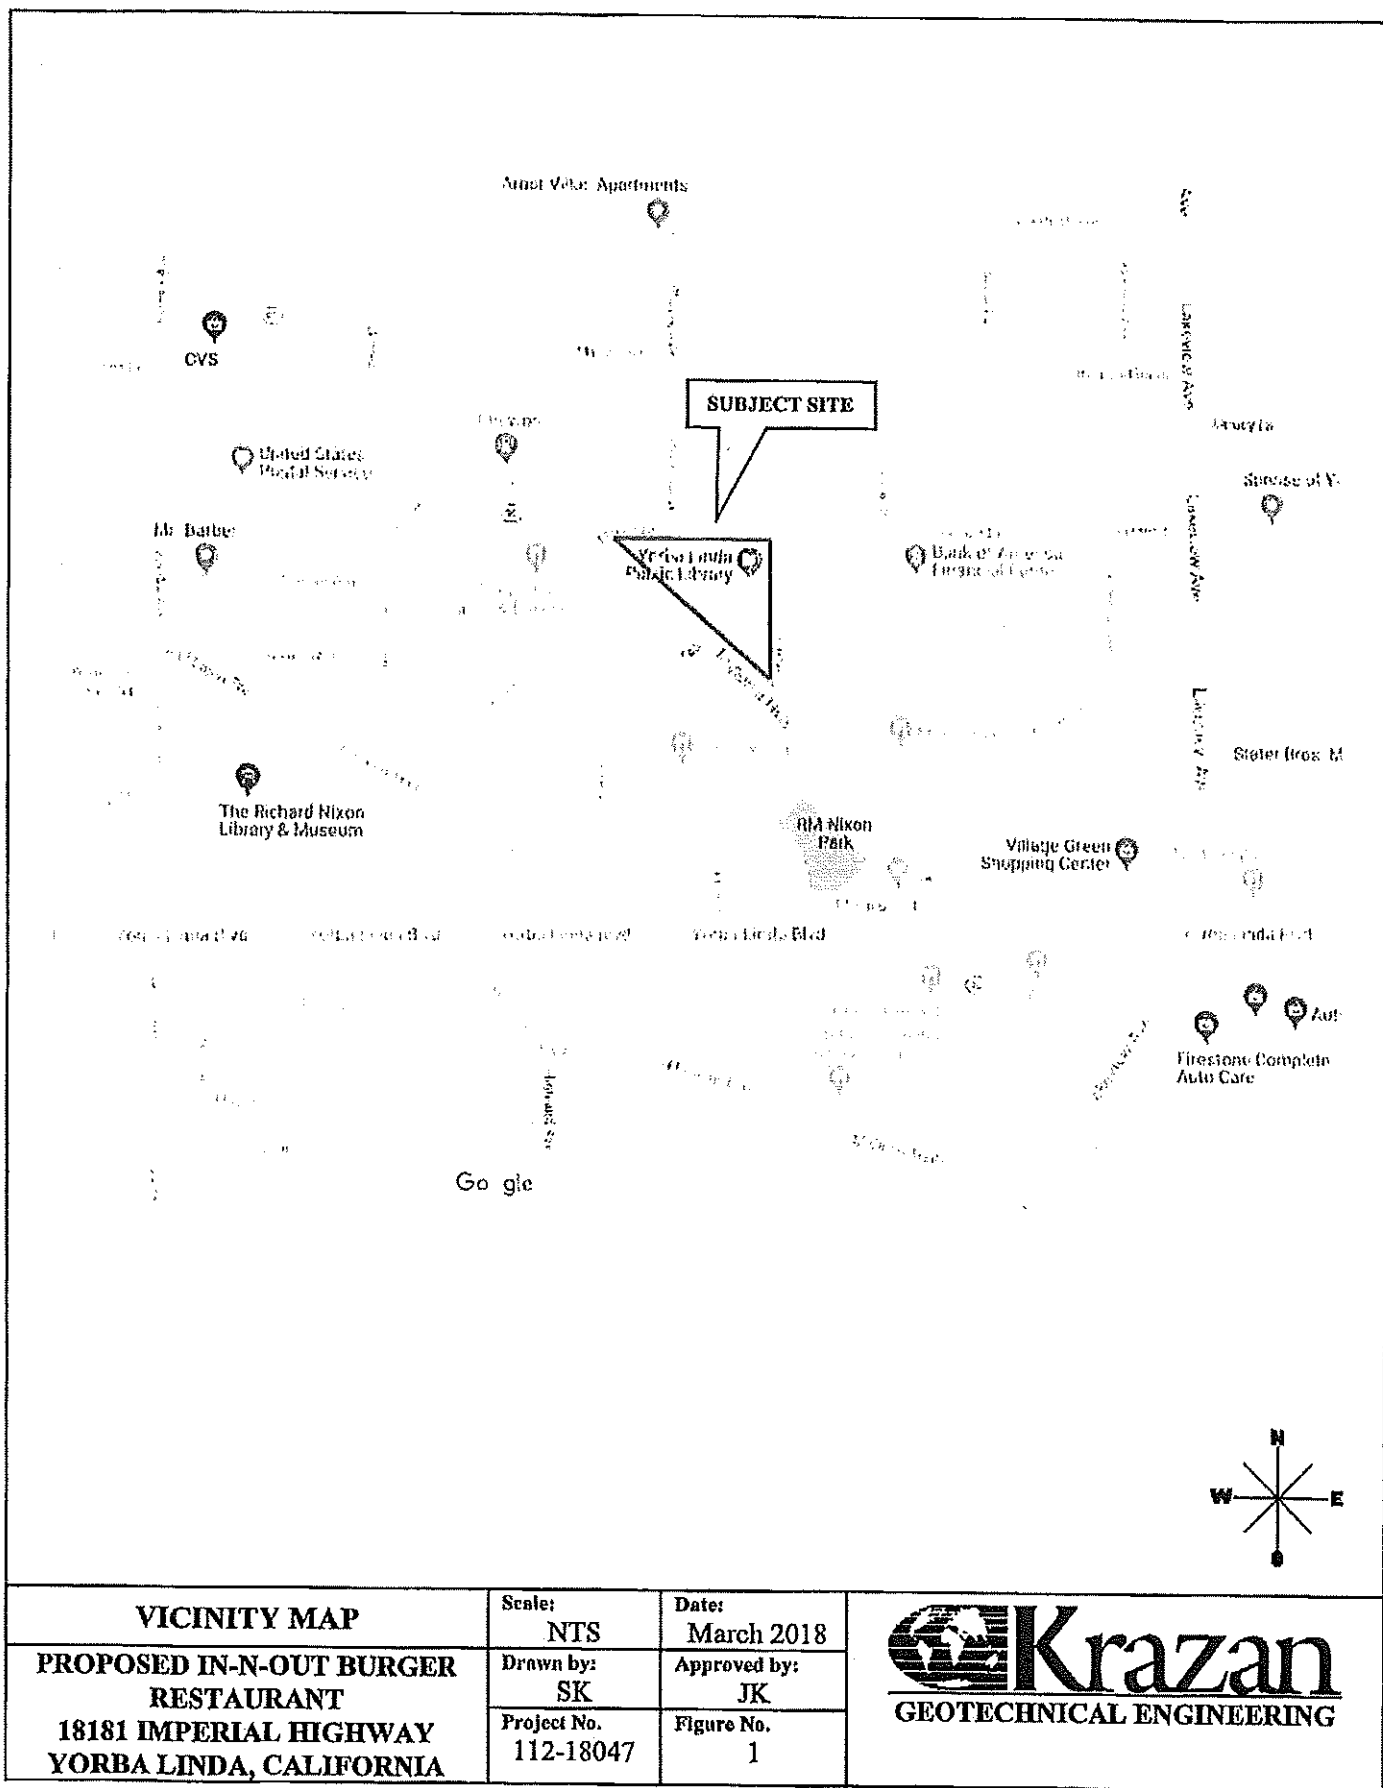


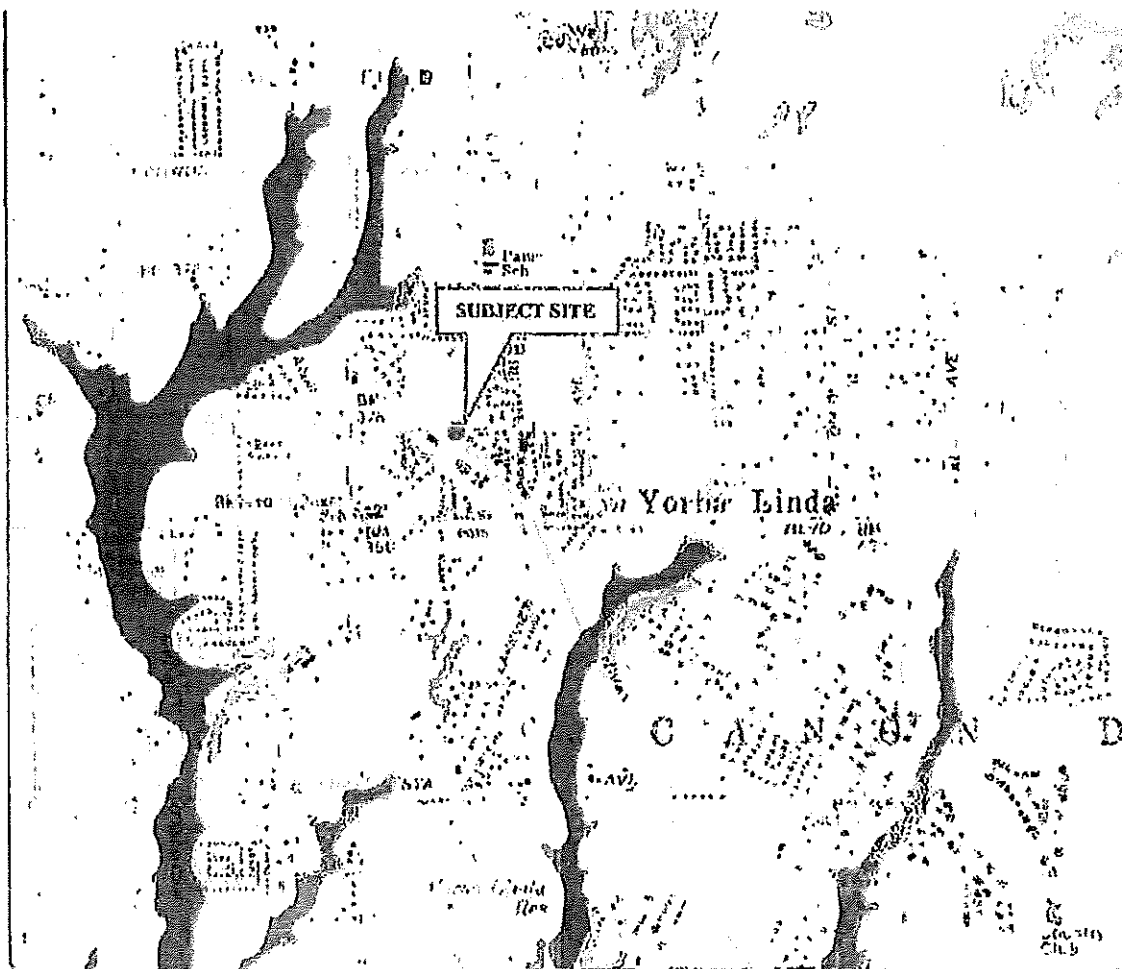


VICINITY MAP PROPOSED IN-N-OUT BURGER RESTAURANT 18181 IMPERIAL HIGHWAY YORBA LINDA, CALIFORNIA	Scale: NTS	Date: March 2018	
	Drawn by: SK	Approved by: JK	
	Project No. 112-18047	Figure No. 1	

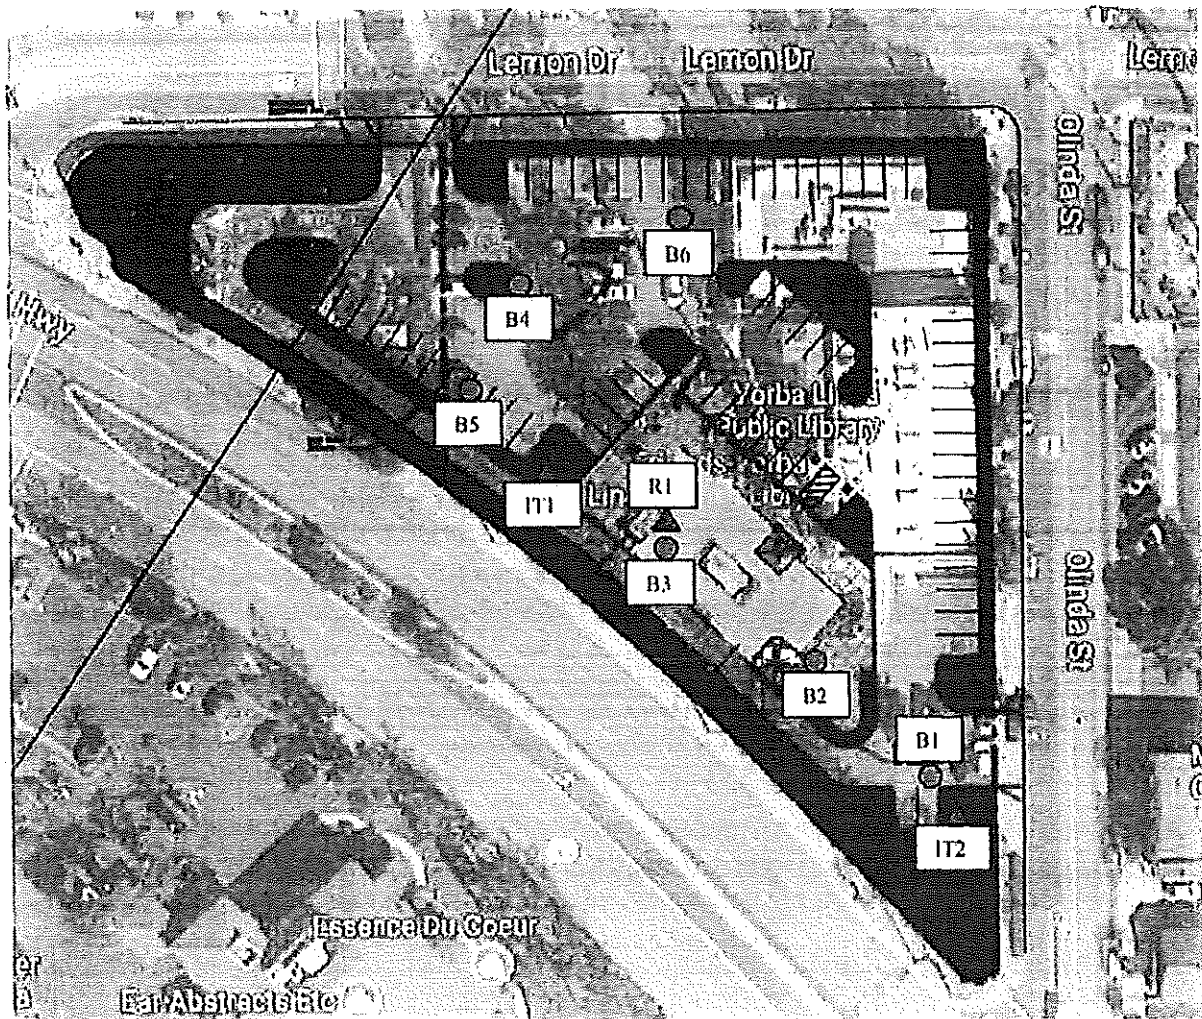

- ▲ APPROXIMATE R-VALUE LOCATION
- APPROXIMATE BORING LOCATION
- ▲ APPROXIMATE INFILTRATION TEST LOCATION

SITE MAP	Scale: NTS	Date: May 2018	
PROPOSED IN-N-OUT BURGER RESTAURANT	Drawn by: SK	Approved by: JK	
18181 IMPERIAL HIGHWAY YORBA LINDA, CALIFORNIA	Project No. 112-18047	Figure No. 2	



MAP EXPLANATION

ALBUQUERQUE EARTHQUAKE FAULT ZONES

Earthquake Fault Zones
 Zone boundaries are indicated by single line segments; the boundaries define the areas of required investigation that includes a potential hazard to structures from surface faulting or fault creep such that additional investigation as described in Public Resources Code Section 26112(a) would be required.




Active Fault Zones
 Faults considered to have been active during Holocene time and to have potential for surface rupture. All lines in Black or Red where Approximately Located; Long Dash in Black or Solid Line in Purple where Approximately Located; Short Dash in Black or Solid Line in Orange where Inferred; Dotted Line in Black or Solid Line in Rose where Consulted; Query (?) indicates additional investigation is required; or C for displacement caused by fault creep.

SEISMIC HAZARD ZONES


Liquefaction Zones
 Areas where historical occurrence of liquefaction, or local geologic, geotechnical and ground water conditions indicate a potential for permanent ground displacement such that additional investigation as defined in Public Resources Code Section 26112(a) would be required.




Earthquake-Induced Landslide Zones
 Areas where previous occurrence of landslide movement, or local topographic, geologic, geotechnical and subsurface water condition indicate a potential for permanent ground displacement such that additional investigation as defined in Public Resources Code Section 26112(a) would be required.



Source: State of California Seismic Hazards Map, Yorba Linda Quadrangle

EARTHQUAKE ZONES OF REQUIRED INVESTIGATION MAP	Scale: NTS	Date: May 2018	
PROPOSED IN-N-OUT BURGER RESTAURANT 18181 IMPERIAL HIGHWAY YORBA LINDA, CALIFORNIA	Drawn by: SK	Approved by: JK	
	Project No. 112-18047	Figure No. 3	

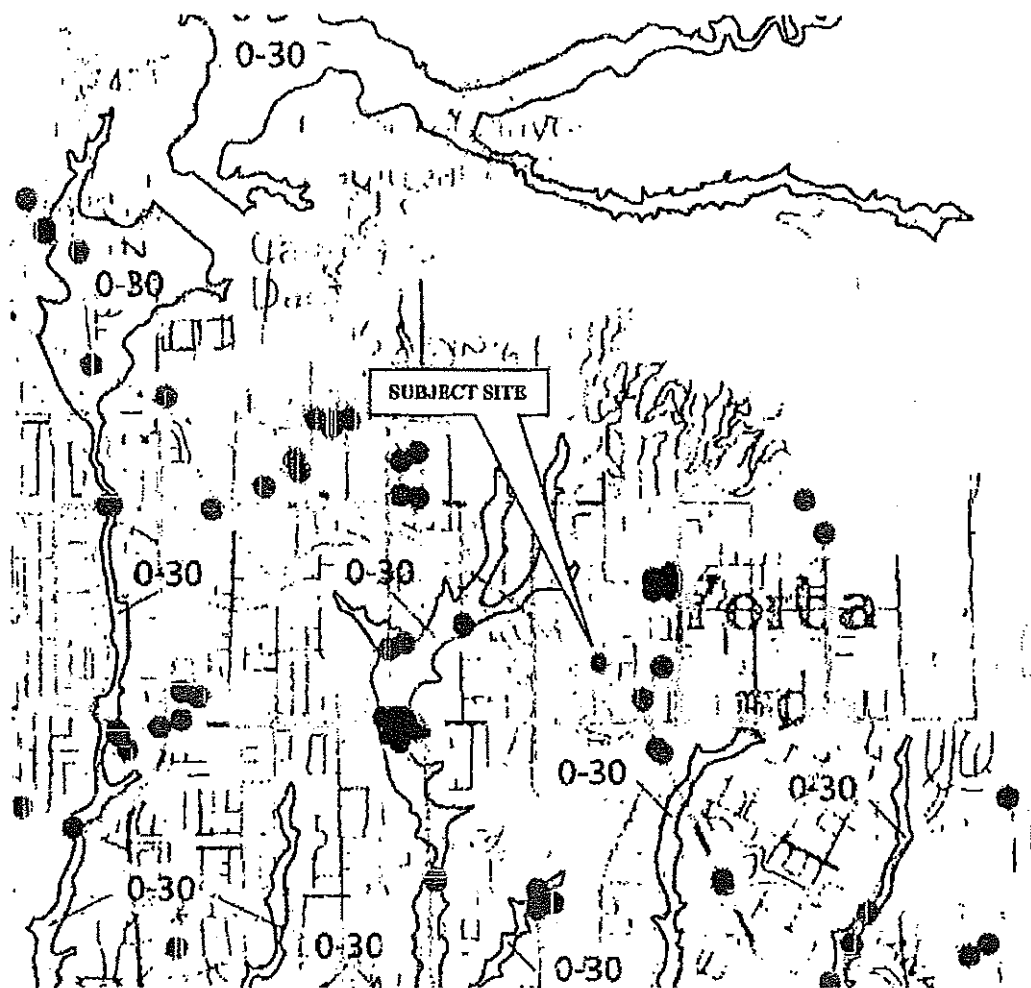

EXPLANATION


--- 20 ---

Contour interval depth (in feet) to historic high groundwater.


10


Depth (in feet) to historic high groundwater within defined area.

• Borehole Location




Source: State of California Seismic Hazards Map, Yorba Linda Quadrangle


HISTORICAL GROUNDWATER PROPOSED IN-N-OUT BURGER RESTAURANT 18181 IMPERIAL HIGHWAY YORBA LINDA, CALIFORNIA	Scale: NTS	Date: May, 2018	
	Drawn by: JP	Approved by: JK	
	Project No. 112-1804y	Figure No. 4	

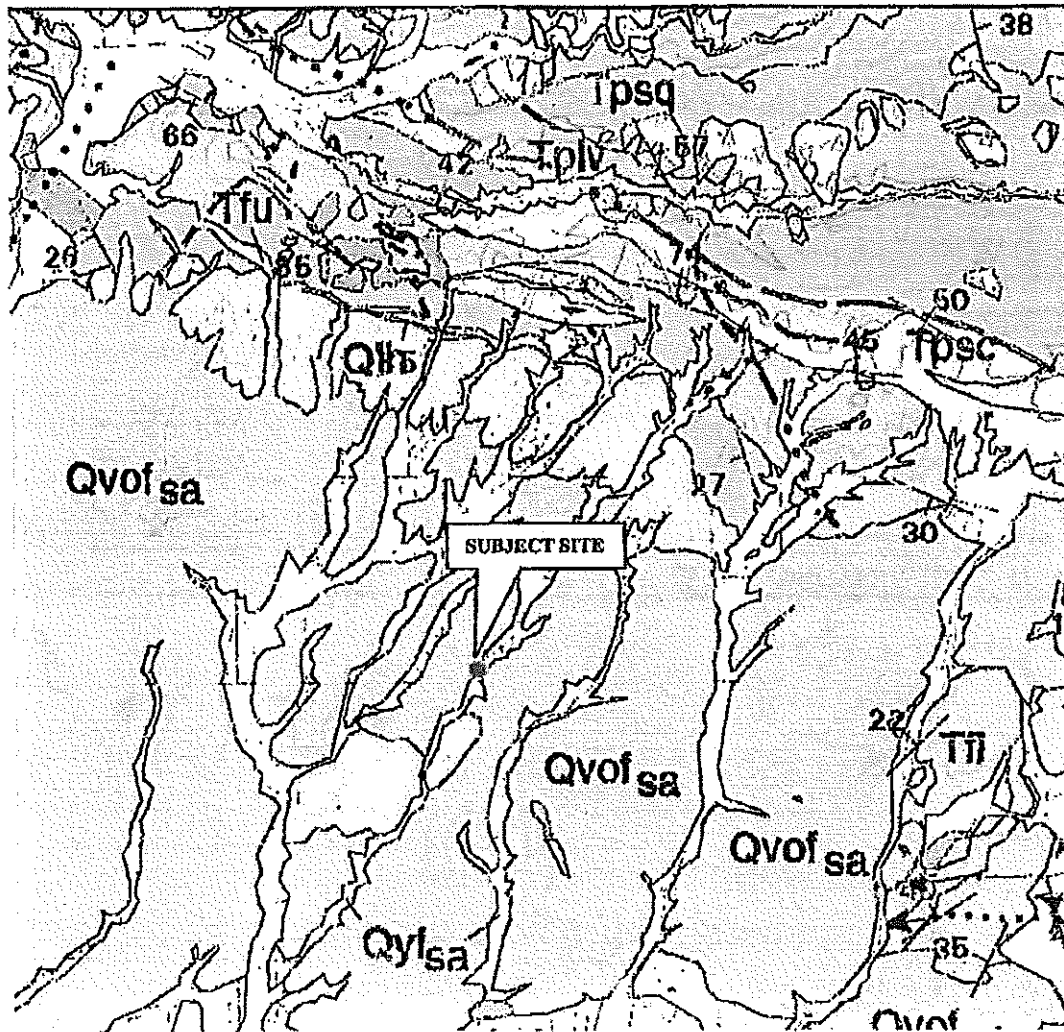

- Qvof** Very old alluvial fan deposits (middle to early Pleistocene)—Sandy alluvium; reddish-brown, well-indurated, fan surfaces well-dissected. Includes:
- Qyl** Young alluvial fan deposits (Holocene and late Pleistocene)—Gravel, sand, and silt. mixtures. some contain boulders; unconsolidated. Includes:



Source: USGS Geologic Map of the Santa Ana 60' Quadrangle, Southern California

GEOLOGIC MAP	Scale: NTS	Date: March 2018	
PROPOSED IN-N-OUT BURGER RESTAURANT	Drawn by: SK	Approved by: JK	
18181 IMPERIAL HIGHWAY YORBA LINDA, CALIFORNIA	Project No. 112-18047	Figure No. 5	

Log of Borings
&
Laboratory Testing

Appendix A

APPENDIX A

FIELD AND LABORATORY INVESTIGATIONS

Field Investigation

Our field investigation consisted of a surface reconnaissance and a subsurface exploration program consisted of drilling, logging and sampling a total of six (6) borings. The depth of exploration was approximately 10 to 20 feet below the existing site surface.

A member of our staff visually classified the soils in the field as the drilling progressed and recorded a continuous log of each boring. Visual classification of the soils encountered in our exploratory borings was made in general accordance with the Unified Soil Classification System (ASTM D2487). A key for the classification of the soil and the boring logs are presented in this Appendix.

During drilling operations, penetration tests were performed at regular intervals to evaluate the soil consistency and to obtain information regarding the engineering properties of the subsoils. Samples were obtained from the borings by driving either a 2.5-inch inside diameter Modified California tube sampler fitted with brass sleeves or a 2-inch outside diameter, 1-3/8-inch inside diameter Standard Penetration ("split-spoon") test (SPT) sampler without sleeves. Soil samples were retained for possible laboratory testing. The samplers were driven up to a depth of 18 inches into the underlying soil using a 140-pound hammer falling 30 inches. The number of blows required to drive the sampler was recorded for each 6-inch penetration interval and the number of blows required to drive the sampler the last 12 inches are shown as blows per foot on the boring logs.

The approximate locations of our borings and bulk samples are shown on the Site Plan, Figure 2. These approximate locations were estimated in the field based on pacing and measuring from the limits of existing site features.

Laboratory Investigation

The laboratory investigation was programmed to determine the physical and mechanical properties of the soil underlying the site. The laboratory-testing program was formulated with emphasis on the evaluation of in-situ moisture, density, gradation, shear strength, consolidation potential, and R-Value of the materials encountered. In addition, chemical tests were performed to evaluate the soil/cement reactivity and corrosivity. Test results were used in our engineering analysis with respect to site and building pad preparation through mass grading activities, foundation and retaining wall design recommendations, pavement section design, evaluation of the materials as possible fill materials and for possible exclusion of some soils from use at the structures as fill or backfill.


Select laboratory test results are presented on the boring logs, with graphic or tabulated results of selected tests included in this Appendix. The laboratory test data, along with the field observations, was used to prepare the final boring logs presented in the Appendix.

UNIFIED SOIL CLASSIFICATION SYSTEM

UNIFIED SOIL CLASSIFICATION AND SYMBOL CHART			
COARSE-GRAINED SOILS (more than 50% of material is larger than No. 200 sieve size.)			
GRAVELS More than 50% of coarse fraction larger than No. 4 sieve size	Clean Gravels (Less than 5% fines)		
		GW	Well-graded gravels, gravel-sand mixtures, little or no fines
		GP	Poorly-graded gravels, gravel-sand mixtures, little or no fines
	Gravels with fines (More than 12% fines)		
		GM	Silty gravels, gravel-sand-silt mixtures
		GC	Clayey gravels, gravel-sand-clay mixtures
SANDS 50% or more of coarse fraction smaller than No. 4 sieve size	Clean Sands (Less than 5% fines)		
		SW	Well-graded sands, gravelly sands, little or no fines
		SP	Poorly graded sands, gravelly sands, little or no fines
	Sands with fines (More than 12% fines)		
		SM	Silty sands, sand-silt mixtures
		SC	Clayey sands, sand-clay mixtures
FINE-GRAINED SOILS (50% or more of material is smaller than No. 200 sieve size.)			
SILTS AND CLAYS Liquid limit less than 50%		ML	Inorganic silts and very fine sands, rock flour, silty of clayey fine sands or clayey silts with slight plasticity
		CL	Inorganic clays of low to medium plasticity, gravelly clays, sandy clays, silty clays, lean clays
		OL	Organic silts and organic silty clays of low plasticity
SILTS AND CLAYS Liquid limit 50% or greater		MH	Inorganic silts, micaceous or diatomaceous fine sandy or silty soils, elastic silts
		CH	Inorganic clays of high plasticity, fat clays
		OH	Organic clays of medium to high plasticity, organic silts
HIGHLY ORGANIC SOILS		PT	Peat and other highly organic soils

CONSISTENCY CLASSIFICATION	
Description	Blows per Foot
<i>Granular Soils</i>	
Very Loose	< 5
Loose	5 - 15
Medium Dense	16 - 40
Dense	41 - 65
Very Dense	> 65
<i>Cohesive Soils</i>	
Very Soft	< 3
Soft	3 - 5
Firm	6 - 10
Stiff	11 - 20
Very Stiff	21 - 40
Hard	> 40

GRAIN SIZE CLASSIFICATION		
Grain Type	Standard Sieve Size	Grain Size in Millimeters
Boulders	Above 12 inches	Above 305
Cobbles	3 to 12 inches	305 to 76.2
Gravel	3 inches to No. 4	76.2 to 4.76
Coarse-grained	3 to ¾ inches	76.2 to 19.1
Fine-grained	¾ inches to No. 4	19.1 to 4.76
Sand	No. 4 to No. 200	4.76 to 0.074
Coarse-grained	No. 4 to No. 10	4.76 to 2.00
Medium-grained	No. 10 to No. 40	2.00 to 0.042
Fine-grained	No. 40 to No. 200	0.042 to 0.074
Silt and Clay	Below No. 200	Below 0.074

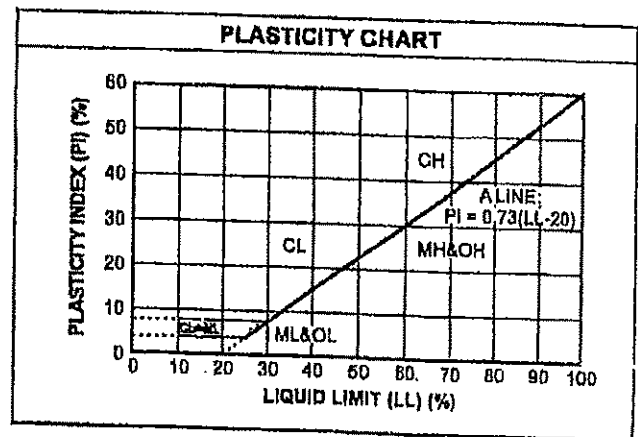

Log of Boring B1

Project: In-N-Out Restaurant

Project No: 112-18042

Client: In-N-Out Burger

Figure No.: A-1

Location: 815 N. Bristol, Santa Ana, CA

Logged By: Jorge Pelayo

Depth to Water> Not Encountered

Initial: N/A

At Completion: N/A

SUBSURFACE PROFILE			SAMPLE				Penetration Test blows/ft	Water Content (%)
Depth (ft)	Symbol	Description	Dry Density (pcf)	Moisture (%)	Type	Blows/ft.		
0		Ground Surface					20 40 60	10 20 30 40
0		SILTY SAND (SM) Medium dense, fine-grained; dark brown, damp						
2								
4								
6			102.5	4.5		20		
8								
10		GRAVEL-SAND MIXTURES (GP) Medium dense, coarse- to medium-grained; brown, dry	119.4	2.1		16		
12								
14		CLAYEY SILT (ML) Stiff, fine-grained; dark brown, moist		21.1		10		
16								
18								
20								

Drill Method: Hollow Stem

Drill Date: 4-3-18

Drill Rig: CME 75

Krazan and Associates

Hole Size: 5½ Inches

Driller: Baja Exploration

Elevation: 50 Feet

Sheet: 1 of 3

Log of Boring B1

Project: In-N-Out Restaurant

Project No: 112-18042

Client: In-N-Out Burger

Figure No.: A-1

Location: 815 N. Bristol, Santa Ana, CA

Logged By: Jorge Pelayo

Depth to Water> Not Encountered

Initial: N/A

At Completion: N/A

SUBSURFACE PROFILE			SAMPLE				Penetration Test blows/ft	Water Content (%)			
Depth (ft)	Symbol	Description	Dry Density (pcf)	Moisture (%)	Type	Blows/ft.		10	20	30	40
22		SANDY SILT (ML) Stiff, fine-grained with trace CLAY; dark brown, moist		17.2		11					
24											
26				20.0		9					
28		CLAYEY SILT (ML) Medium stiff to stiff; fine-grained; dark brown, moist									
30				21.1		8					
32											
34		SILTY SAND (SM) Medium dense, fine-grained; dark brown, moist									
36				19.6		11					
38											
40											

Drill Method: Hollow Stem

Drill Date: 4-3-18

Drill Rig: CME 75

Krazan and Associates

Hole Size: 5½ Inches

Driller: Baja Exploration

Elevation: 50 Feet

Sheet: 2 of 3

Log of Boring B1

Project: In-N-Out Restaurant

Project No: 112-18042

Client: In-N-Out Burger

Figure No.: A-1

Location: 815 N. Bristol, Santa Ana, CA

Logged By: Jorge Pelayo

Depth to Water> Not Encountered

Initial: N/A

At Completion: N/A

SUBSURFACE PROFILE			SAMPLE				Penetration Test blows/ft	Water Content (%)
Depth (ft)	Symbol	Description	Dry Density (pcf)	Moisture (%)	Type	Blows/ft.		
42				17.2		19		
44		SILTY CLAY (CL) Stiff, fine-grained with SAND; dark brown, very moist						
46				18.4		43		
48								
50				23.2		12		
52		End of Borehole						
54								
56		No water encountered Boring backfilled with soil cuttings						
58								
60								

Drill Method: Hollow Stem

Drill Date: 4-3-18

Drill Rig: CME 75

Krazan and Associates

Hole Size: 5½ Inches

Driller: Baja Exploration

Elevation: 50 Feet

Sheet: 3 of 3

Log of Boring B2

Project: In-N-Out Restaurant

Project No: 112-18042

Client: In-N-Out Burger

Figuro No.: A-2

Location: 815 N. Bristol, Santa Ana, CA

Logged By: Jorge Pelayo

Depth to Water> Not Encountered

Initial: N/A

At Completion: N/A

SUBSURFACE PROFILE			SAMPLE				Penetration Test blows/ft	Water Content (%)
Depth (ft)	Symbol	Description	Dry Density (pcf)	Moisture (%)	Type	Blows/ft.		
		Ground Surface					20 40 60	10 20 30 40
0		SILTY SAND (SM) Medium dense, fine-grained; dark brown, dry						
2								
4								
6			121.4	3.7		31		
8		GRAVEL-SAND MIXTURES (GP) Medium dense, coarse- to medium-grained; light brown, dry						
10			121.1	1.7		21		
12								
14		CLAYEY SILT (ML) Medium stiff to stiff; fine-grained; dark brown, moist						
16				15.3		7		
18								
20		No water encountered Boring backfilled with soil cuttings		15.8		14		

Drill Method: Hollow Stem

Drill Date: 4-3-18

Drill Rig: CME 75

Krazan and Associates

Hole Size: 5½ Inches

Driller: Baja Exploration

Elevation: 20 Feet

Sheet: 1 of 1

Log of Boring B3

Project: In-N-Out Restaurant

Project No: 112-18042

Client: In-N-Out Burger

Figure No.: A-3





Location: 815 N. Bristol, Santa Ana, CA

Logged By: Jorge Pelayo

Depth to Water> Not Encountered

Initial: N/A

At Completion: N/A

SUBSURFACE PROFILE			SAMPLE				Penetration Test blows/ft			Water Content (%)				
Depth (ft)	Symbol	Description	Dry Density (pcf)	Moisture (%)	Type	Blows/ft.								
0		Ground Surface						20	40	60	10	20	30	40
		CLAYEY SILT (ML) FILL - Very stiff; fine-grained; dark brown, moist												
2														
4														
6				103.0	12.5		24							
8														
	SILTY SAND (SM) Medium dense, fine-grained; dark brown, damp													
10			101.2	4.4		28								
		End of Borehole												
12														
14														
16														
18														
20		No water encountered Boring backfilled with soil cuttings												

Drill Method: Hollow Stem

Drill Date: 4-3-18

Drill Rig: CME 75

Krazan and Associates

Hole Size: 5½ Inches

Driller: Baja Exploration

Elevation: 10 Feet

Sheet: 1 of 1

Log of Boring B4

Project: In-N-Out Restaurant

Client: In-N-Out Burger

Location: 815 N. Bristol, Santa Ana, CA

Depth to Water: Not Encountered

Initial: N/A

Project No: 112-18042

Figure No.: A-4

Logged By: Jorge Pelayo

At Completion: N/A

SUBSURFACE PROFILE			SAMPLE				Penetration Test blows/ft	Water Content (%)			
Depth (ft)	Symbol	Description	Dry Density (pcf)	Moisture (%)	Type	Blows/ft.					
0		Ground Surface					20 40 60	10 20 30 40			
0		SILTY SAND (SM) Medium dense, fine-grained; dark brown to brown, damp									
2											
4											
6			116.2	5.3		17					
8											
10		GRAVEL-SAND MIXTURES (GP) Medium dense, coarse- to medium-grained; light brown, dry	107.9	1.9		29					
12											
14		CLAYEY SILT (ML) Very stiff; fine-grained; brown, moist									
16				9.4		16					
18											
20		No water encountered Boring backfilled with soil cuttings		11.1		19					

Drill Method: Hollow Stem

Drill Rig: CME 75

Driller: Baja Exploration

Krazan and Associates

Drill Date: 4-3-18

Hole Size: 5½ Inches

Elevation: 20 Feet

Sheet: 1 of 1

Log of Boring B5

Project: In-N-Out Restaurant

Project No: 112-18042

Client: In-N-Out Burger

Figure No.: A-5

Location: 815 N. Bristol, Santa Ana, CA

Logged By: Jorge Pelayo

Depth to Water> Not Encountered

Initial: N/A

At Completion: N/A

SUBSURFACE PROFILE			SAMPLE				Penetration Test blows/ft	Water Content (%)			
Depth (ft)	Symbol	Description	Dry Density (pcf)	Moisture (%)	Type	Blows/ft.					
		Ground Surface					20 40 60	10	20	30	40
0		SILTY SAND (SM) Medium dense, fine-grained; dark brown, moist									
2											
4											
6			114.7	10.6		15					
8		GRAVEL-SAND MIXTURES (GP) Medium dense, coarse- to medium-grained; light brown, moist									
10			107.8	9.5		17					
12											
14		CLAYEY SILT (ML) Stiff to very stiff; fine-grained; dark brown, moist									
16				14.2		9					
18											
20		No water encountered Boring backfilled with soil cuttings		16.3		16					

Drill Method: Hollow Stem

Drill Date: 4-3-18

Drill Rig: CME 75

Krazan and Associates

Hole Size: 5½ Inches

Driller: Baja Exploration

Elevation: 20 Feet

Sheet: 1 of 1

Log of Boring B6

Project: In-N-Out Restaurant

Project No: 112-18042

Client: In-N-Out Burger

Figure No.: A-6





Location: 815 N. Bristol, Santa Ana, CA

Logged By: Jorge Pelayo

Depth to Water: Not Encountered

Initial: N/A

At Completion: N/A

SUBSURFACE PROFILE			SAMPLE				Penetration Test blows/ft	Water Content (%)					
Depth (ft)	Symbol	Description	Dry Density (pcf)	Moisture (%)	Type	Blows/ft.							
								20	40	60	10	20	30
0		Ground Surface											
0		SILTY SAND (SM) Medium dense, fine-grained; dark brown, moist											
2													
4													
6			105.3	7.2		17							
8		GRAVEL-SAND MIXTURES (GP) Medium dense, coarse- to medium-grained; light brown, damp											
10			116.7	6.3		25							
10		End of Borehole											
12													
14													
16													
18													
20		No water encountered Boring backfilled with soil cuttings											

Drill Method: Hollow Stem

Drill Date: 4-3-18

Drill Rig: CME 75

Krazan and Associates

Hole Size: 5½ inches

Driller: Baja Exploration

Elevation: 10 Feet

Sheet: 1 of 1


Sieve Analysis

Project Number : 11218047
 Project Name : INO Yorba Linda
 Date : 5/9/2018
 Sample Location : B-2 @ 5'
 Soil Classification : SM

Wet Weight	:	415.60
Dry Weight	:	415.60
Moisture Content	:	0%

Sieves Size/Number	Sieve Size, mm	Retained Weight	Retained. %	Cum. % Retained	Cum. % Passing.
1-1/2"	37.50				100.0
1"	25.00				100.0
3/4"	19.00				100.0
1/2"	12.50				100.0
3/8"	9.50	5.0	1.2	1.2	98.8
#4	4.75	17.7	4.3	5.5	94.5
#8	2.36	13.0	3.1	8.6	91.4
#16	1.18	20.2	4.9	13.5	86.5
#30	0.60	26.7	6.4	19.9	80.1
#50	0.30	34.9	8.4	28.3	71.7
#100	0.15	57.8	13.9	42.2	57.8
#200	0.08	89.6	21.6	63.7	36.3

Grain Size Analysis

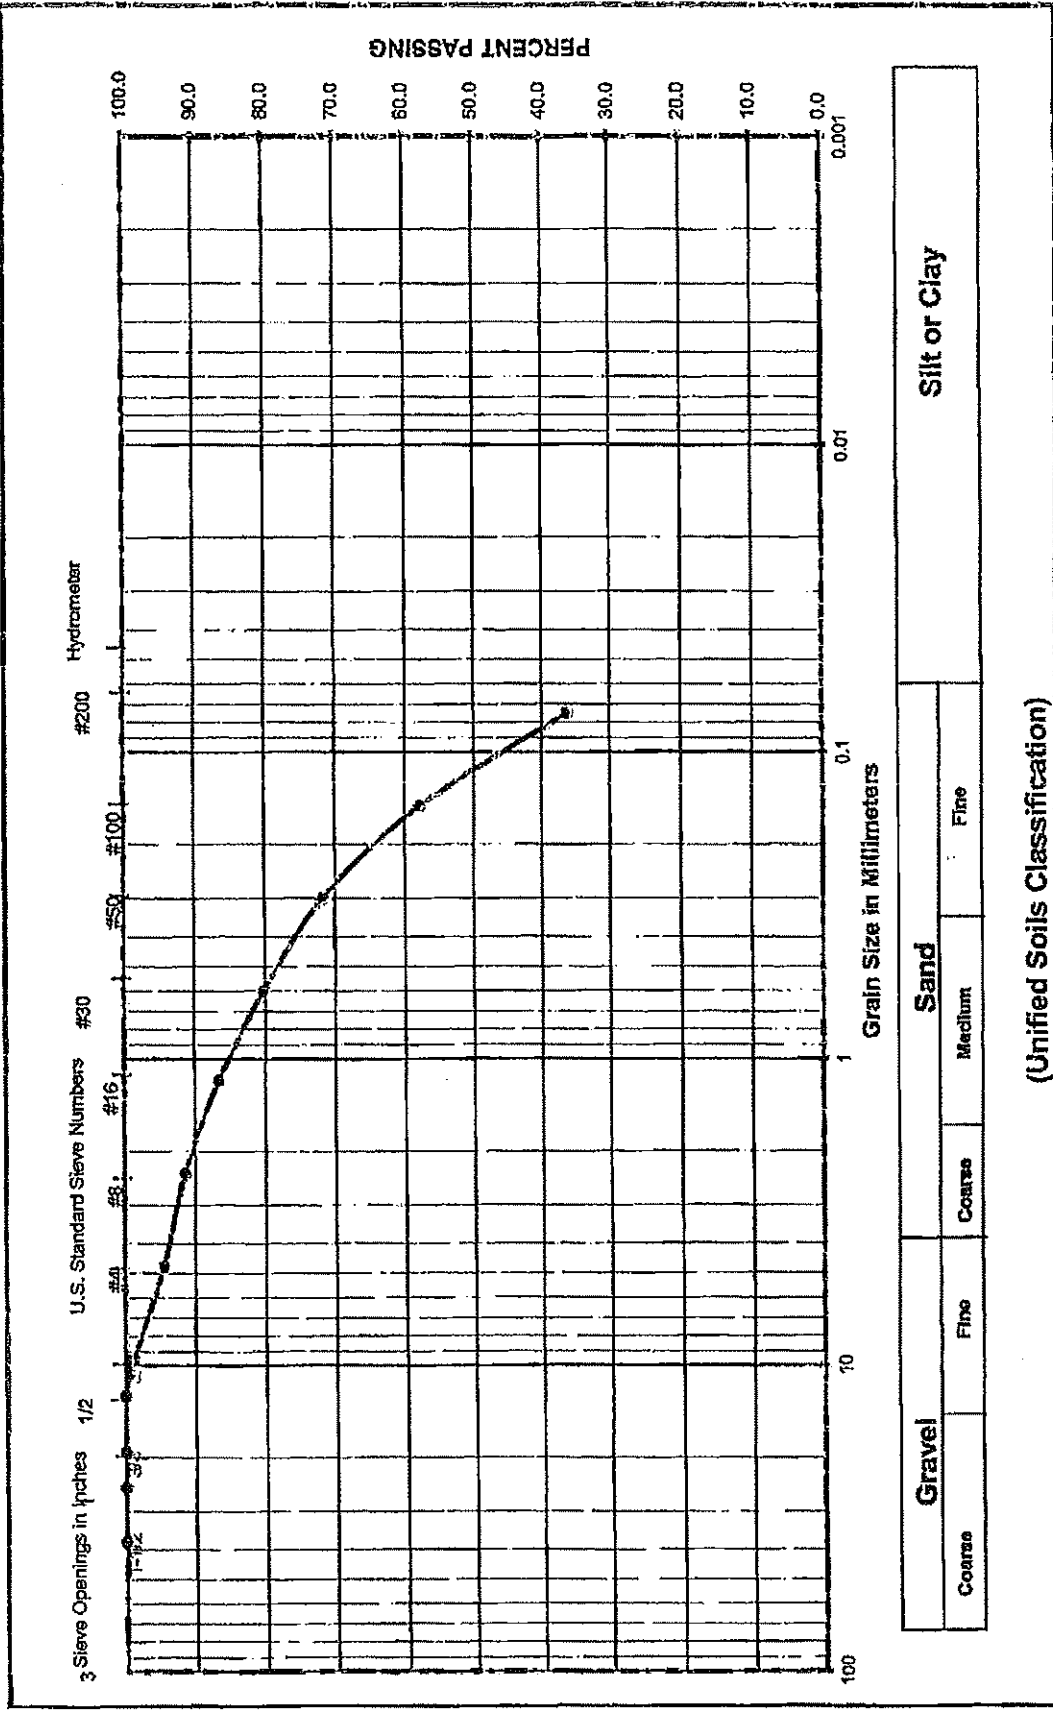

(Unified Soils Classification)

Gravel		Sand		Silt or Clay	
Coarse	Fine	Coarse	Fine		

Project Name: INO Yorba Linda
 Project Number: 11218047
 Soil Classification: SM
 Sample Number: B-2 @ 5'


Sieve Analysis

Project Number : 11218047
 Project Name : INO Yorba Linda
 Date : 5/9/2018
 Sample Location : B-2 @ 10'
 Soil Classification : SM / gravel

Wet Weight	:	485.40
Dry Weight	:	485.40
Moisture Content	:	0%

Sieves Size/Number	Sieve Size, mm	Retained Weight	Retained. %	Cum % Retained	Cum. % Passing.
1-1/2"	37.50				100.0
1"	25.00				100.0
3/4"	19.00	13.6	2.8	2.8	97.2
1/2"	12.50	0.1	0.0	2.8	97.2
3/8"	9.50	0.1	0.0	2.8	97.2
#4	4.75	0.1	0.0	2.9	97.1
#8	2.36	4.0	0.8	3.7	96.3
#16	1.18	14.3	2.9	6.6	93.4
#30	0.60	29.6	6.1	12.7	87.3
#50	0.30	59.3	12.2	24.9	75.1
#100	0.15	64.1	13.2	38.2	61.8
#200	0.08	96.1	19.8	58.0	42.0

Grain Size Analysis

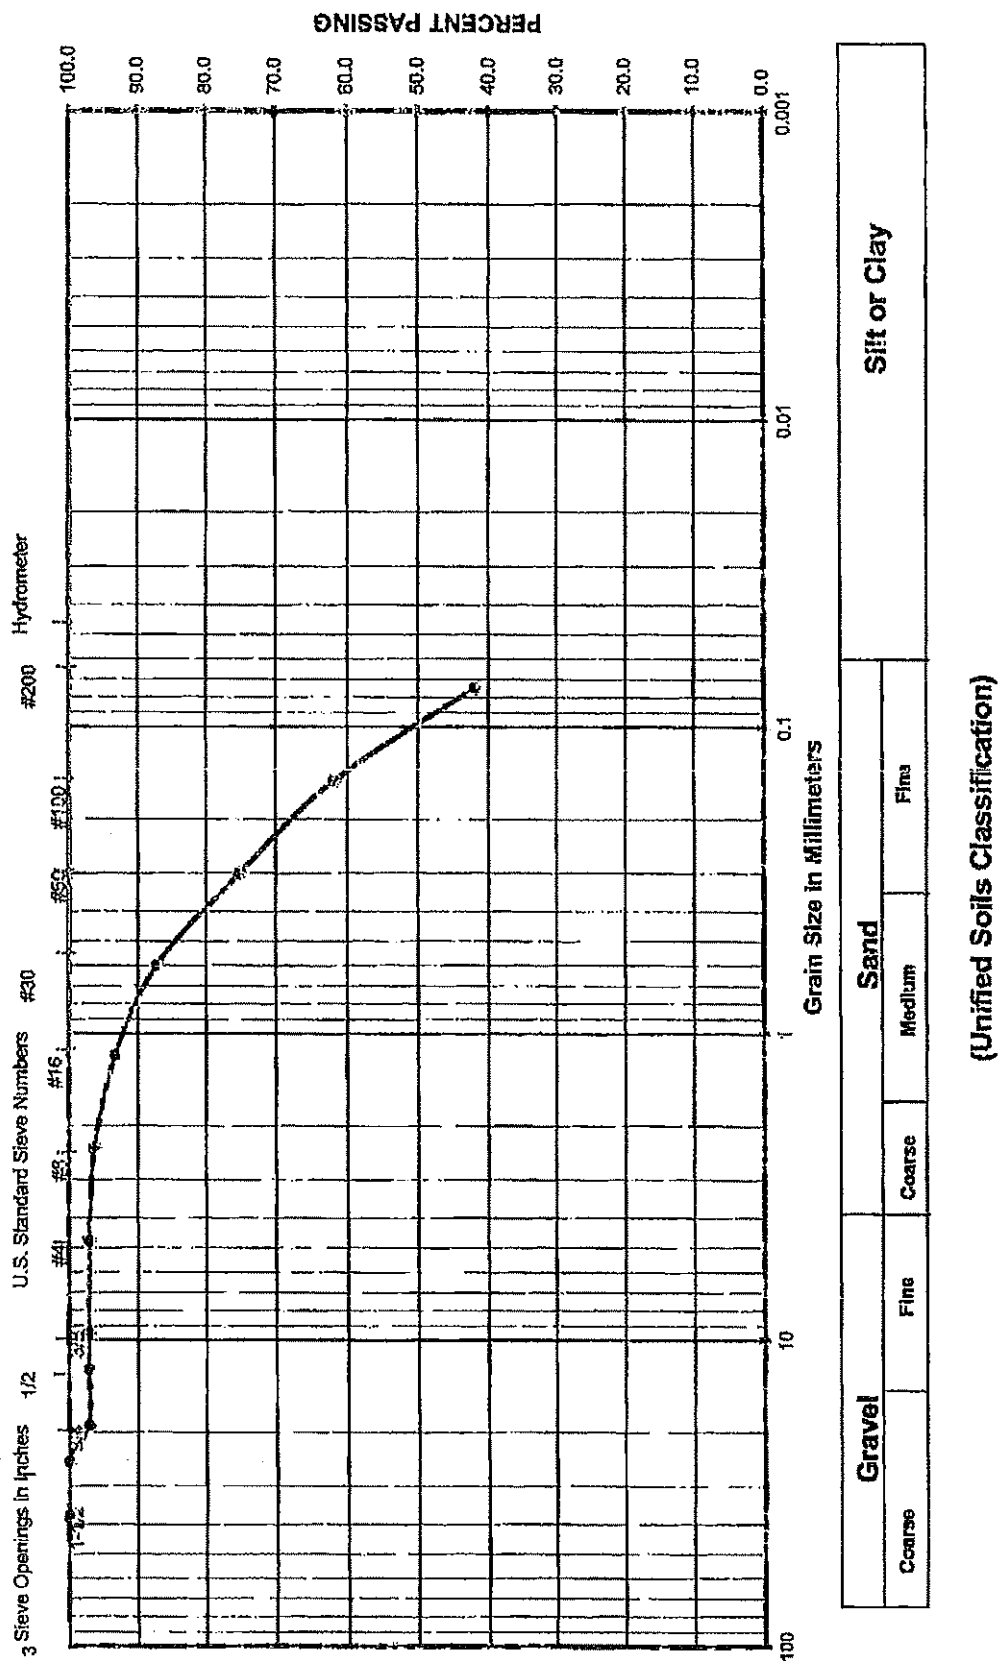

Project Name INO Yorba Linda
 Project Number 11218047
 Soil Classification SM / gravel
 Sample Number B-2 @ 10'


Sieve Analysis

Project Number : 11218047
 Project Name : INO Yorba Linda
 Date : 5/9/2018
 Sample Location : B-2 @ 15'
 Soil Classification : ML

Wet Weight	:	497.40
Dry Weight	:	497.40
Moisture Content	:	0%

Sieves Size/Number	Sieve Size, mm	Retained Weight	Retained. %	Cum % Retained	Cum. % Passing.
1-1/2"	37.50				100.0
1"	25.00				100.0
3/4"	19.00				100.0
1/2"	12.50				100.0
3/8"	9.50				100.0
#4	4.75	1.9	0.4	0.4	99.6
#8	2.36	7.5	1.5	1.9	98.1
#16	1.18	15.3	3.1	5.0	95.0
#30	0.60	26.1	5.2	10.2	89.8
#50	0.30	47.8	9.6	19.8	80.2
#100	0.15	32.3	6.5	26.3	73.7
#200	0.08	110.0	22.1	48.4	51.6

Grain Size Analysis

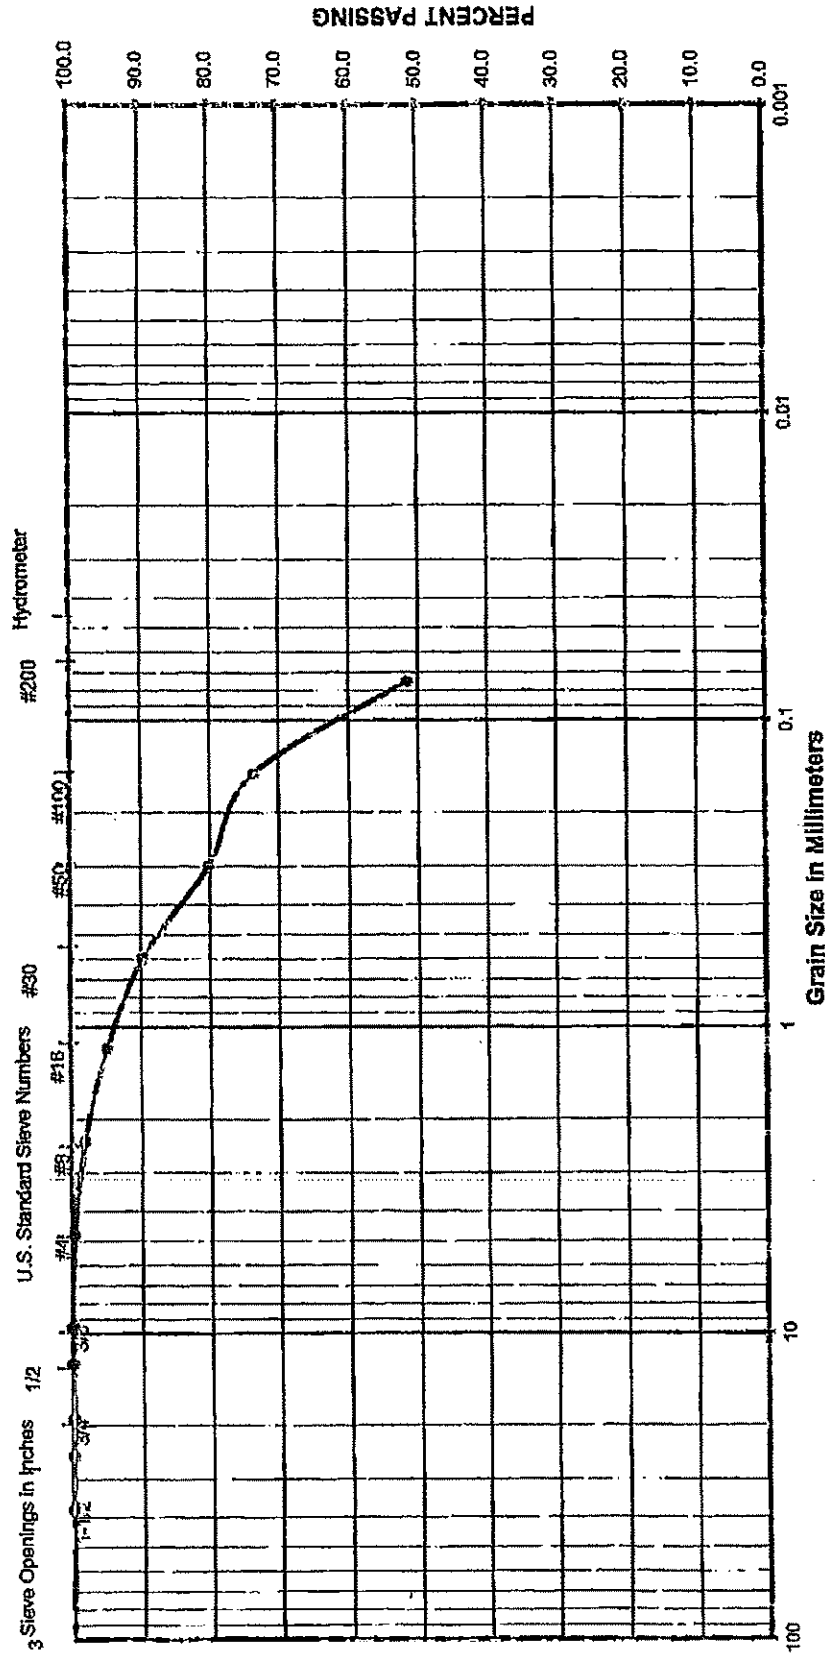


Sieve Analysis

Project Number : 11218047
 Project Name : INO Yorba Linda
 Date : 5/9/2018
 Sample Location : B-2 @ 20'
 Soil Classification : ML

Wet Weight	:	491.20
Dry Weight	:	491.20
Moisture Content	:	0%

Sieves Size/Number	Sieve Size, mm	Retained Weight	Retained. %	Cum % Retained	Cum. % Passing.
1-1/2"	37.50				100.0
1"	25.00				100.0
3/4"	19.00				100.0
1/2"	12.50				100.0
3/8"	9.50	9.8	2.0	2.0	98.0
#4	4.75	10.1	2.1	4.1	95.9
#8	2.36	10.9	2.2	6.3	93.7
#16	1.18	20.7	4.2	10.5	89.5
#30	0.60	28.7	5.8	16.3	83.7
#50	0.30	39.8	8.1	24.4	75.6
#100	0.15	26.5	5.4	29.8	70.2
#200	0.08	66.5	13.5	43.4	56.6

Grain Size Analysis

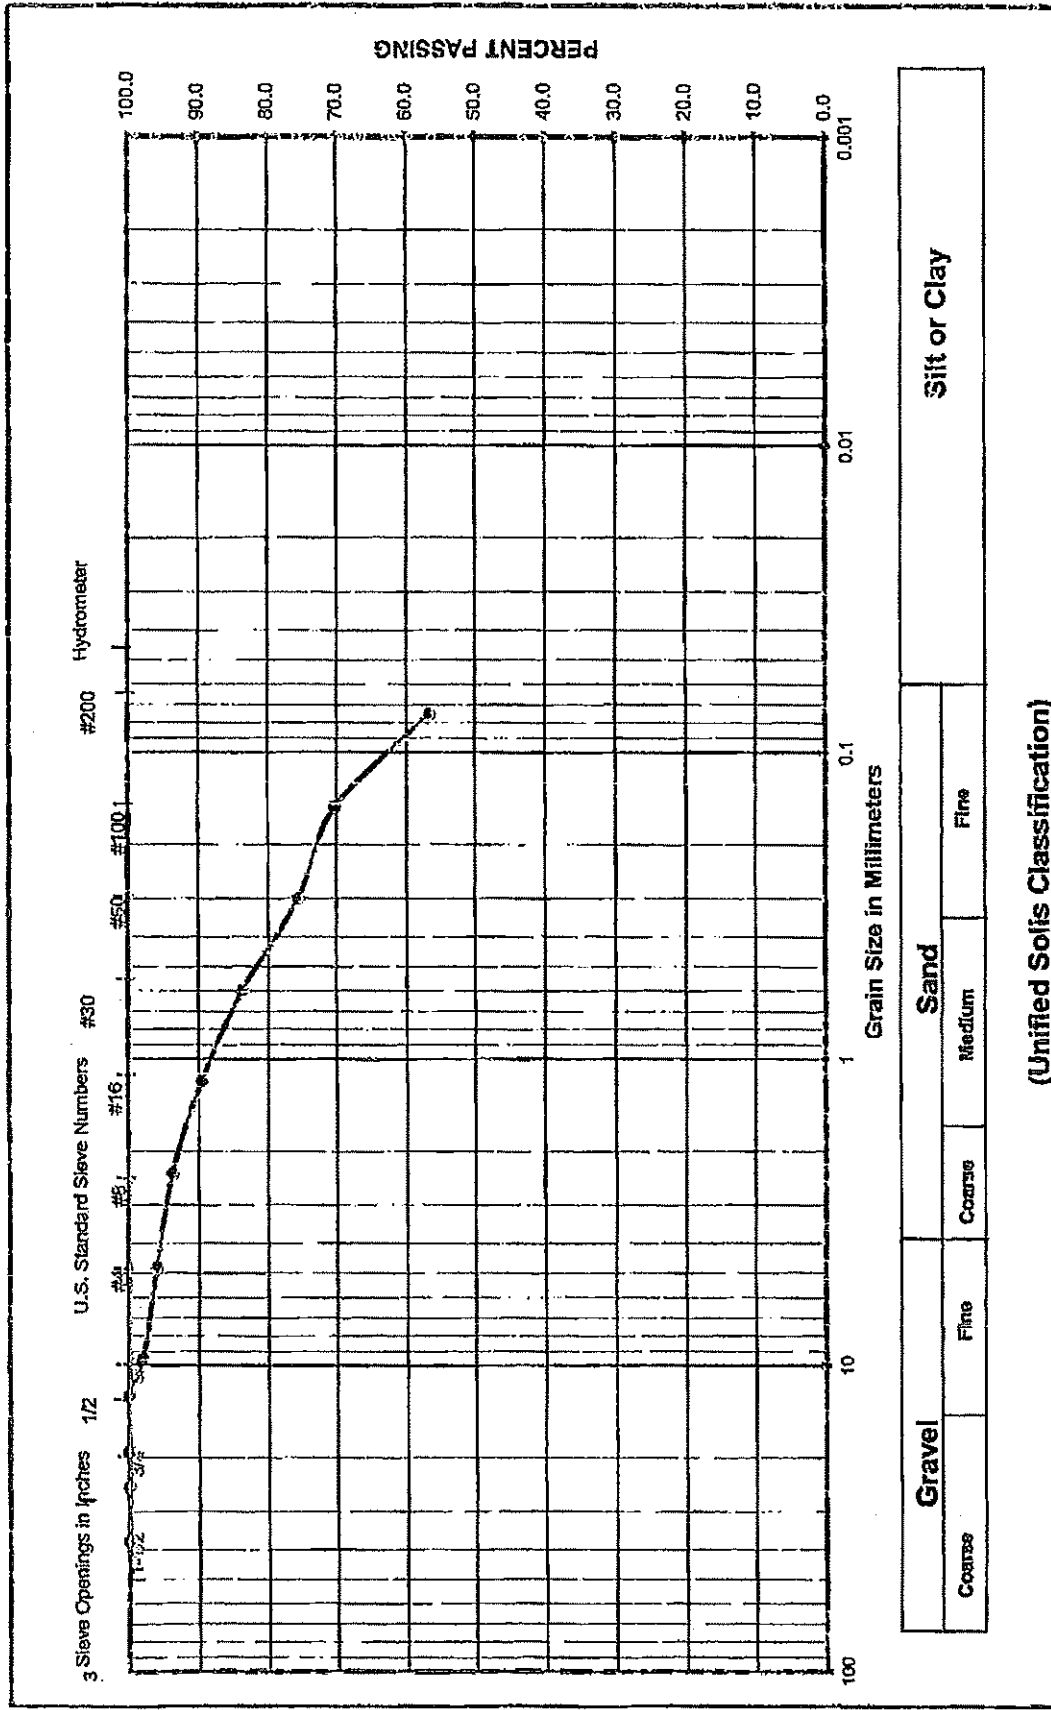


(Unified Soils Classification)

Project Name: INO Yorba Linda
 Project Number: 11218047
 Soil Classification: ML
 Sample Number: B-2 @ 20'

Shear Strength Diagram (Direct Shear)
ASTM D - 3080 / AASHTO T - 236


Project Number	Boring No. & Depth	Soil Type	Date
11218047	B-3 @ 5'	SM	5/9/2018

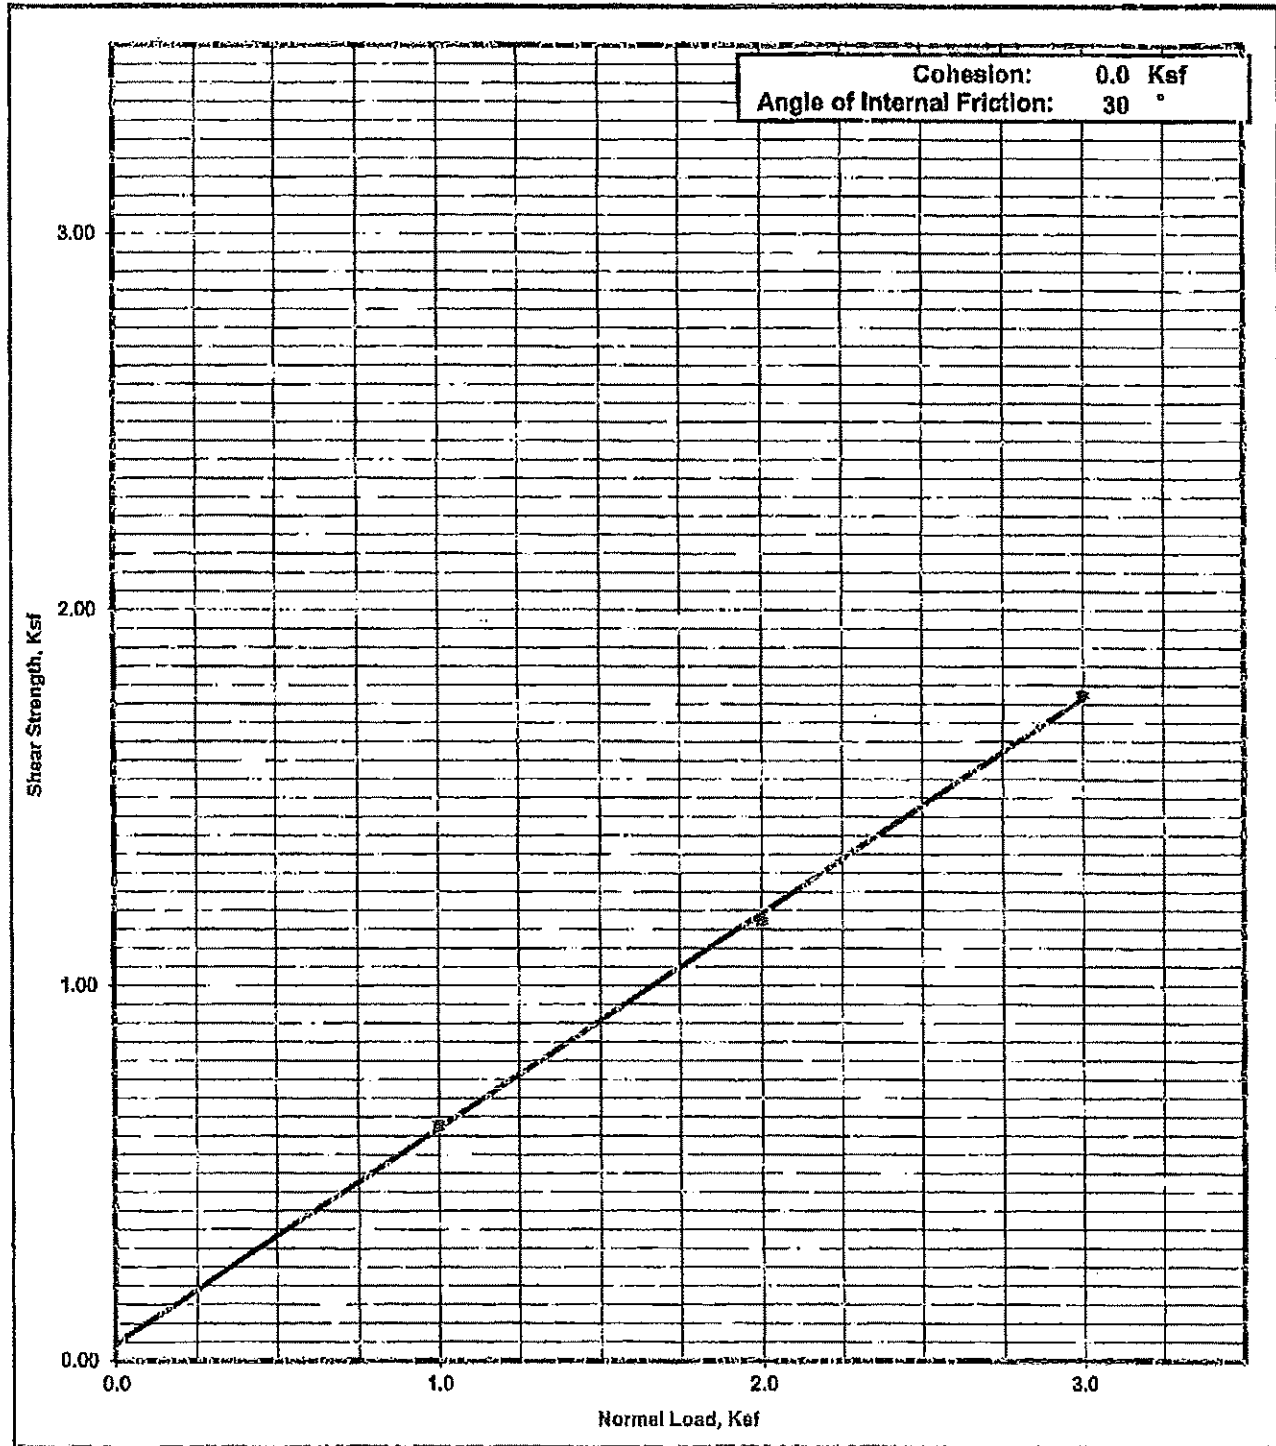

Krazan Testing Laboratory

Shear Strength Diagram (Direct Shear)
ASTM D - 3080 / AASHTO T - 236


Project Number	Boring No. & Depth	Soil Type	Date
11218047	B-6 @ 5'	SM	5/9/2018

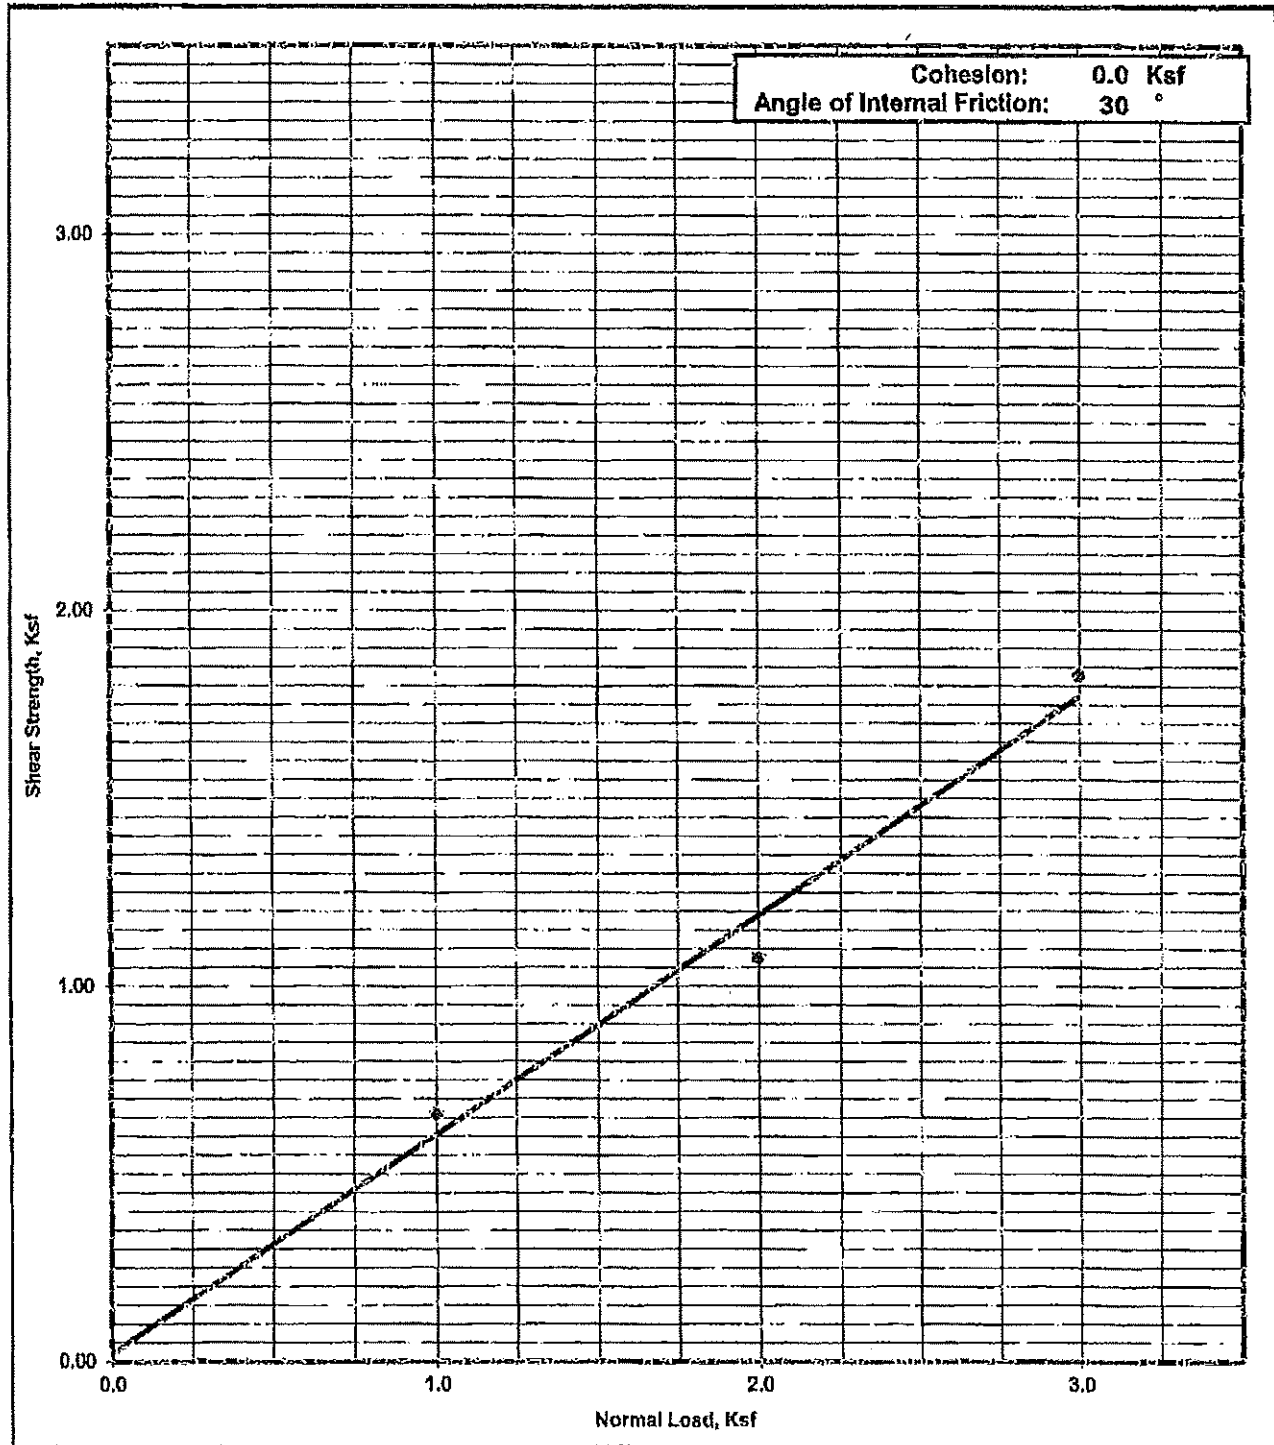

Krazan Testing Laboratory

Consolidation Test


Project No	Boring No. & Depth	Date	Soil Classification
11218047	B-3 @ 5'	5/9/2018	SM

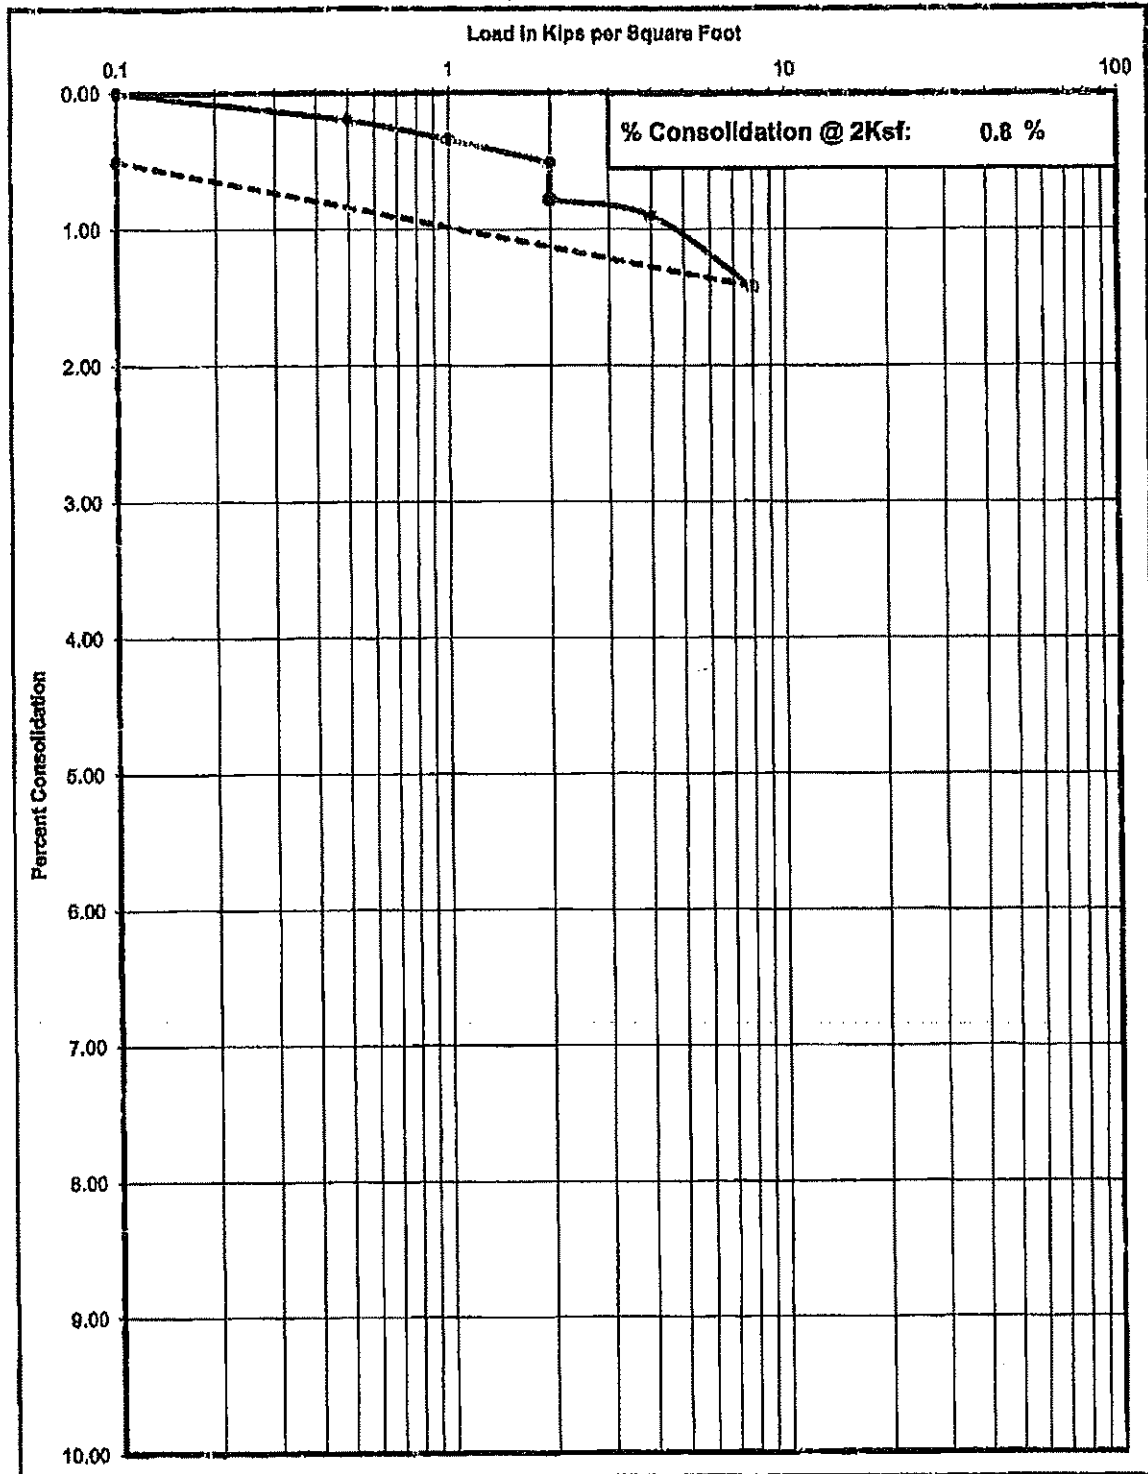

Krazan Testing Laboratory

Consolidation Test


Project No	Boring No. & Depth	Date	Soil Classification
11218047	B-3 @ 10'	5/9/2018	SM

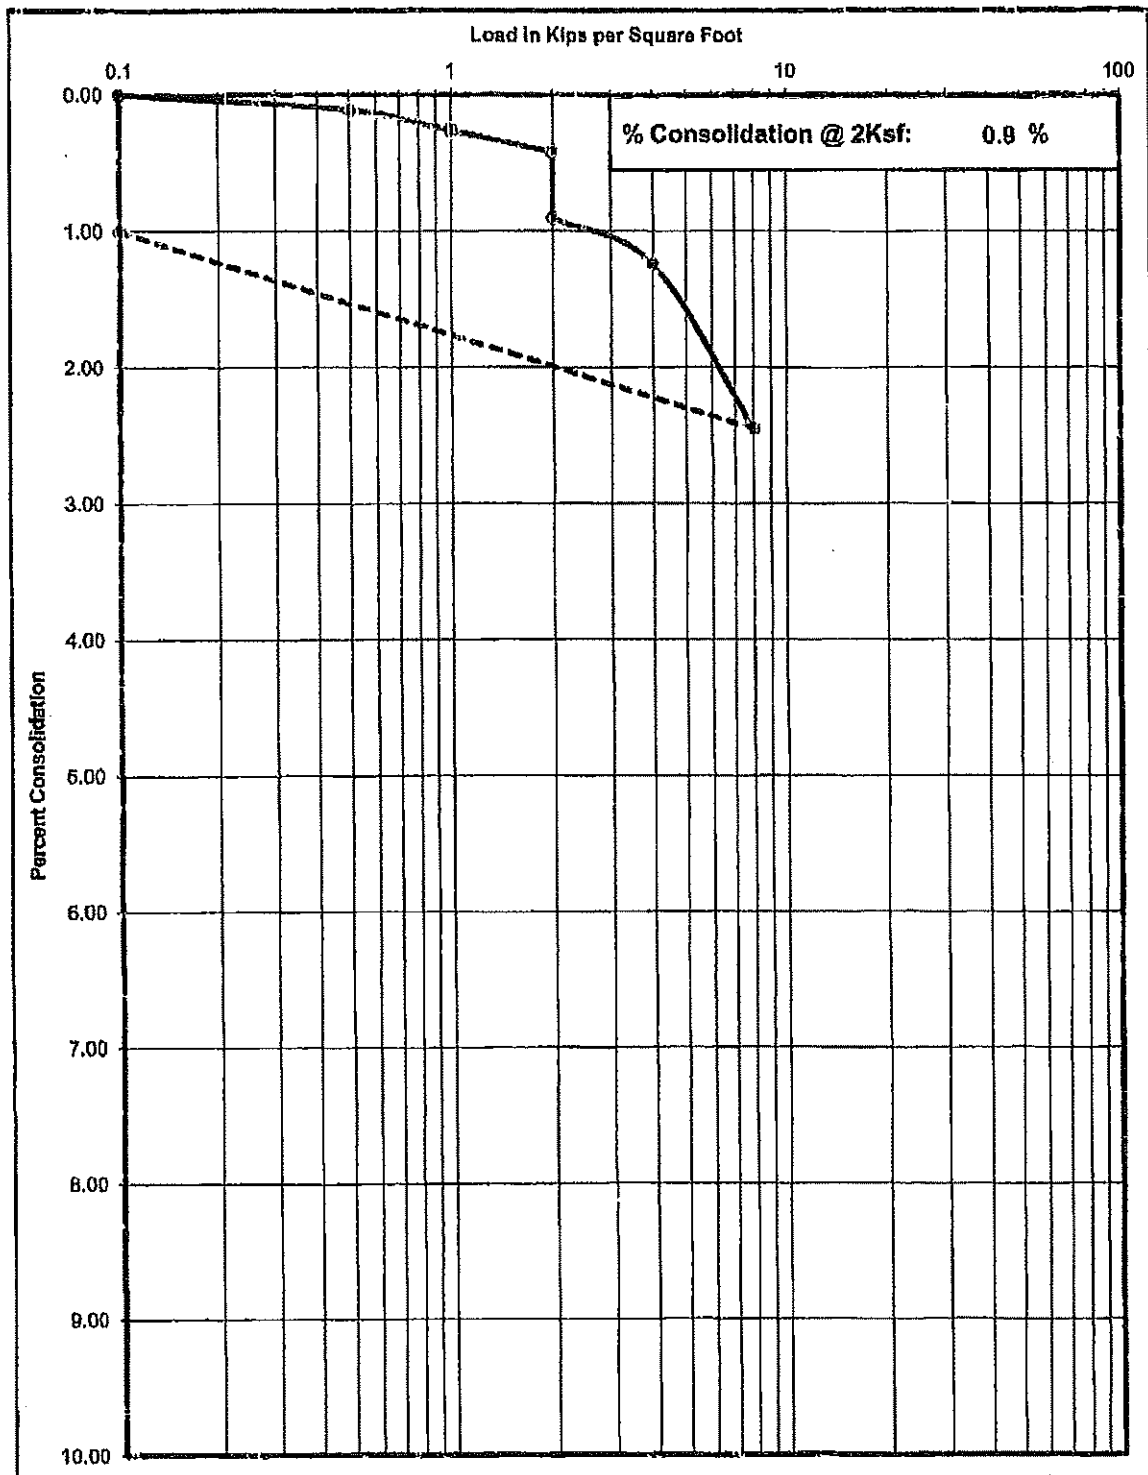

Krazan Testing Laboratory

Consolidation Test


Project No	Boring No. & Depth	Date	Soil Classification
11218047	B-4 @ 5'	5/9/2018	SM

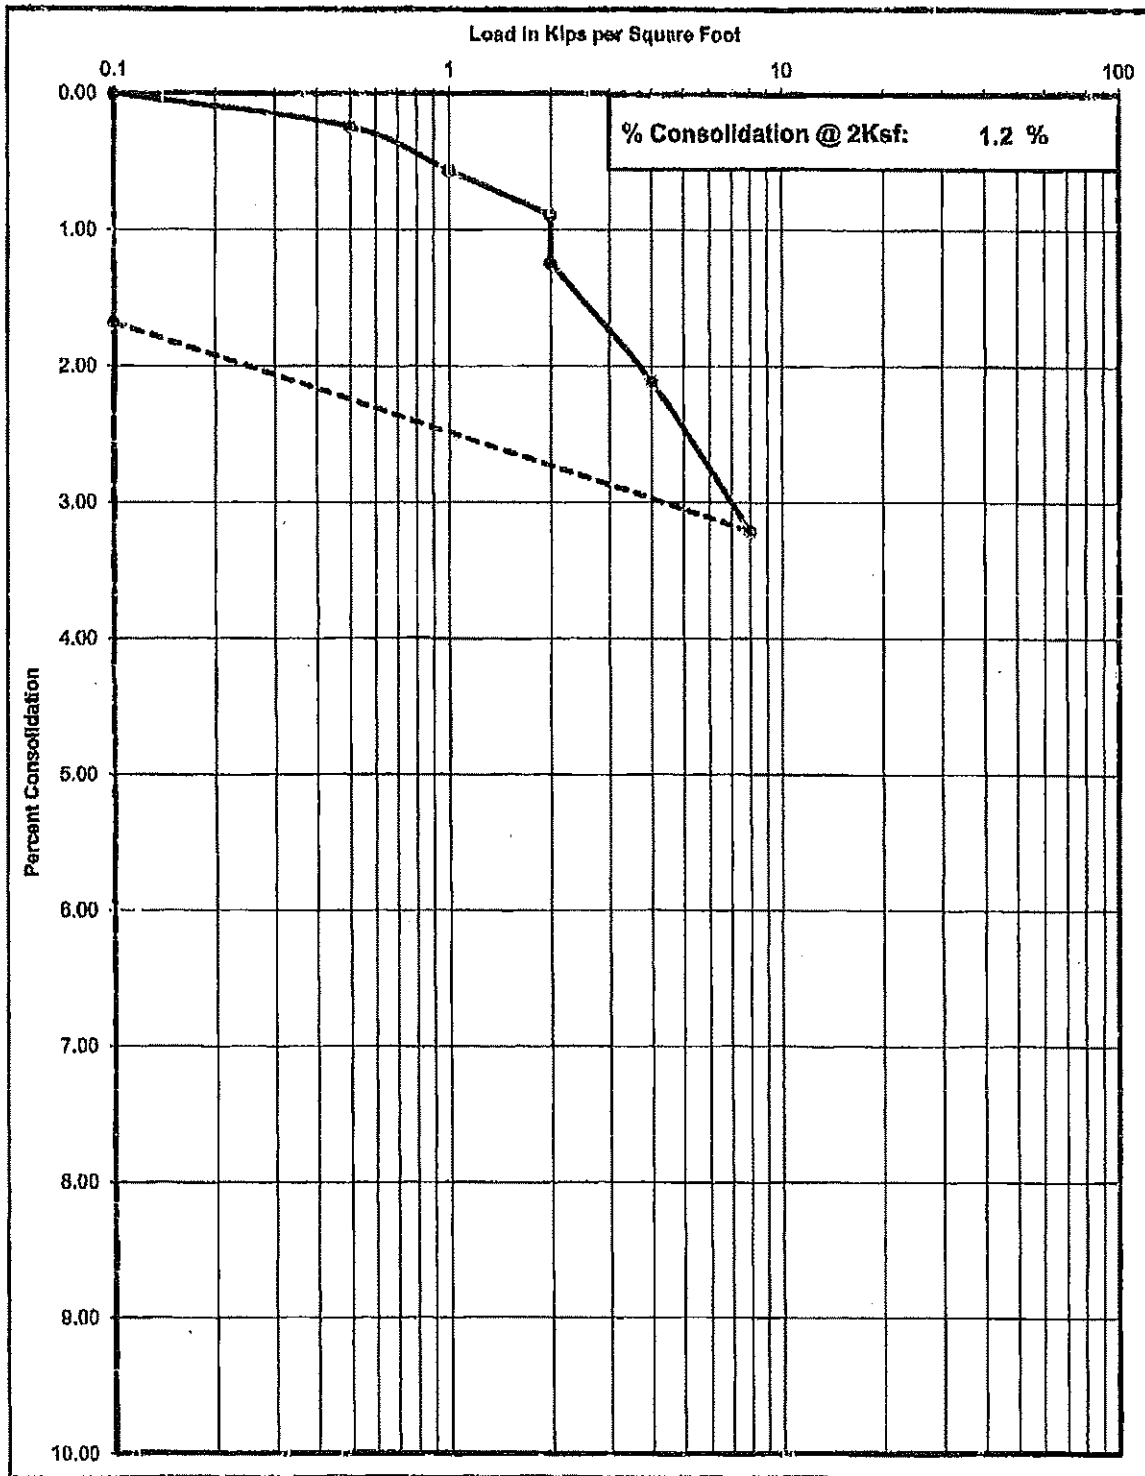

Krazan Testing Laboratory


Consolidation Test

Project No	Boring No. & Depth	Date	Soil Classification
11218047	B-4 @ 10'	5/9/2018	SM

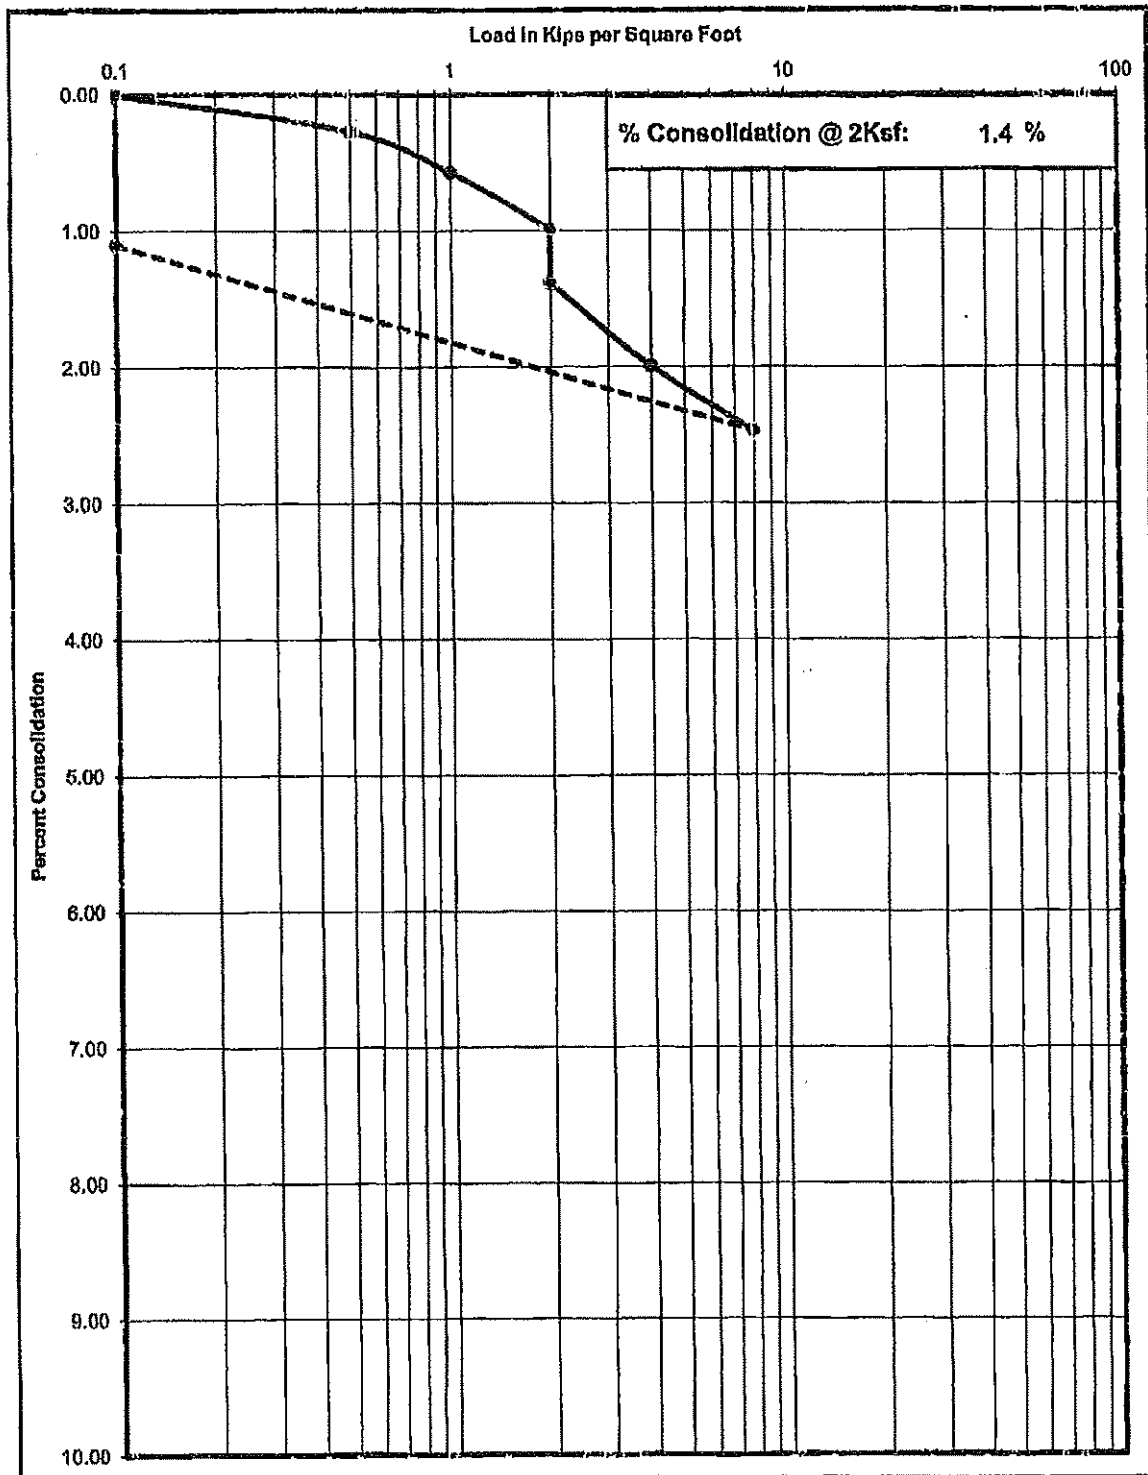

Krazan Testing Laboratory


RESULTS OF INFILTRATION TESTS - REVERSE BOREHOLE					
Project #	11218047	Date	5/9/2018		
Project Name	INO Yorba Linda				
Project Address	18181 Imperial Highway, Yorba Linda				
Test No:	IT-1	Total Depth (In.)	60	Test Size (In)	8
Depth To Water	>>50'	Soil Classification	SM		

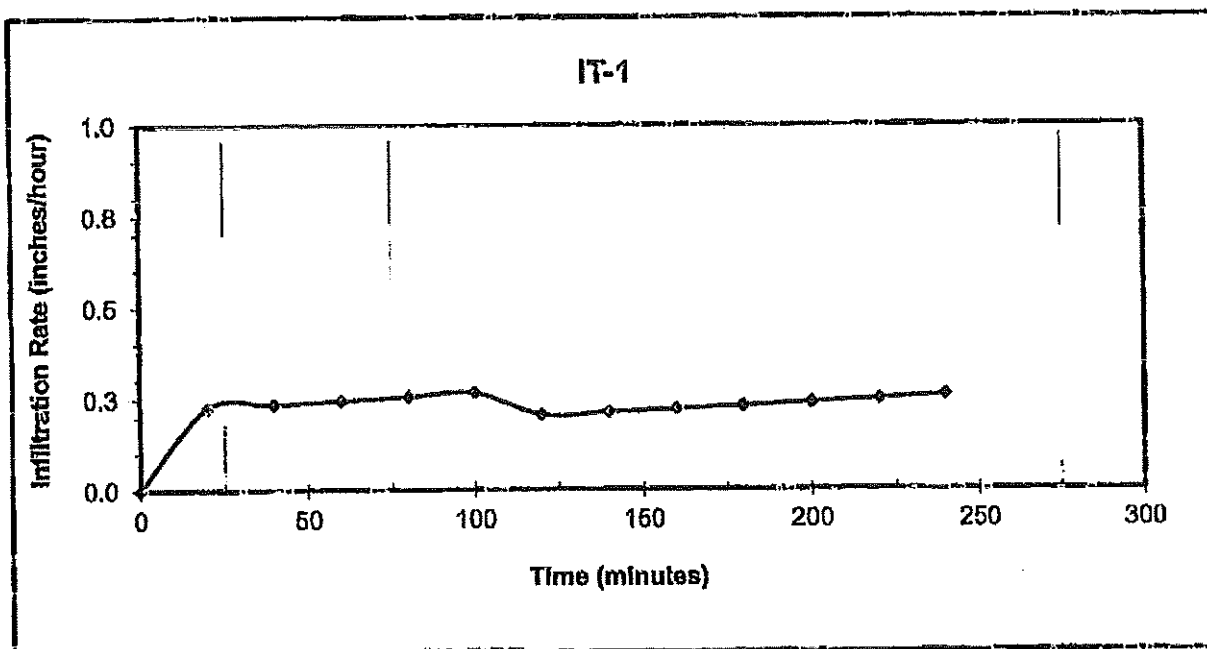[illegible]

RESULTS OF INFILTRATION TESTS - REVERSE BOREHOLE

Project #	11218047	Date	5/9/2018
Project Name	INO Yorba Linda		
Project Address	18181 Imperial Highway, Yorba Linda		

Test No:	IT-2	Total Depth (In.)	80	Test Size (In)	8
Depth To Water	>>50'	Soil Classification	SM		

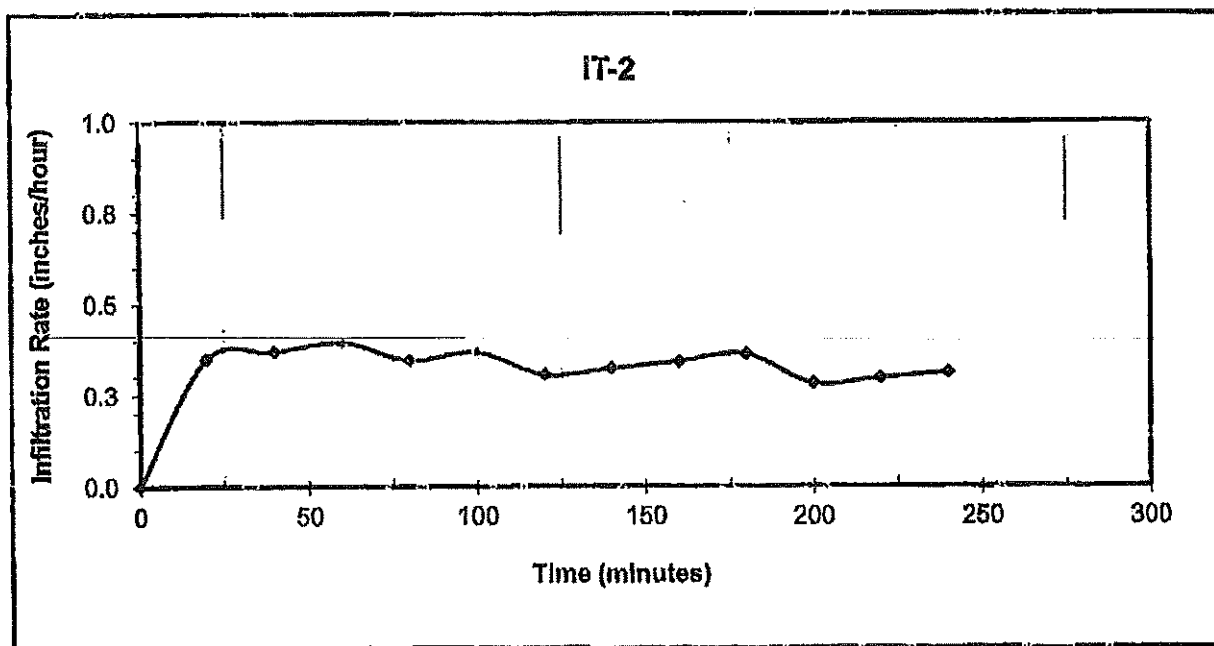[illegible]

ANAHEIM TEST LAB, INC

3008 ORANGE AVENUE
SANTA ANA, CALIFORNIA 92707
PHONE (714) 549-7267

Krazan & Associates, Inc.
1100 Olympic Drive, Ste. 103
Corona, CA 92881

DATE: 04/13/18

P.O. NO: Verbal

LAB NO: C-1757

SPECIFICATION: 417/422/643

MATERIAL: Soil

Project No: 11218047
INO Yorba Linda
B-1 @ 0-5'

ANALYTICAL REPORT

CORROSION SERIES SUMMARY OF DATA

pH	SOLUBLE SULFATES per CA. 417 ppm	SOLUBLE CHLORIDES per CA. 422 ppm	MIN. RESISTIVITY per CA. 643 ohm-cm
7.5	197	29	2,100

RESPECTFULLY SUBMITTED



WES BRIDGER CHEMIST

General Earthwork
Specifications

Appendix B

APPENDIX B

EARTHWORK SPECIFICATIONS

GENERAL

When the text of the report conflicts with the general specifications in this appendix, the recommendations in the report have precedence.

SCOPE OF WORK: These specifications and applicable plans pertain to and include all earthwork associated with the site rough grading, including, but not limited to, the furnishing of all labor, tools and equipment necessary for site clearing and grubbing, stripping, preparation of foundation materials for receiving fill, excavation, processing, placement and compaction of fill and backfill materials to the lines and grades shown on the project grading plans and disposal of excess materials.

PERFORMANCE: The Contractor shall be responsible for the satisfactory completion of all earthworks in accordance with the project plans and specifications. This work shall be inspected and tested by a representative of Krazan and Associates, Incorporated, hereinafter referred to as the Geotechnical Engineer and/or Testing Agency. Attainment of design grades, when achieved, shall be certified by the project Civil Engineer. Both the Geotechnical Engineer and the Civil Engineer are the Owner's representatives. If the Contractor should fail to meet the technical or design requirements embodied in this document and on the applicable plans, he shall make the necessary adjustments until all work is deemed satisfactory as determined by both the Geotechnical Engineer and the Civil Engineer. No deviation from these specifications shall be made except upon written approval of the Geotechnical Engineer, Civil Engineer, or project Architect.

No earthwork shall be performed without the physical presence or approval of the Geotechnical Engineer. The Contractor shall notify the Geotechnical Engineer at least 2 working days prior to the commencement of any aspect of the site earthwork.

The Contractor agrees that he shall assume sole and complete responsibility for job site conditions during the course of construction of this project, including safety of all persons and property; that this requirement shall apply continuously and not be limited to normal working hours; and that the Contractor shall defend, indemnify and hold the Owner and the Engineers harmless from any and all liability, real or alleged, in connection with the performance of work on this project, except for liability arising from the sole negligence of the Owner or the Engineers.

TECHNICAL REQUIREMENTS: All compacted materials shall be densified to the minimum relative compaction of 95 percent. Soil moisture-content requirements presented in the Geotechnical Engineer's report shall also be complied with. The maximum laboratory compacted dry unit weight of each soil placed as fill shall be determined in accordance with ASTM Test Method D1557-00 (Modified Proctor). The optimum moisture-content shall also be determined in accordance with this test method. The terms "relative compaction" and "compaction" are defined as the in-place dry density of the compacted soil divided by the laboratory compacted maximum dry density as determined by ASTM Test Method D1557-00, expressed as a percentage as specified in the technical portion of the Geotechnical Engineer's report. The location and frequency of field density tests shall be as determined by the Geotechnical Engineer. The results of these tests and compliance with these specifications shall be the basis upon which the Geotechnical Engineer will judge satisfactory completion of work.

SOILS AND FOUNDATION CONDITIONS: The Contractor is presumed to have visited the site and to have familiarized himself with existing site conditions and the contents of the data presented in the Geotechnical Engineering Investigation report.

The Contractor shall make his own interpretation of the data contained in the Geotechnical Engineering Investigation report and the Contractor shall not be relieved of liability under the Contract for any loss sustained as a result of any variance between conditions indicated by or deduced from said report and the actual conditions encountered during the progress of the work.

DUST CONTROL: The work includes dust control as required for the alleviation or prevention of any dust nuisance on or about the site or the borrow area, or off-site if caused by the Contractor's operation either during the performance of the earthwork or resulting from the conditions in which the Contractor leaves the site. The Contractor shall assume all liability, including court costs of codefendants, for all claims related to dust or wind-blown materials attributable to his work.

SITE PREPARATION

Site preparation shall consist of site clearing and grubbing, over-excavation of the proposed building pad areas, preparation of foundation materials for receiving fill, construction of Engineered Fill including the placement of non-expansive fill where recommended by the Geotechnical Engineer.

CLEARING AND GRUBBING: The Contractor shall accept the site in this present condition and shall demolish and/or remove from the area of designated project earthwork all structures, both surface and subsurface, trees, brush, roots, debris, organic matter and all other matter determined by the Geotechnical Engineer to be deleterious. Site stripping to remove organic materials and organic-laden soils in landscaped areas shall extend to a minimum depth of 2 inches or until all organic-laden soil with organic matter in excess of 3 percent of the soils by volume are removed. Such materials shall become the property of the Contractor and shall be removed from the site.

Tree root systems in proposed building areas should be removed to a minimum depth of 3 feet and to such an extent that would permit removal of all roots greater than 1 inch in diameter. Tree roots removed in parking areas may be limited to the upper 1½ feet of the ground surface. Backfill of tree root excavation should not be permitted until all exposed surfaces have been inspected and the Geotechnical Engineer is present for the proper control of backfill placement and compaction. Burning in areas that are to receive fill materials shall not be permitted.

Excavations required to achieve design grades, depressions, soft or pliant areas, or areas disturbed by demolition activities extending below planned finished subgrade levels should be excavated down to firm, undisturbed soil and backfilled with Engineered Fill. The resulting excavations should be backfilled with Engineered Fill.

EXCAVATION: Following clearing and grubbing operations, the proposed building pad area shall be over-excavated to a depth of at least five feet below existing grades or three feet below the planned foundation bottom levels, whichever is deeper, and the remaining areas of the building and adjoining exterior concrete flatwork or pavements at the building perimeter shall be over-excavated to a depth of at least one foot below existing grade. The areas of over-excavation and recompaction beneath footings and slabs shall extend out laterally a minimum of five feet beyond the perimeter of these elements.

All excavation shall be accomplished to the tolerance normally defined by the Civil Engineer as shown on the project grading plans. All over-excavation below the grades specified shall be backfilled at the

Contractor's expense and shall be compacted in accordance with the applicable **TECHNICAL REQUIREMENTS**.

SUBGRADE PREPARATION: Surfaces to receive Engineered Fill or to support structures directly, shall be scarified to a depth of 8 inches, moisture-conditioned as necessary and compacted in accordance with the **TECHNICAL REQUIREMENTS**, above.

Loose soil areas and/or areas of disturbed soil shall be should be excavated down to firm, undisturbed soil, moisture-conditioned as necessary and backfilled with Engineered Fill. All ruts, hummocks, or other uneven surface features shall be removed by surface grading prior to placement of any fill materials. All areas that are to receive fill materials shall be approved by the Geotechnical Engineer prior to the placement of any of the fill material.

FILL AND BACKFILL MATERIAL: No material shall be moved or compacted without the presence of the Geotechnical Engineer. Material from the required site excavation may be utilized for construction of site fills, with the limitations of their use presented in the Geotechnical Engineer's report, provided the Geotechnical Engineer gives prior approval. All materials utilized for constructing site fills shall be free from vegetation or other deleterious matter as determined by the Geotechnical Engineer, and shall comply with the requirements for non-expansive fill, aggregate base or aggregate subbase as applicable for its proposed used on the site as presented in the Geotechnical Engineer's report.

PLACEMENT, SPREADING AND COMPACTION: The placement and spreading of approved fill materials and the processing and compaction of approved fill and native materials shall be the responsibility of the Contractor. Fill materials should be placed and compacted in horizontal lifts, each not exceeding 8 inches in uncompacted thickness. Due to equipment limitations, thinner lifts may be necessary to achieve the recommended level of compaction. Compaction of fill materials by flooding, ponding, or jetting shall not be permitted unless specifically approved by local code, as well as the Geotechnical Engineer. Additional lifts should not be placed if the previous lift did not meet the required dry density (relative compaction) or if soil conditions are not stable. The compacted subgrade in pavement areas should be non-yielding when proof-rolled with a loaded ten-wheel truck, such as a water truck or dump truck, prior to pavement construction.

Both cut and fill shall be surface-compacted to the satisfaction of the Geotechnical Engineer prior to final acceptance.

SEASONAL LIMITS: No fill material shall be placed, spread, or rolled while it is frozen or thawing, or during unfavorable wet weather conditions. When the work is interrupted by heavy rains, fill operations shall not be resumed until the Geotechnical Engineer indicates that the moisture-content and density of previously placed fill is as specified.

General Paving
Specifications

Appendix C

APPENDIX C

PAVEMENT SPECIFICATIONS

1. DEFINITIONS - The term "pavement" shall include asphalt concrete surfacing, untreated aggregate base, and aggregate subbase. The term "subgrade" is that portion of the area on which surfacing, base, or subbase is to be placed.

The term "Standard Specifications": hereinafter referred to is the January 1999 Standard Specifications of the State of California, Department of Transportation, and the "Materials Manual" is the Materials Manual of Testing and Control Procedures, State of California, Department of Public Works, Division of Highways. The term "relative compaction" refers to the field density expressed as a percentage of the maximum laboratory density as defined in the ASTM D1557-00.

2. SCOPE OF WORK - This portion of the work shall include all labor, materials, tools, and equipment necessary for, and reasonably incidental to the completion of the pavement shown on the plans and as herein specified, except work specifically notes as "Work Not Included."

3. PREPARATION OF THE SUBGRADE - The Contractor shall prepare the surface of the various subgrades receiving subsequent pavement courses to the lines, grades, and dimensions given on the plans. The upper 12 inches of the soil subgrade beneath the pavement section shall be compacted to a minimum relative compaction of 95 percent. The finished subgrades shall be tested and approved by the Geotechnical Engineer prior to the placement of additional pavement courses.

4. UNTREATED AGGREGATE BASE - The aggregate base material shall be spread and compacted on the prepared subgrade in conformity with the lines, grades, and dimensions shown on the plans. The aggregate base material shall conform to the requirements of Section 26 of the Standard Specifications for Class 2 material, $\frac{3}{4}$ -inches maximum size. The aggregate base material shall be compacted to a minimum relative compaction of 95 percent. The aggregate base material shall be spread and compacted in accordance with Section 26 of the Standard Specifications. The aggregate base material shall be spread in layers not exceeding 6 inches and each layer of aggregate material course shall be tested and approved by the Geotechnical Engineer prior to the placement of successive layers.

5. AGGREGATE SUBBASE - The aggregate subbase shall be spread and compacted on the prepared subgrade in conformity with the lines, grades, and dimensions shown on the plans. The aggregate subbase material shall conform to the requirements of Section 25 of the Standard Specifications for Class II material. The aggregate subbase material shall be compacted to a minimum relative compaction of 95 percent, and it shall be spread and compacted in accordance with Section 25 of the Standard Specifications. Each layer of aggregate subbase shall be tested and approved by the Geotechnical Engineer prior to the placement of successive layers.

6. ASPHALT CONCRETE SURFACING - Asphalt concrete surfacing shall consist of a mixture of mineral aggregate and paving grade asphalt, mixed at a central mixing plant and spread and compacted on a prepared base in conformity with the lines, grades, and dimensions shown on the plans. The viscosity grade of the asphalt shall be AR-8000. The mineral aggregate shall be Type B, ½-inch or ¾-inch maximum, medium grading, for the wearing course and ¾-inch maximum, medium grading for the base course, and shall conform to the requirements set forth in Section 39 of the Standard Specifications. The drying, proportioning, and mixing of the materials shall conform to Section 39.

The prime coat, spreading and compacting equipment, and spreading and compacting the mixture shall conform to the applicable chapters of Section 39, with the exception that no surface course shall be placed when the atmospheric temperature is below 50 degrees F. The surfacing shall be rolled with a combination steel-wheel and pneumatic rollers, as described in Section 39-6. The surface course shall be placed with an approved self-propelled mechanical spreading and finishing machine.

7. FOG SEAL COAT - The fog seal (mixing type asphalt emulsion) shall conform to and be applied in accordance with the requirements of Section 37.

Attachment E WQMP Exhibit

LEMON DRIVE


OLINDA STREET

IMPERIAL HIGHWAY

STA-1
0.116 AC

STA-2
0.161 AC

IN-N-OUT
BURGER
3,867 SF
FF=391.00

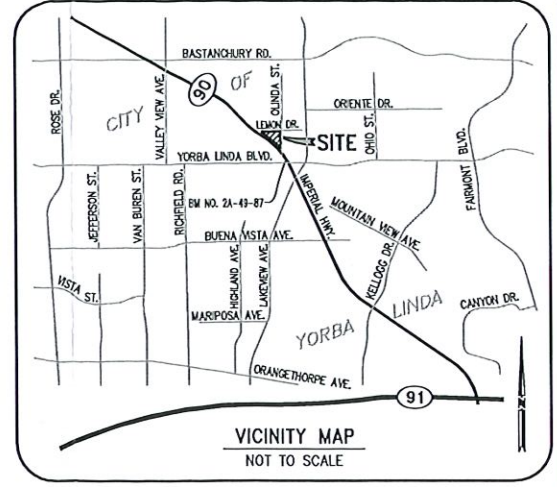

LAND COVER

- IMPERVIOUS - AC PAVEMENT/CONCRETE
- IMPERVIOUS - SIDEWALK
- IMPERVIOUS - BUILDING/TRASH ENCLOSURE
- PERVIOUS - LANDSCAPING
- PERVIOUS - SELF TREATING AREA

LEGEND

- TREATMENT CONTROL BMP
- (T1) BIO-RETENTION BASIN (GPS COORDINATES: 33.891285, -117.816190)
- NON-STRUCTURAL SOURCE CONTROL BMPs
- (N1) EDUCATION FOR PROPERTY OWNERS, TENANTS & OCCUPANTS
 - (N3) COMMON AREA LANDSCAPE MANAGEMENT
 - (N4) BMP MAINTENANCE
 - (N11) COMMON AREA LITTER CONTROL
 - (N14) COMMON AREA CATCH BASIN INSPECTION
 - (N15) STREET SWEEPING PRIVATE STREETS AND PARKING LOTS
- STRUCTURAL SOURCE CONTROL BMPs
- (S1) STORM DRAIN STENCILING
 - (S2) OUTDOOR MATERIAL STORAGE
 - (S3) OUTDOOR TRASH & WASTE STORAGE
 - (S4) EFFICIENT IRRIGATION SYSTEM
 - (S5) ENERGY DISSIPATION
 - (S13) WASH WATER CONTROL FOR FOOD PREPARATION AREAS



PLAN PREPARED FOR
IN-N-OUT BURGER
13502 HAMBURGER LANE
BALDWIN PARK, CA 91706

THIS PLAN IS:
PRELIMINARY
(NOT FOR CONSTRUCTION)

NOTICE TO CONTRACTOR
THE CONTRACTOR SHALL ASCERTAIN THE TRUE VERTICAL AND HORIZONTAL LOCATION AND SIZE OF ALL UTILITIES, PIPES, AND/OR STRUCTURES AND SHALL BE RESPONSIBLE FOR DAMAGE TO ANY PUBLIC OR PRIVATE UTILITIES, SHOWN OR NOT SHOWN HEREIN.

IMPORTANT NOTICE
Section 4216 of the Government Code requires a 30-day identification Number be issued before a "Furnish to Excavate" will be valid. For your Big Blue ID, Number call 811. Two working days before you dig.

GRADING PERMIT No. PENDING
WQMP No. XX-XXXX

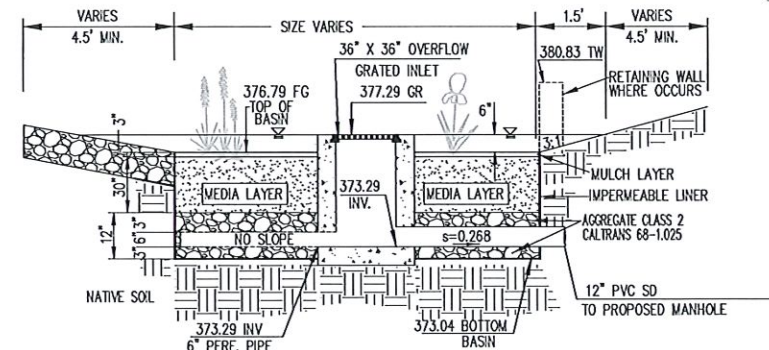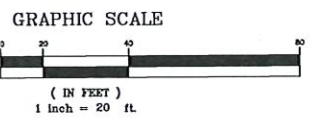


NOTES:
1.- MEDIA SPECIFICATIONS TO BE APPROVED BY THE CITY OF YORBA LINDA

(T1) BIO-RETENTION BASIN - TYPICAL SECTION
NOT TO SCALE

NO.	REVISIONS	DATE

Prepared by:
Joseph C. Truxaw and Associates, Inc.
Civil Engineers and Land Surveyors
265 S. Anita Dr., Suite 111, Orange, CA 92668 (714) 935-0265 fax (714) 935-0106



WQMP - BMP EXHIBIT
IN-N-OUT BURGER
18181 IMPERIAL HWY
IN THE CITY OF YORBA LINDA
ORANGE COUNTY, STATE OF CALIFORNIA

DATE 04-16-20
DRAWN BY PJS/MDR
CHECKED BY SMH/CD
JOB NO. IN018021
SHEET NO. 1
OF 1 SHEETS