

Prepared for

Jay and Lisa Cobb 2264 Vermont Avenue Clovis, California 93619

Prepared by

GEOSOLUTIONS, INC. 220 HIGH STREET SAN LUIS OBISPO, CALIFORNIA 93401 (805) 543-8539

0

March 14, 2019



March 14, 2019 SL11157-2

### Client:

Jay and Lisa Cobb 2264 Vermont Avenue Clovis, California 93619

Project name:

Parcel 9 North Ocean Avenue APN: 064-481-009 Cayucos area San Luis Obispo County, CA

### SOILS ENGINEERING REPORT

Dear Mr. and Mrs. Cobb:

This Soils Engineering Report has been prepared for the proposed bed and breakfast to be located at Parcel 9 North Ocean Avenue, APN: 064-481-009, Cayucos area of San Luis Obispo County, California. Geotechnically, the site is suitable for the proposed development provided the recommendations in this report for site preparation, earthwork, foundations, slabs, retaining walls, and pavement sections are incorporated into the design.

Undocumented fill materials were encountered during the field investigation, up to 12 feet below ground surface. Depending on the location of the proposed development with respect to the undocumented fill material, it is anticipated that that either a graded pad will be constructed for the proposed bed and breakfast with all foundations excavated into engineered fill, or that the proposed bed and breakfast will be supported by a system of deep foundations extending into the underlying weathered bedrock material encountered at depths of 8 feet to 32 feet below ground surface. This report presents recommendations for an engineered fill pad; additional recommendations for deep foundation systems can be provided upon request. All foundations are to be excavated into uniform material to limit the potential for distress of the foundation systems due to differential settlement. If cuts steeper than allowed by State of California Construction Safety Orders for "Excavations, Trenches, Earthwork" are proposed, a numerical slope stability analysis may be necessary for temporary construction slopes.

Thank you for the opportunity to have been of service in preparing this report. If you have any questions or require additional assistance, please feel free to contact the undersigned at (805) 543-8539.

Sincerely,

GeoSolutions, Inc.

Kraig R. Crozier, PE Principal, C61361

220 High Street San Luis Obispo CA 93401 805 543 8539

1021 Tama Lane, Suite 105 Santa Maria, CA 93455 805.614.6333

201 S. Milpas Street, Suite 103 Santa Barbara, CA 93103 805,966,2200

info@geosolutions.net

sbinfo@geosolutions.net

### **TABLE OF CONTENTS**

1.0	INTRO	DUCTION1
	1.1	Site Description
	1.2	Project Description1
2.0	PURPO	SE AND SCOPE2
3.0	FIELD A	AND LABORATORY INVESTIGATION2
4.0	SEISMI	C DESIGN CONSIDERATIONS4
5.0	LIQUE	FACTION HAZARD ASSESSMENT5
6.0	GENEF	RAL SOIL-FOUNDATION DISCUSSION5
7.0	CONCL	USIONS AND RECOMMENDATIONS6
	7.1	Preparation of Building Pad6
	7.2	Preparation of Paved Areas7
	7.3	Pavement Design7
	7.4	Conventional Foundations8
	7.5	Slab-On-Grade Construction9
	7.6	Exterior Concrete Flatwork
	7.7	Retaining Walls11
8.0	ADDITI	ONAL GEOTECHNICAL SERVICES14
9.0	LIMITA	TIONS AND UNIFORMITY OF CONDITIONS15

### **REFERENCES**

### APPENDIX A

Field Investigation Soil Classification Chart Boring Logs

### APPENDIX B

Laboratory Testing Soil Test Reports

### APPENDIX C

Seismic Hazard Analysis Design Map Summary (SEAOC, 2018)

### APPENDIX D

Preliminary Grading Specifications



### **LIST OF FIGURES**

Figure 1: Site Location Map	1
Figure 2: Site Plan	
Figure 3: Google Earth Image	
Figure 4: Regional Geologic Map	
Figure 5: Sub-Slab Detail	
Figure 6: Retaining Wall Detail	
Figure 7: Retaining Wall Active and Passive Wedges	

### LIST OF TABLES

Table 1: Engineering Properties	4
Table 2: Seismic Design Parameters	5
Table 3: Minimum Footing and Grade Beam Recommendations	8
Table 4: Minimum Slab Recommendations	9
Table 5: Retaining Wall Design Parameters	.11
Table 6: Required Verification and Inspections of Soils	.15



### SOILS ENGINEERING REPORT PARCEL 9, NORTH OCEAN AVENUE APN: 064-481-009, CAYUCOS AREA SAN LUIS OBISPO COUNTY, CALIFORNIA

### PROJECT SL11157-2

### 1.0 INTRODUCTION

This report presents the results of the geotechnical investigation for the proposed bed and breakfast to be located at Parcel 9 North Ocean Avenue, APN: 064-481-009, Cayucos area of San Luis Obispo County, California. See Figure 1: Site Location Map for the general location of the project area. Figure 1: Site Location Map was obtained from the computer program *Topo USA 8.0* (DeLorme, 2009).

### 1.1 Site Description

Parcel 9, North Ocean is located at 35.449703 degrees north latitude and 120.908094 degrees west longitude at a general elevation of 18 feet above mean sea level. The property is approximately square in shape. The nearest intersection is where North Ocean Avenue intersects Lucerne Street to the west of the property. The project property will hereafter be referred to as the "Site." See Figure 2: Site Plan for the general layout of the Site.

The Site has a slight slope gradient towards the southeast. Surface drainage follows the topography towards the southeast. Annual grasses currently vegetate the Site.

# Data use subject to licensia. Disalase subject to licensia. 0 Colcumn. Too USA98 8. White to the subject to licensia. White to the subject to licensia. See Colcumn. Too USA98 8. White to the subject to licensia. See Colcumn. Too USA98 8. White to the subject to licensia.

Figure 1: Site Location Map

### 1.2 Project Description

The size and layout of the proposed development at the Site is currently unknown. At the time of the preparation of this report, the proposed bed and breakfast is anticipated to be one or two stories in height and to be constructed using light wood framing.

It is anticipated that the proposed bed and breakfast will utilize a slab-on-grade and/or raised wood lower floor system. Dead and sustained live loads are currently unknown, but they are anticipated to be relatively light with maximum continuous footing and column loads estimated to be approximately 2.5 kips per linear foot and 25 kips, respectively.

### 2.0 PURPOSE AND SCOPE

The purpose of this study was to explore and evaluate the surface and sub-surface soil conditions at the

Site and to develop geotechnical information and design criteria. The scope of this study includes the following items:

- A literature review of available published and unpublished geotechnical data pertinent to the project site including geologic maps, and available online or in-house aerial photographs.
- A field study consisting of site reconnaissance and subsurface exploration including

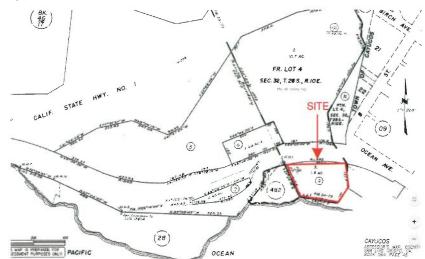


Figure 2: Site Plan

- exploratory borings in order to formulate a description of the sub-surface conditions at the Site.
- 3. Laboratory testing performed on representative soil samples that were collected during our field study.
- 4. Engineering analysis of the data gathered during our literature review, field study, and laboratory testing.
- 5. Development of recommendations for site preparation and grading as well as geotechnical design criteria for building foundations, retaining walls, pavement sections, underground utilities, and drainage facilities.

### 3.0 FIELD AND LABORATORY INVESTIGATION

The field investigation was conducted on February 22, 2019 using a track-mounted CME 55 drill rig. Three eight-inch diameter exploratory borings were advanced to a maximum depth of 35 feet below ground surface (bgs) at the approximate locations indicated on Figure 3: Google Earth Image. Sampling methods included the Standard Penetration Test utilizing a standard split-spoon sampler (SPT) without liners and a Modified California sampler (CA) with liners. The CME 55 drill rig was equipped with an automatic hammer, which has an efficiency of approximately 80 percent and was used to obtain test blow counts in the form of N-values.

Data gathered during the field investigation suggest that the soil materials in the northwestern corner of the Site consist of colluvial soils overlying competent formational material. The soil materials in the remainder of the Site consist of undocumented fill materials overlying alluvial soils and competent formational material. The surface material encountered at boring B-1 generally consisted of very dark grayish brown to black sandy CLAY encountered in a slightly moist and very stiff condition to approximately 5.0 feet bgs underlain by gray to light brown Claystone encountered in a hard condition. The surface and sub-surface materials encountered in borings B-2 and B-3 generally consisted of light brown to gray silty SAND (SM) and clayey SAND (SC) with cobbles and brick debris encountered in a slightly moist and loose to medium dense condition to approximate depths of 12 feet bgs, this material was interpreted as undocumented fill. The undocumented fill material is underlain by light gray to gray silty

SAND (SM) encountered in a loose to medium dense condition to depths of 28 to 32 feet bgs; this material was interpreted as Alluvial Deposits. The borings were terminated dark green to olive green Claystone encountered in a slightly moist and hard condition at 35 feet and 30 feet bgs, respectively. The claystone material encountered at termination of the borings was interpreted as Franciscan Formation rocks.

Regional site geology was obtained from United States Geological Survey MapView internet application (USGS, 2013) which compiles existing geologic maps. Figure 4: Regional Geologic Map presents the geologic conditions in site vicinity as mapped on the Geologic Map of the Cayucos Quadrangle (Dibblee, 2006). The majority of all underlying material at was interpreted the Site Franciscan Formation.

Groundwater was encountered boring B-2 at an approximate depth of 26 feet below ground surface. It should be expected that groundwater elevations may vary seasonally and with irrigation practices.



Figure 3: Google Earth Image

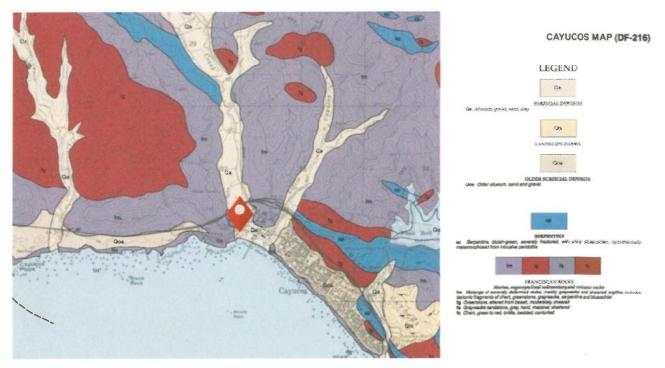


Figure 4: Regional Geologic Map

During the boring operations the soils encountered were continuously examined, visually classified, and sampled for general laboratory testing. A project engineer has reviewed a continuous log of the soils

encountered at the time of field investigation. See **Appendix A** for the Boring Logs from the field investigation.

Laboratory tests were performed on soil samples that were obtained from the Site during the field investigation. The results of these tests are listed below in Table 1: Engineering Properties. Laboratory data reports and detailed explanations of the laboratory tests performed during this investigation are provided in **Appendix B**.

Laboratory testing of the native CLAY materials indicated that the Site soils have high-shrink swell potential. As the silty sand surface materials encountered at the Site have been determined to be undocumented fill and may be removed/replaced during development of the property, the recommendations presented in this report are based on the soil properties of the native CLAY soils. Additional testing may be performed following building pad preparation to confirm soil engineering properties and adjust/reduce foundation and slab requirements based on the final test results.

Table 1: Engineering Properties

Sample Name	Sample Description	USCS Specification	Expansion Index	Expansion Potential	Maximum Dry Density, yd (pcf)	Optimum Moisture (%)	Angle of Internal Friction, ¢ (deg.)	Cohesion, c (psf)	Plasticity Index	Fines Content (%)
А	Very Dark Grayish Brown Sandy CLAY	CL	62	Med	120.0	12.4	-	-	32 High	57.8
B-1 @4'	Light Olive Brown Sandy CLAY	CL	-	-	-	1	25.3	544	1	-
B-1 @9'	Light Olive Brown Sandy CLAY	CL	1	-	1		9.7	1409	,	-
С	Light Olive Brown Clayey SAND	SC		-	127.6	10.4	-	-	25 High	-
D	Dark Grayish Brown Poorly Graded SAND with Silt	SP-SM	0	Very Low	117.8	9.2	-	-	N.P.	9.3
B-3 @4'	Olive Brown Poorly Graded SAND with Silt	SP-SM		-	-		32.4	0	-	-

## 4.0 SEISMIC DESIGN CONSIDERATIONS

Estimating the design ground motions at the Site depends on many factors including the distance from the Site to known active faults; the expected magnitude and rate of recurrence of seismic events produced on such faults; the source-to-site ground motion attenuation characteristics; and the Site soil profile characteristics. According to section 1613 of the 2016 CBC (CBSC, 2016), all structures and portions of structures should be designed to resist the effects of seismic loadings caused by earthquake ground motions in accordance with the ASCE 7: Minimum Design Loads for Buildings and Other Structures, hereafter referred to as ASCE7-10 (ASCE, 2013). The Site soil profile classification (Site Class) can be determined by the average soil properties in the upper 100 feet of the Site profile and the criteria provided in Table 20.3-1 of ASCE7-10.

Spectral response accelerations, peak ground accelerations, and site coefficients provided in this report were obtained using the computer-based Seismic Design Maps tool available from the Structural Engineers Association of California (SEAOC, 2018). This program utilizes the methods developed in ASCE 7-10 in conjunction with user-inputted Site location to calculate seismic design parameters and response spectra (both for period and displacement) for soil profile Site Classes A through E.

Site coordinates of **35.449703** degrees north latitude and **-120.908094** degrees east longitude were used in the web-based probabilistic seismic hazard analysis (SEAOC, 2018). Based on the results from the insitu tests performed during the field investigation, the Site was defined as **Site Class D**, "Stiff Soil" profile per ASCE7-10, Chapter 20. Relevant seismic design parameters obtained from the program area summarized in Table 2: Seismic Design Parameters Refer to **Appendix C** for more information regarding the seismic hazard analysis performed for the project and detailed results.

Table 2: Seismic Design Parameters

Site Class	Site Class D, "Stiff Soil"
Seismic Design Category	D
1-Second Period Design Spectral Response Acceleration, S <sub>D1</sub>	0.443g
Short-Period Design Spectral Response Acceleration, S <sub>DS</sub>	0.797g
Site Specific MCE Peak Ground Acceleration, PGA <sub>M</sub>	0.473g

### 5.0 LIQUEFACTION HAZARD ASSESSMENT

Liquefaction occurs when saturated cohesionless soils lose shear strength due to earthquake shaking. Ground motion from an earthquake may induce cyclic reversals of shear stresses of large amplitude. Lateral and vertical movement of the soil mass combined with the loss of bearing strength can result from this phenomenon. Liquefaction potential of soil deposits during earthquake activity depends on soil type, void ratio, groundwater conditions, the duration of shaking, and confining pressures on the potentially liquefiable soil unit. Fine, poorly graded loose sand, shallow groundwater, high intensity earthquakes, and long duration of ground shaking are the principal factors leading to liquefaction.

Based on the consistency and relative density of the in-situ soils the potential for seismic liquefaction of soils at the Site is low. Assuming that the recommendations of the Soils Engineering Report are implemented, the potential for seismically induced settlement and differential settlement at the Site is considered to be low.

### 6.0 GENERAL SOIL-FOUNDATION DISCUSSION

Undocumented fill materials were encountered during the field investigation, to depths of 12 feet below ground surface. Depending on the location of the proposed development with respect to the undocumented fill material, it is anticipated that that either a graded pad will be constructed for the proposed bed and breakfast with all foundations excavated into engineered fill, or that the proposed bed and breakfast will be supported by a system of deep foundations extending into the underlying weathered bedrock material encountered at depths of 8 feet to 32 feet below ground surface. This report presents recommendations for an engineered fill pad; additional recommendations for deep foundation systems can be provided upon request. All foundations are to be excavated into uniform material to limit the potential for distress of the foundation systems due to differential settlement. If cuts steeper than allowed by State of California Construction Safety Orders for "Excavations, Trenches, Earthwork" are proposed, a numerical slope stability analysis may be necessary for temporary construction slopes.



### 7.0 CONCLUSIONS AND RECOMMENDATIONS

The Site is suitable for the proposed development provided the recommendations presented in this report are incorporated into the project plans and specifications.

The primary geotechnical concerns at the Site are:

- 1. The presence of loose undocumented fill materials and debris.
- 2. The presence of potentially expansive material. Influx of water from irrigation, leakage from the building, infiltration from LID improvements, or natural seepage could cause expansive soil problems. Foundations supported by expansive soils should be designed by a Structural Engineer in accordance with the 2016 California Building Code.
- 3. The potential for differential settlement occurring between foundations supported on two soil materials having different settlement characteristics, such as native soil or loose alluvial deposits and engineered fill. Therefore, it is important that all of the foundations are founded in equally competent uniform material in accordance with this report.

### 7.1 Preparation of Building Pad

- 1. It is anticipated that a graded pad will be constructed for the proposed bed and breakfast with foundations excavated into engineered fill. Pad grading will require removal of the documented fill encountered in the upper 12 feet of the Site in borings B-2 and B-3.
- 2. For the development of an engineered fill pad, the undocumented fill material should be removed from the building pad area. The limits of excavation should extend a minimum of 5 feet beyond the perimeter foundation, to property lines, or existing improvements, whichever is least. Following removal of the undocumented fill materials from within the building pad area, there is potential that the excavation may expose both competent formational material and loose alluvial deposits. Additional excavation may be necessary, depending on soil conditions to remove loose alluvial materials to expose competent formational material within the excavation for the entire building pad area. The exposed competent formational material is anticipated to slope down towards the south and should be benched and level prior to receiving fill materials. Sub-surface drains may need to be installed on the uphill side of the excavation and on the benches excavated into exposed formational material to facilitate drainage of the building pad area, depending on field conditions observed during grading operations.
- 3. The excavated material, cleared of oversize material and debris may then be processed as engineered fill. Onsite soil and rock material is suitable as fill material provided it is processed to remove concentrations of organic material, debris, and other particles. Import material should be non-expansive and granular; such as a Class II/III aggregate sub-base or similar material. All material to be used as non-expansive engineered fill must be observed and approved by a representative of GeoSolutions, Inc. prior to delivery to the Site. GeoSolutions, Inc. should be notified at least 72 hours prior to delivery to the site to sample and test proposed imported fill materials. Refer to Figure 5: Sub-Slab Detail for under-slab drainage material and **Appendix D** for more details on fill placement.
- 4. The recommended soil moisture content should be maintained during construction and following construction of the proposed development. Where soil moisture content is not maintained, desiccation cracks may develop which indicate a loss of soil compaction, leading to the potential for damage to foundations, flatwork, pavements, and other improvements. Soils that have become cracked due to moisture loss should be removed sufficient depth to repair the cracked soil as observed by the soils engineer, and the



removed materials should then be moisture conditioned to approximately 3 percent over optimum value, and compacted.

### 7.2 Preparation of Paved Areas

- Pavement areas should be excavated to approximate sub-grade elevation or to competent material; whichever is deeper. The exposed surface should be scarified an additional depth of 12 inches, moisture conditioned to slightly above optimum moisture content, and compacted to a minimum relative density of 95 percent (ASTM D1557-12 test method).
- 2. The top 12 inches of sub-grade soil under all pavement sections should be compacted to a minimum relative density of 95 percent based on the ASTM D1557-12 test method at slightly above optimum.
- 3. Sub-grade soils should not be allowed to dry out or have excessive construction traffic between moisture conditioning and compaction, and placement of the pavement structural section.
- 4. Due to the expansive potential of the soils at the Site, the base courses beneath unreinforced pavement sections may fail, causing cracking of the pavement surfaces, as the sub-grade materials move laterally during expansive shrink-swell cycles.
- 5. Therefore, in order to minimize the potential for the failure of pavement sections at the Site, GeoSolutions, Inc. recommends that a Type 2 laterally-reinforcing geotextile grid, such as Tensar BX1200, Syntec SBX12, ADS BX124GG, or equivalent, be installed between the prepared sub-grade and base materials at the Site.
- 6. GeoSolutions, Inc. should be contacted prior to the design and construction of pavement sections at the Site in order to assist in the selection of an appropriate laterally-reinforcing biaxial geogrid product and to provide recommendations regarding the procedures for the installation of geogrid products at the Site.

### 7.3 Pavement Design

- 1. All pavement construction and materials used should conform to Sections 25, 26 and 39 of the latest edition of the State of California Department of Transportation Standard Specifications (State of California, 1999).
- As indicated previously in Section 7.2, the top 12 inches of sub-grade soil under pavement sections should be compacted to a minimum relative density of 95 percent based on the ASTM D1557-12 test method at slightly above optimum moisture content. Aggregate bases and sub-bases should also be compacted to a minimum relative density of 95 percent based on the aforementioned test method.
- 3. A minimum of six inches of Class II Aggregate Base is recommended for all pavement sections. All pavement sections should be crowned for good drainage.
- 4. In order to minimize the potential for cracking of the pavement surfaces at the Site due to lateral movement of the base courses during expansive shrink-swell cycles of the subgrade materials, GeoSolutions, Inc. recommends that a Type 2 laterally-reinforcing geotextile grid, such as Tensar BX1200, Syntec SBX12, ADS BX124GG, or equivalent, be installed between the prepared sub-grade and base materials at the Site.



5. GeoSolutions, Inc. should be contacted prior to the design and construction of the pavement sections to provide recommendations regarding the selection of and installation of an appropriate laterally-reinforcing biaxial geogrid product.

### 7.4 Conventional Foundations

- 1. Conventional continuous and spread footings with grade beams may be used for support of the proposed structure(s). Isolated pad footings are not permitted. Foundations must be designed in accordance to section 1808.6, 2016 CBC, Foundations on Expansive Soils.
- 2. Minimum footing and grade beam sizes and depths in engineered fill should conform to the following table, as observed and approved by a representative of GeoSolutions, Inc.

Table 3: Minimum Footing and Grade Beam Recommendations

Perimeter Footings	Grade Beams
12 inches (one story)	12 inches
15 inches (two story)	12 mones
30 inches	18 inches
6 #5 bars	4 #5 bars
(3 top / 3 bottom)	(2 top / 2 bottom)
-	16 feet on-center each way
	12 inches (one story) 15 inches (two story) 30 inches 6 #5 bars

<sup>\*</sup> Steel should be held in place by stirrups at appropriate spacing to ensure proper positioning of the steel (see WRI Design of Slab-on-Ground Foundations and ACI 318, Section 26.6.6 – Placing Reinforcement).

- 3. Minimum reinforcing for footings should conform to the recommendations provided in Table 3: Minimum Footing and Grade Beam Recommendations which meets the specifications of Section 1808.6 of the 2016 California Building Code for the soil conditions at the Site. Reinforcing steel should be held in place by stirrups at appropriate spacing to ensure proper positioning of the steel in accordance with WRI Design of Slabon-Ground Foundations, and ACI 318, Section 26.6.6 Placing Reinforcement.
- 4. A representative of this firm should observe and approve all foundation excavations for required embedment depth prior to the placement of reinforcing steel and/or concrete. Concrete should be placed only in excavations that are free of loose, soft soil and debris and that have been maintained in a moist condition with no desiccation cracks present.
- 5. An allowable dead plus live load bearing pressure of **1,500 psf** may be used for the design of footings founded in engineered fill.
- 6. Allowable bearing capacities may be increased by one-third when transient loads such as wind and/or seismicity are included.
- 7. A total settlement of less than 1 inch and a differential settlement of less than 1 inch in 30 feet are anticipated.

GEO

- 8. Lateral forces on structures may be resisted by passive pressure acting against the sides of shallow footings and/or friction between the engineered fill and the bottom of the footings. For resistance to lateral loads, a friction factor of **0.30** may be utilized for sliding resistance at the base of footings extending a minimum of 30 inches into engineered fill. A passive pressure of **300-pcf** equivalent fluid weight may be used against the side of shallow footings in engineered fill. If friction and passive pressures are combined to resist lateral forces acting on shallow footings, the lesser value should be reduced by 50 percent.
- 9. Foundation excavations should be observed and approved by a representative of this firm prior to the placement of reinforcing steel and/or concrete.
- 10. Foundation design should conform to the requirements of Chapter 18 of the latest edition of the CBC (CBSC, 2016).
- The base of all grade beams and footings should be level and stepped as required to accommodate any change in grade while still maintaining the minimum required footing embedment and slope setback distance.

### 7.5 Slab-On-Grade Construction

- 1. Concrete slabs-on-grade and flatwork should not be placed directly on unprepared native materials. Preparation of sub-grade to receive concrete slabs-on-grade and flatwork should be processed as discussed in the preceding sections of this report. Concrete slabs should be placed only over sub-grade that is free of loose, soft soil and debris and that has been maintained in a moist condition with no desiccation cracks present.
- Concrete slabs-on-grade should be in conformance with the recommendations provided in Table 4: Minimum Slab Recommendations. Reinforcing should be placed on-center both ways at or slightly above the center of the structural section. Reinforcing bars should have a minimum clear cover of 1.5 inches. Where lapping of the slab steel is required, laps in adjacent bars should be staggered a minimum of every five feet (see WRI Design of Slab-on-Ground Foundations, Steel Placement). The recommended reinforcement may be used for anticipated uniform floor loads not exceeding 200 psf. If floor loads greater than 200 psf are anticipated, a Structural Engineer should evaluate the slab design.

Table 4: Minimum Slab Recommendations

Minimum Thickness	5 inches
Reinforcing*	#4 bars at 16 inches on-center each way
	lab steel is required, laps in adjacent bars should be staggered a feet (see WRI/CSRI-81 recommendations for Steel Placement,

- 3. Concrete for all slabs should be placed at a maximum slump of less than 5 inches. Excessive water content is the major cause of concrete cracking. If fibers are used to aid in the control of cracking, a water-reducing admixture may be added to the concrete to increase slump while maintaining a water/cement ratio, which will limit excessive shrinkage. Control joints should be constructed as required to control cracking.
- 4. Where concrete slabs-on-grade are to be constructed for interior conditioned spaces, the slabs should be underlain by a minimum of four inches of clean free-draining material, such as a ¾ inch coarse aggregate mix, to serve as a cushion and a capillary break. Where moisture susceptible storage or floor coverings are anticipated, a 15-mil Stego Wrap membrane (or equivalent installed per manufacturer's specifications) should be



placed between the free-draining material and the slab to minimize moisture condensation under the floor covering. See Figure 5: Sub-Slab Detail for the placement of under-slab drainage material. It is suggested, but not required, that a two-inch thick sand layer be placed on top of the membrane to assist in the curing of the concrete, increasing the depth of the under-slab material to a total of six inches. The sand should be lightly moistened prior to placing concrete.

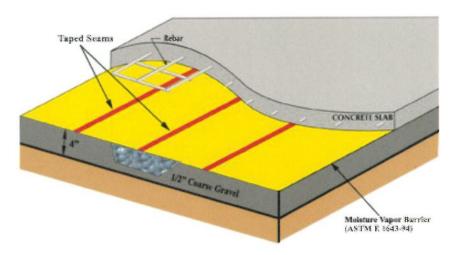


Figure 5: Sub-Slab Detail

- 5. It should be noted that for a vapor barrier installation to conform to manufacturer's specifications, sealing of penetrations, joints and edges of the vapor barrier membrane are typically required. As required by the California Building Code, joints in the vapor barrier should be lapped a minimum of 6 inches. If the installation is not performed in accordance with the manufacturer's specifications, there is an increased potential for water vapor to affect the concrete slabs and floor coverings.
- 6. The most effective method of reducing the potential for moisture vapor transmission through concrete slabs-on-grade would be to place the concrete directly on the surface of the vapor barrier membrane. However, this method requires a concrete mix design specific to this application with low water-cement ratio in addition to special concrete finishing and curing practices, to minimize the potential for concrete cracks and surface defects. The contractor should be familiar with current techniques to finish slabs poured directly onto the vapor barrier membrane.
- 7. Moisture condensation under floor coverings has become critical due to the use of watersoluble adhesives. Therefore, it is suggested that moisture sensitive slabs not be constructed during inclement weather conditions.

### 7.6 Exterior Concrete Flatwork

1. Due to the presence of expansive surface soils within the proposed development areas, there is a potential for considerable soil movement and distress to reinforced concrete flatwork if conventional measures are used, such as the placement of 4 to 6 inches of imported sand materials placed beneath concrete flatwork. Heaving and cracking are anticipated to occur. To reduce the potential for movement associated with expansive soils, we recommend the placement of a minimum of 24 inches of approved non-expansive import material placed as engineered fill beneath the flatwork.



- 2. Minimum flatwork for conventional pedestrian areas should be a minimum of 4 inches thick and consist of No. 3 (#3) rebar spaced at 24 inches on-center each-way at or slightly above the center of the structural section.
- 3. Flatwork should be constructed with frequent joints to allow for movement due to fluctuations in temperature and moisture content in the adjacent soils. Flatwork at doorways, driveways, curbs and other areas where restraining the elevation of the flatwork is desired, should be doweled to the perimeter foundation by a minimum of No. 3 reinforcing steel dowels, spaced at a maximum distance of 24 inches on-center.
- 4. As an alternative, interlocking concrete pavers may be utilized for exterior improvements in lieu of reinforced concrete flatwork. Concrete pavers, when installed in accordance with manufacturers' recommendations and industry standards (ICPI), allow for a greater degree of soil movement as they are part of a flexible system. If interlocking concrete pavers are selected for use in the driveway area, the structural section should be underlain by a woven geotextile fabric, such as Mirafi 500x or equivalent, to function as a separation layer and to provide additional support for vehicle tire loads.

### 7.7 Retaining Walls

1. Retaining walls should be designed to resist lateral pressures from adjacent soils and surcharge loads applied behind the walls. We recommend using the lateral pressures presented in Table 5: Retaining Wall Design Parameters and Figure 6: Retaining Wall Detail for the design of retaining walls at the Site. The Active Case may be used for the design of unrestrained retaining walls, and the At-Rest Case may be used for the design of restrained retaining walls.

Table 5: Retaining Wall Design Parameters

Lateral Pressure and Condition	Equivalent Fluid Pressure, pcf
Static, Active Case, Engineered Fill (γ'K <sub>A</sub> )	50
Static, At-Rest Case, Engineered Fill (γ'K <sub>O</sub> )	70
Static, Passive Case, Engineered Fill (γ'K <sub>P</sub> )	300

- 2. The above values for equivalent fluid pressure are based on retaining walls having level retained surfaces, having vertical approximately surface against the retained material. and retaining granular backfill material or engineered fill composed of native soil within the active wedge. See Figure 6: Retaining Wall Detail and Figure 7: Retaining Wall Active and Passive Wedges for a description of the location of the active wedge behind a retaining wall.
- 3. Proposed retaining walls having a retained surface that slopes upward from the top of the wall should be designed for an

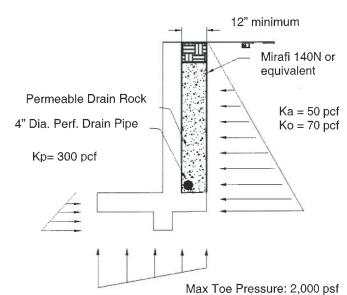


Figure 6: Retaining Wall Detail

additional equivalent fluid pressure of 1 pcf for the active case and 1.5 pcf for the at-rest case, for every degree of slope inclination.

4. We recommend that the proposed retaining walls at the Site have an approximately vertical surface against the retained material. If the proposed retaining walls are to have sloped surfaces against the retained material, the project designers should contact the Soils Engineer to determine the appropriate lateral earth pressure values for retaining walls located at the Site.

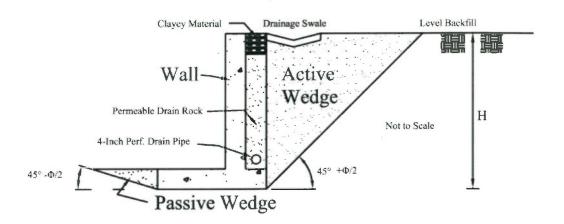


Figure 7: Retaining Wall Active and Passive Wedges

5. Retaining wall foundations should be founded a minimum of 30 inches below lowest adjacent grade in engineered fill as observed and approved by a representative of GeoSolutions, Inc. A coefficient of friction of **0.30** may be used between engineered fill

and concrete footings. Project designers may use a maximum toe pressure of **2,000 psf** for the design of retaining wall footings founded in engineered fill.

- 6. For earthquake conditions, retaining walls greater than 6 feet in height should be designed to resist an additional seismic lateral soil pressure of **25 pcf** equivalent fluid pressure for unrestrained walls (active condition). The pressure resultant force from earthquake loading should be assumed to act a distance of  $^{1}/_{3}H$  above the base of the retaining wall, where H is the height of the retaining wall. Seismic active lateral earth pressure values were determined using the simplified dynamic lateral force component (SEAOC 2010) utilizing the design peak ground acceleration, PGA<sub>M</sub>, discussed in Section 4.0 (**PGA<sub>M</sub>** = **0.473g**). The dynamic increment in lateral earth pressure due to earthquakes should be considered during the design of retaining walls at the Site. Based on research presented by Dr. Marshall Lew (Lew et al., 2010), lateral pressures associated with seismic forces should not be applied to restrained walls (at-rest condition).
- 7. Seismically induced forces on retaining walls are considered to be short-term loadings. Therefore, when performing seismic analyses for the design of retaining wall footings, we recommend that the allowable bearing pressure and the passive pressure acting against the sides of retaining wall footings be increased by a factor of one-third.
- In addition to the static lateral soil pressure values reported in Table 5: Retaining Wall Design Parameters, the retaining walls at the Site should be designed to support any design live load, such as from vehicle and construction surcharges, etc., to be supported by the wall backfill. If construction vehicles are required to operate within 10 feet of a retaining wall, supplemental pressures will be induced and should be taken into account in the design of the retaining wall.
- 9. The recommended lateral earth pressure values are based on the assumption that sufficient sub-surface drainage will be provided behind the walls to prevent the build-up of hydrostatic pressure. To achieve this we recommend that a granular filter material be placed behind all proposed walls. The blanket of granular filter material should be a minimum of 12 inches thick and should extend from the bottom of the wall to 12 inches from the ground surface. The top 12 inches should consist of moisture conditioned, compacted, clayey soil. Neither spread nor wall footings should be founded in the granular filter material used as backfill.
- 10. A 4-inch diameter perforated or slotted drainpipe (ASTM D1785 PVC) should be installed near the bottom of the filter blanket with perforations facing down. The drainpipe should be underlain by at least 4 inches of filter type material and should daylight to discharge in suitably projected outlets with adequate gradients. The filter material should consist of a clean free-draining aggregate, such as a coarse aggregate mix. If the retaining wall is part of a structural foundation, the drainpipe must be placed below finished slab sub-grade elevation.
- 11. The filter material should be encapsulated in a permeable geotextile fabric. A suitable permeable geotextile fabric, such as non-woven needle-punched Mirafi 140N or equal, may be utilized to encapsulate the retaining wall drain material and should conform to Caltrans Standard Specification 88-1.03 for underdrains.
- 12. For hydrostatic loading conditions (i.e. no free drainage behind retaining wall), an additional loading of 45-pcf equivalent fluid weight should be added to the active and atrest lateral earth pressures. If it is necessary to design retaining structures for submerged conditions, the allowed bearing and passive pressures should be reduced by 50 percent. In addition, soil friction beneath the base of the foundations should be neglected.



- 13. Precautions should be taken to ensure that heavy compaction equipment is not used adjacent to walls, so as to prevent undue pressure against, and movement of the walls.
- 14. The use of water-stops/impermeable barriers should be used for any basement construction, and for building walls that retain earth.

### 8.0 ADDITIONAL GEOTECHNICAL SERVICES

The recommendations contained in this report are based on a limited number of borings and on the continuity of the sub-surface conditions encountered. GeoSolutions, Inc. assumes that it will be retained to provide additional services during future phases of the proposed project. These services would be provided by GeoSolutions, Inc. as required by County of San Luis Obispo, the 2016 CBC, and/or industry standard practices. These services would be in addition to those included in this report and would include, but are not limited to, the following services:

- Consultation during plan development.
- 2. Plan review of grading and foundation documents prior to construction and a report certifying that the reviewed plans are in conformance with our geotechnical recommendations.
- Consultation during selection and placement of a laterally-reinforcing biaxial geogrid product.
- 4. Construction inspections and testing, as required, during all grading and excavating operations beginning with the stripping of vegetation at the Site, at which time a site meeting or pre-job meeting would be appropriate.
- 5. Special inspection services during construction of reinforced concrete, structural masonry, high strength bolting, epoxy embedment of threaded rods and reinforcing steel, and welding of structural steel.
- 6. Preparation of construction reports certifying that building pad preparation and foundation excavations are in conformance with our geotechnical recommendations.
- 7. Preparation of special inspection reports as required during construction.
- 8. In addition to the construction inspections listed above, section 1705.6 of the 2016 CBC (CBSC, 2016) requires the following inspections by the Soils Engineer for controlled fill thicknesses greater than 12 inches as shown in Table 6: Required Verification and Inspections of Soils:



Table 6: Required Verification and Inspections of Soils

	Verification and Inspection Task	Continuous During Task Listed	Periodically During Task Listed
1.	Verify materials below footings are adequate to achieve the design bearing capacity.	-	Х
2.	Verify excavations are extended to proper depth and have reached proper material.	F = 8	Х
3.	Perform classification and testing of controlled fill materials.	-	Х
4.	Verify use of proper materials, densities and lift thicknesses during placement and compaction of controlled fill.	X	-
5.	Prior to placement of controlled fill, observe sub-grade and verify that site has been prepared properly.	-	X

### 9.0 LIMITATIONS AND UNIFORMITY OF CONDITIONS

- 1. The recommendations of this report are based upon the assumption that the soil conditions do not deviate from those disclosed during our study. Should any variations or undesirable conditions be encountered during the development of the Site, GeoSolutions, Inc. should be notified immediately and GeoSolutions, Inc. will provide supplemental recommendations as dictated by the field conditions.
- 2. This report is issued with the understanding that it is the responsibility of the owner or his/her representative to ensure that the information and recommendations contained herein are brought to the attention of the architect and engineer for the project, and incorporated into the project plans and specifications. The owner or his/her representative is responsible to ensure that the necessary steps are taken to see that the contractor and subcontractors carry out such recommendations in the field.
- 3. As of the present date, the findings of this report are valid for the property studied. With the passage of time, changes in the conditions of a property can occur whether they are due to natural processes or to the works of man on this or adjacent properties. Therefore, this report should not be relied upon after a period of 3 years without our review nor should it be used or is it applicable for any properties other than those studied. However many events such as floods, earthquakes, grading of the adjacent properties and building and municipal code changes could render sections of this report invalid in less than 3 years.

S:\SL11000-SL11499\SL11157-1 - Parcel 9 North Ocean GEO\Engineering\SL11157-2 - Parcel 9, North Ocean SER.doc

### **REFERENCES**

### REFERENCES

- American Concrete Institute (ACI). Building Code Requirements for Structural Concrete (318-08), Chapter 7, Section 7.5, Placing Reinforcement, ACI Committee 318, 2008.
- American Society of Civil Engineers (ASCE). *Minimum Design Loads for Buildings and Other Structures*, ASCE Standard 7-10, ASCE, Reston, VA, 2013.
- California Building Standards Commission (CBSC). (2016). 2016 California Building Code, California Code of Regulations, Title 24. Part 2, Vol. 2.
- County of Luis Obispo. Assessor's Map Book: 064, Page 048. August 14, 2000. <a href="http://www.sbcvote.com/assessor/AssessorParcelMap.aspx">http://www.sbcvote.com/assessor/AssessorParcelMap.aspx</a>.
- DeLorme. Topo USA 8.0. Vers.8.0.0 Computer software. DeLorme, 2009.
- Dibblee, Thomas W., Jr.. *Geologic Map of the Cayucos Quadrangle*. Dibblee Geologic Center Map Number DF-216. Santa Barbara Museum of Natural History: April 2006.
- Lew, M., Sitar, N., Al Atik, L., Paourzanjani, M., and Hudson, M. "Seismic Earth pressure on Deep Building Basements," SEAOC 2010 Convention Proceedings, 2010.
- State of California. Department of Industrial Relations. *California Code of Regulations*. 2001 Edition. Title 8. Chapter 4: Division of Industrial Safety. Subchapter 4, Construction Safety Orders. Article 6: Excavations. http://www.dir.ca.gov/title8/sub4.html.
- State of California, Department of Transportation. Standard Specifications. State of California Department of Transportation Central Publication Distribution Unit: July 1999.
- Structural Engineers Association of California (SEAOC), Seismic Design Maps, accessed March 7, 2019. <a href="https://seismicmaps.org/">https://seismicmaps.org/</a>.
- United States Geological Survey. *MapView Geologic Maps of the Nation*. Internet Application. USGS, accessed March 7, 2019. <a href="http://ngmdb.usgs.gov/maps/MapView/">http://ngmdb.usgs.gov/maps/MapView/</a>.
- Wire Reinforcement Institute, Design of Slab-on-Ground Foundations, A Design, Construction \$ Inspection Aid for Consulting Engineers, TF 700-R-03 Update, dated 2003.

Geo.

# **APPENDIX A**

Field Investigation
Soil Classification Chart
Boring Logs

### FIELD INVESTIGATION

The field investigation was conducted February 22, 2019 using a track-mounted CME 55 drill rig. The surface and sub-surface conditions were studied by advancing three exploratory borings. This exploration was conducted in accordance with presently accepted geotechnical engineering procedures consistent with the scope of the services authorized to GeoSolutions, Inc.

The CME 55 drill rig with an eight-inch diameter hollow-stem continuous flight auger advanced three exploratory borings near the approximate locations indicated on Figure 3: Google Earth Image. The drilling and field observation was performed under the direction of the project engineer. A representative of GeoSolutions, Inc. maintained a log of the soil conditions and obtained soil samples suitable for laboratory testing. The soils were classified in accordance with the Unified Soil Classification System. See the Soil Classification Chart in this appendix.

Standard Penetration Tests with a two-inch outside diameter standard split tube sampler (SPT) without liners (ASTM D1586) and a three-inch outside diameter Modified California (CA) split tube sampler with liners (ASTM D3550) were performed to obtain field indication of the in-situ density of the soil and to allow visual observation of at least a portion of the soil column. Soil samples obtained with the split spoon sampler are retained for further observation and testing. The split spoon samples are driven by a 140-pound hammer free falling 30 inches. The sampler is initially seated six inches to penetrate any loose cuttings and is then driven an additional 12 inches with the results recorded in the boring logs as N-values, which area the number of blows per foot required to advance the sample the final 12 inches.

The CA sampler is a larger diameter sampler than the standard (SPT) sampler with a two-inch outside diameter and provides additional material for normal geotechnical testing such as in-situ shear and consolidation testing. Either sampler may be used in the field investigation, but the N-values obtained from using the CA sampler will be greater than that of the SPT. The N-values for samples collected using the CA can be roughly correlated to SPT N-values using a conversion factor that may vary from about 0.5 to 0.7. A commonly used conversion factor is 0.67 (2/3). More information about standardized samplers can be found in ASTM D1586 and ASTM D3550.

Disturbed bulk samples are obtained from cuttings developed during boring operations. The bulk samples are selected for classification and testing purposes and may represent a mixture of soils within the noted depths. Recovered samples are placed in transport containers and returned to the laboratory for further classification and testing.

Logs of the borings showing the approximate depths and descriptions of the encountered soils, applicable geologic structures, recorded N-values, and the results of laboratory tests are presented in this appendix. The logs represent the interpretation of field logs and field tests as well as the interpolation of soil conditions between samples. The results of laboratory observations and tests are also included in the boring logs. The stratification lines recorded in the boring logs represent the approximate boundaries between the surface soil types. However, the actual transition between soil types may be gradual or varied.

GEO

### SOIL CLASSIFICATION CHART

MAJOR DIV	MAJOR DIVISIONS		FORY CLASSIFICATION CRITERIA	GROUP SYMBOLS	PRIMARY DIVISIONS	
		Clean gravels (less	Cu greater than 4 and Cz between 1 and 3	GW	Well-graded gravels and gravel-sand mixtures, little or no fines	
			Not meeting both criteria for GW	GP	Poorly graded gravels and gravel-sand mixtures, little or no fines	
		Silty gravels, gravel-sand-silt mixtures				
COARSE GRAINED SOILS More than 50% retained on No.		Clayey gravels, gravel-sand-clay mixtures				
200 sieve	,	Clean sand (less	C <sub>n</sub> greater than 6 and C <sub>2</sub> between 1 and 3	SW	Well graded sands, gravely sands, little or no fines	
	SANDS	than 5% fines*)	Not meeting both criteria for SW	SP	Poorly graded sands and gravelly and sands, little or no fines	
	More than 50% of coarse fraction passes No. 4	Sand with fines	Atterberg limits plot below "A" line or plasticity index less than 4	SM	Silty sands, sand-silt mixtures	
	(4.75mm) sieve	(more than 12% fines*)	Atterberg limits plot above "A" line and plasticity index greater than 7	SC	Clayey sands, sand-clay mixtures	
		Inorganic soil	PI < 4 or plots below "A"-line	ML	Inorganic silts, very fine sands, rock flour, silty or clayey fine sands	
	SILTS AND CLAYS (liquid limit less than 50)	Inorganic soil	PI > 7 and plots on or above "A" line**	CL	Inorganic clays of low to medium plasticity, gravelly clays, sandy clays, silty clays, lean clays	
FINE GRAINED SOILS 50% or more passes No. 200		Organic Soil	LL (oven dried)/LL (not dried) < 0.75	OL	Organic silts and organic silty clays of low plasticity	
sieve	SILTS AND CLAYS	Inorganic soil	Plots below "A" line	МН	Inorganic silts, micaceous or diatomaceou fine sands or silts, clastic silts	
	(liquid limit 50 or more)	inorganic soil	Plots on or above "A" line	СН	Inorganic clays of high plasticity, fat clays	
		Organic Soil	LL (oven dried)/LL (not dried) < 0.75	ОН	Organic silts and organic clays of high plasticity	
Peat	Highly Organic	Primarily org	anie matter, dark in color, and organic odor	PT	Peat, muck and other highly organic soils	

\*Fines are those soil particles that pass the No. 200 sieve. For gravels and sands with between 5 and 12% fines, use of dual symbols is required (I.e. GW-GM, GW-GC, GP-GM, or GP-GC).

\*\*If the plasticity index is between 4 and 7 and it plots above the "A" line, then dual symbols (I.e. CL-ML) are required. the "A" line, then dual symbols (i.e. CL-ML) are required.

CONSISTENCY					
CLAYS AND PLASTIC SILTS	STRENGTH TON/SQ. FT	BLOWS: FOOT =			
VERY SOFT	0 - 1/4	0 - 2			
SOFT	1/4 - 1/2	2 - 4			
FIRM	1/2 - 1	4 - 8			
STIFF	1 - 2	8 - 16 -			
VERY STIFF	2 - 4	16 - 32			
HARD	Over 4	Over 32			


### RELATIVE DENSITY

SANDS, GRAVELS AND NON-PLASTIC SILTS	BLOWS: FOOT +
VERY LOOSE	0 - 4
LOOSE	4 - 10
MEDIUM DENSE	10 - 30
DENSE	30 - 50
VERY DENSE	Over 50

- + Number of blows of a 140-pound hammer falling 30inches to drive a 2-inch O.D. (1-3/8-inch I.D.) split spoon (ASTM D1586).
- ++ Unconfined compressive strength in tons/sq.ft. as determined by laboratory testing or approximated by the standard penetration test (ASTM D1586), pocket penetrometer, torvane, or visual observation.

### CLASSIFICATIONS BASED ON PERCENTAGE OF FINES

Less than 5%, Pass No. 200 (75mm)sieve) More than 12% Pass N. 200 (75 mm) sieve 5%-12% Pass No. 200 (75 mm) sieve GW, GP, SW, SP GM, GC, SM, SC Borderline Classification requiring use of dual symbols

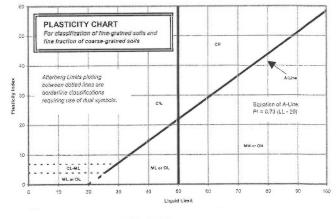

- Drilling Notes:
- Sampling and blow counts
   a. California Modified number of blows per foot of a 140 pound hummer falling 30 inches

  b. Standard Penetration Test – number of blows per
- 12 inches of a 140 pound hammer falling 30

Types of Samples: X - Sample

SPT - Standard Penetration

CA - California Modified
N - Nuclear Gauge
PO - Pocket Penetrometer (tons/sq.ft.)



220 High Street, San Luis Obispo, CA 93401

Phone: 805-543-8539

1021 Tama Lane, Ste 105, Santa Maria, CA 93455

Phone: 805-614-6333

201 S. Milpas St, Ste 103, Santa Barbara, CA 93103

**BORING LOG** 

BORING NO. B-1

3	=		LUTIO	ste roc	p, Santa P		305-966		JO	B NO.	SL	11157	-2			
			PROJE	CT INFORMATION				DRILLING INFORMATION								
DF DA	RILL		LOCATION: LED:	Parcel 9, North Ocea See Figure 3 February 22, 2019 JAP	ın			HOLE SAME	PLING	ETER: METHO LEVATI	8 DD: <b>S</b>	ME 55 Inche SPT and Not Rec	s	l		
De	pth	of Gr	oundwater:	Not Encountered	Boring	Ter	minate	d At: 1	5 Feet					Page	e 1 of 3	
DEРТН	ГТНОГОСУ	uscs	soi	L DESCRIPTION	SAMPLE ID	SAMPLERS TYPE	BLOWS/ 12 IN	N 1/60	MOISTURE CONTENT (%)	FINES CONTENT (%)	PLASTICITY INDEX (PI)	EXPANSION INDEX (EI)	OPTIMUM WATER CONTENT (%)	MAXIMUM DRY DENSITY (pcf)	COHESION, C (psf)	FRICTION ANGLE, (degrees)
0- 1- 2- 3-	\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\	CL CL	slightly moist	: very dark grayish brown, : black, slightly moist	A	^^^				57.8	32	62	12.4	120.0		
4— 5— 6— 7—	ンベングイングング	CL	very stiff	: light gray, slightly moist	В	^^^		30							544	25.3
8— 9— 10—	114444444		moderately ha	gray to light brown, rd, highly fractured, athered, slightly moist, mplex (Kfm)	CA		73	77							1409	9.7
12 — 13 — 14 — 15 —	14444444		hard	We.	SPT		38	54			25		10.4	127.6		
16 — - 17 — - 18 — - 19 —													æ			



220 High Street, San Luis Obispo, CA 93401

Phone: 805-543-8539

1021 Tama Lane, Ste 105, Santa Maria, CA 93455

Phone: 805-614-6333

201 S. Milpas St, Ste 103, Santa Barbara, CA 93103

Phone: 805-966-2200

**BORING LOG** 

**BORING NO. B-2** IOR NO SL11157-2

5	SOLUTIONS							Phone: 805-966-2200 <b>JOB NO. SL11157-2</b>							
			PROJECT INFORMATIO				DI	RILLIN	G INFO	ORMAT	ION				
DR DA LO	PROJECT: Parcel 9, North Ocean  DRILLING LOCATION: See Figure 3  DATE DRILLED: Febuary 22, 2019  LOGGED BY: JAP  Depth of Groundwater: 26 Feet Boring Termina					minate	HOL SAM APPI	LL RIG: E DIAM IPLING I ROX. EL	METHO EVATI	8 DD: <b>S</b>	ME 55 Inche SPT lot Rec	s		2 of 3	
					, PE							TER		(bst)	SLE,
ОЕРТН	ПТНОГОСУ	nscs	SOIL DESCRIPTION	SAMPLEID	SAMPLERS TYPE	BLOWS/ 12 IN	N 1/60	MOISTURE CONTENT (%)	FINES CONTENT (%)	PLASTICITY INDEX (PI)	EXPANSION INDEX (EI)	OPTIMUM WATER CONTENT (%)	MAXIMUM DRY DENSITY (pcf)	COHESION, C (psf)	FRICTION ANGLE, (degrees)
0-	111111	SM	SILTY SAND: light brown, with gra- and cobbles of sepentinite, loose, f	vel iill D	^^^				9.3	N.P.	0				
3— 4— 5—	44444	SM	SILTY SAND: light gray, moist, medense	dium SPT	X	11	22								
6— 7— 8— 9— 10—	199999999999		(fill) 1" layer of black CLAY with brick medium dense	SPT		9	14								
12 — 13 — 14 — 15 — 16 —		SM	SILTY SAND: light gray, slightly mo (alluvium) medium dense	oist SPT		13	18								
18 –				SPT	$\Box$	12	14								
25 — 26 — 27 — 28 — 29 — 30 — 31 — 32 —			saturated  CLAYSTONE: dark gray to olive gray	een,											
33 — 34 — 35 — 36 —	15,514.		moderately hard, slightly moist, high fractured, moderately weathered, Franciscan Complex (Kfm)			31	28								



220 High Street, San Luis Obispo, CA 93401

Phone: 805-543-8539

1021 Tama Lane, Ste 105, Santa Maria, CA 93455

Phone: 805-614-6333

201 S. Milpas St, Ste 103, Santa Barbara, CA 93103

# **BORING LOG**

**BORING NO.** SL11157-2 JOB NO

3	3		LUTIONS					PI	none: 8	05-966	-2200	JO	B NO.	SL <sup>2</sup>	11157	.2
			PROJECT INFOR	MATION						DF	RILLING	3 INFO	RMAT	ION		
DF DA LC	PROJECT: Parcel 9, North Ocean  DRILLING LOCATION: See Figure 3  DATE DRILLED: February 22, 2019  LOGGED BY: JAP  Depth of Groundwater: Not Encountered Boring Terminate						minate	HOLE SAMF APPR	OX. EL	METHO EVATI	8 DD: C	ME 55 Inches A and lot Rec	s SPT	Page	3 of 3	
	T															
DEPTH	ПТНОГОСУ	nscs	SOIL DESCRIPT	FION	SAMPLE ID	SAMPLERS TYPE	BLOWS/ 12 IN	N 1/60	MOISTURE CONTENT (%)	FINES CONTENT (%)	PLASTICITY INDEX (PI)	EXPANSION INDEX (EI)	OPTIMUM WATER CONTENT (%)	MAXIMUM DRY DENSITY (pcf)	COHESION, C (psf)	FRICTION ANGLE, (degrees)
0-		SM	SILTY SAND: light brown	, slightly moist												
2 -   3 -   4 -   5 -   6 -   7 -   8 -   9 -   11 -   12 -   13 -   14 -   15 -   16 -   17 -   18 -   18 -		SC	medium dense  CLAYEY SAND: dark brownoist  (fill) medium dense  SILTY SAND: dark gray, s (alluvium)	wn, slightly	SPT		5	8								
19 — 20 — 21 — 22 — 23 — 24 — 25 — 26 — 27 — 28 — 29 — 30 — 31 — 32 — 32 — 32 — 32 — 32 — 32 — 32			CLAYSTONE: dark gray to slightly moist, heavily fract moderately soft, moderate Franciscan Complex (Kfm	o olive green, tured, sly weathered,	SPT	X	23	21								

### **APPENDIX B**

Laboratory Testing
Soil Test Reports

### LABORATORY TESTING

This appendix includes a discussion of the test procedures and the laboratory test results performed as part of this investigation. The purpose of the laboratory testing is to assess the engineering properties of the soil materials at the Site. The laboratory tests are performed using the currently accepted test methods, when applicable, of the American Society for Testing and Materials (ASTM).

Undisturbed and disturbed bulk samples used in the laboratory tests are obtained from various locations during the course of the field exploration, as discussed in **Appendix A** of this report. Each sample is identified by sample letter and depth. The Unified Soils Classification System is used to classify soils according to their engineering properties. The various laboratory tests performed are described below:

**Expansion Index of Soils** (ASTM D4829) is conducted in accordance with the ASTM test method and the California Building Code Standard, and are performed on representative bulk and undisturbed soil samples. The purpose of this test is to evaluate expansion potential of the site soils due to fluctuations in moisture content. The sample specimens are placed in a consolidometer, surcharged under a 144-psf vertical confining pressure, and then inundated with water. The amount of expansion is recorded over a 24-hour period with a dial indicator. The expansion index is calculated by determining the difference between final and initial height of the specimen divided by the initial height.

Laboratory Compaction Characteristics of Soil Using Modified Effort (ASTM D1557) is performed to determine the relationship between the moisture content and density of soils and soil-aggregate mixtures when compacted in a standard size mold with a 10-lbf hammer from a height of 18 inches. The test is performed on a representative bulk sample of bearing soil near the estimated footing depth. The procedure is repeated on the same soil sample at various moisture contents sufficient to establish a relationship between the maximum dry unit weight and the optimum water content for the soil. The data, when plotted, represents a curvilinear relationship known as the moisture density relations curve. The values of optimum water content and modified maximum dry unit weight can be determined from the plotted curve.

**Liquid Limit, Plastic Limit, and Plasticity Index of Soils** (ASTM D4318) are the water contents at certain limiting or critical stages in cohesive soil behavior. The liquid limit (LL or  $W_L$ ) is the lower limit of viscous flow, the plastic limit (PL or  $W_P$ ) is the lower limit of the plastic stage of clay and plastic index (PI or  $I_P$ ) is a range of water content where the soil is plastic. The Atterberg Limits are performed on samples that have been screened to remove any material retained on a No. 40 sieve. The liquid limit is determined by performing trials in which a portion of the sample is spread in a brass cup, divided in two by a grooving tool, and then allowed to flow together from the shocks caused by repeatedly dropping the cup in a standard mechanical device. To determine the Plastic Limit a small portion of plastic soil is alternately pressed together and rolled into a 1/8-inch diameter thread. This process is continued until the water content of the sample is reduced to a point at which the thread crumbles and can no longer be pressed together and re-rolled. The water content of the soil at this point is reported as the plastic limit. The plasticity index is calculated as the difference between the liquid limit and the plastic limit.

Direct Shear Tests of Soils Under Consolidated Drained Conditions (ASTM D3080) is performed on undisturbed and remolded samples representative of the foundation material. The samples are loaded with a predetermined normal stress and submerged in water until saturation is achieved. The samples are then sheared horizontally at a controlled strain rate allowing partial drainage. The shear stress on the sample is recorded at regular strain intervals. This test determines the resistance to deformation, which is shear strength, inter-particle attraction or cohesion c, and resistance to interparticle slip called the angle of internal friction  $\phi$ .

**Particle Size Analysis of Soils** (ASTM D422) is used to determine the particle-size distribution of fine and coarse aggregates. In the test method the sample is separated through a series of sieves of progressively smaller openings for determination of particle size distribution. The total percentage passing each sieve is reported and used to determine the distribution of fine and coarse aggregates in the sample.

GEO.


Density of Soil in Place by the Drive-Cylinder Method (ASTM D2937) and Laboratory Determination of Water (Moisture) Content of Soil and Rock by Mass (ASTM D2216) are used to obtain values of inplace water content and in-place density. Undisturbed samples, brought from the field to the laboratory, are weighed, the volume is calculated, and they are placed in the oven to dry. Once the samples have been dried, they are weighed again to determine the water content, and the in-place density is then calculated. The moisture density tests allow the water content and in-place densities to be obtained at required depths.


Ge080.	lutions, Inc.		so	ILS RI	EPORT		(805) 543	3-8539
Project:	Parcel 9 N. Ocean	n Avenue				Date Tested:	February 26, 2019	
Client:	1 4100. > 1 11 0 0 0 41	11101140				Project #:	SL11157-1	
Sample:	A	Depth:	2.0 Feet			Lab #:	17742	
Location:	B-1	Берш.	2.0 1 001			Sample Date:	February 22, 2019	
Location.	D-1					Sampled By:	JP	
						Sampled By.	31	
	Soil Classifica		I		Labo	ratory Maximum D	ensity	
	ASTM D2487, I					ASTM D1557		
Result:	Very Dark Grayis CLAY	sh Brown Sandy		88				
Specification:		CL	1	.22	1			
	Sieve Analy	sis	1					
	ASTM D42		1	.20				
Sieve	Percent	Project	1	E.			-	
Size	Passing	Specifications	<b>4</b> 1	18		/		
3"	1 HOULE	- Poortioutions	Dry Density, pcf	Ē				
2"	<b>†</b>	<del>                                     </del>	<b>1</b> 🚉 1	16				
1 1/2"			l su l	-				
1"	-	+	┨ 🧸 1	14				
3/4"			<b>ብ</b> ፩ ՝					
	07			12		4		
No. 4	97		-l 1	12				
No. 8	94		4	E				
No. 16	90		1 1	10				
No. 30	87		1	E				
No. 50	81		1	08				
No. 100	67		1	0	5	10	15	20
No. 200	57.8		]				,	
	Sand Equivalent	Cal 217	1			Water Content, 9	6	
1		SE						
2			Mold ID		n/a	Mold Diameter, ins	S	4.00
3			No. of Laye	ers	5	Weight of Rammer	, lbs.	10.00
4			No. of Blow		25			
	Plasticity Ind					_		
	ASTM D431	8						
	110 11/120 10 1				7	a: a	2.64	
Liquid Limit:		47	Estimated S	pecific C	mavity for 100%	Saturation Curve =	2.04	
Liquid Limit:			Estimated S Trial #	pecific (	1	Saturation Curve = 2	3	4
lastic Limit:		47					, , , , , , , , , , , , , , , , , , , ,	4 18.1
lastic Limit:	С	47 15 32	Trial # Water Conte	ent:	1 8.0	11.0	3 14.4	18.1
lastic Limit:	:: Expansion Inc	47 15 32 dex	Trial # Water Cont Dry Density	ent:	1 8.0 112.6	2	3	
Plastic Limit: Plasticity Index	Expansion Inc ASTM D482	47 15 32 dex	Trial # Water Cont Dry Density Maximum I	ent:   v:   Ory Dens	1 8.0 112.6 sity, pcf:	2 11.0 119.4 120.0	3 14.4	18.1
Plastic Limit: Plasticity Index Expansion Inde	CEEEEEEEEEEEEEEEEEEEEEEEEEEEEEEEEEEEEE	47 15 32 dex 99 62	Trial # Water Cont Dry Density	ent:   v:   Ory Dens	1 8.0 112.6 sity, pcf:	2 11.0 119.4	3 14.4	18.1
Plastic Limit: Plasticity Index Expansion Index Expansion Pote	Expansion In  ASTM D482 ex: ential;	47 15 32 dex	Trial # Water Cont Dry Density Maximum I	ent:   v:   Ory Dens	1 8.0 112.6 sity, pcf:	2 11.0 119.4 120.0	3 14.4	18.1
Plastic Limit: Plasticity Index Expansion Index Expansion Pote	Expansion In  ASTM D482 ex: ential;	47 15 32 dex 29 62 Medium 50	Trial # Water Conton Dry Density Maximum I Optimum W	ent:   v:   Ory Dens Vater Con	1 8.0 112.6 sity, pcf: ntent, %:	2 11.0 119.4 120.0 12.4	3 14.4	18.1
lastic Limit: lasticity Index expansion Index expansion Potenitial Saturatio	Expansion In ASTM D482 ex: ential: on, %:	47 15 32 dex 29 62 Medium 50 Moisture-Den	Trial # Water Content Dry Density Maximum I Optimum W	ent:   v:   Dry Dens	1 8.0 112.6 sity, pcf: ntent, %:	2 11.0 119.4 120.0 12.4 t ASTM D2216	3 14.4 118.8	18.1
lastic Limit: lasticity Index expansion Index expansion Pote	Expansion In  ASTM D482 ex: ential;	47 15 32 dex 29 62 Medium 50 Moisture-Den	Trial # Water Content Dry Density Maximum I Optimum W	ent:   v:   Dry Dens	1 8.0 112.6 sity, pcf: ntent, %:	2 11.0 119.4 120.0 12.4	3 14.4 118.8	18.1
lastic Limit: lasticity Index xpansion Index xpansion Pote nitial Saturatio	Expansion In ASTM D482 ex: ential: on, %:	47 15 32 dex 29 62 Medium 50 Moisture-Den	Trial # Water Content Dry Density Maximum I Optimum W	ent:   v:   Dry Dens	1 8.0 112.6 sity, pcf: ntent, %:	2 11.0 119.4 120.0 12.4 t ASTM D2216	3 14.4 118.8	18.1
lastic Limit: lasticity Index expansion Index expansion Potenitial Saturatio	Expansion In ASTM D482 ex: ential: on, %:	47 15 32 dex 29 62 Medium 50 Moisture-Den	Trial # Water Content Dry Density Maximum I Optimum W	ent:   v:   Dry Dens	1 8.0 112.6 sity, pcf: ntent, %:	2 11.0 119.4 120.0 12.4 t ASTM D2216	3 14.4 118.8	18.1
Plastic Limit: Plasticity Index Expansion Index Expansion Pote initial Saturatio	Expansion In ASTM D482 ex: ential: on, %:	47 15 32 dex 29 62 Medium 50 Moisture-Den	Trial # Water Content Dry Density Maximum I Optimum W	ent:   v:   Dry Dens	1 8.0 112.6 sity, pcf: ntent, %:	2 11.0 119.4 120.0 12.4 t ASTM D2216	3 14.4 118.8	18.1
Plastic Limit: Plasticity Index Expansion Index Expansion Pote initial Saturatio	Expansion In ASTM D482 ex: ential: on, %:	47 15 32 dex 29 62 Medium 50 Moisture-Den	Trial # Water Content Dry Density Maximum I Optimum W	ent:   v:   Dry Dens	1 8.0 112.6 sity, pcf: ntent, %:	2 11.0 119.4 120.0 12.4 t ASTM D2216	3 14.4 118.8	18.1
Plastic Limit: Plasticity Index Expansion Index Expansion Pote initial Saturatio	Expansion In ASTM D482 ex: ential: on, %:	47 15 32 dex 29 62 Medium 50 Moisture-Den	Trial # Water Content Dry Density Maximum I Optimum W	ent:   v:   Dry Dens	1 8.0 112.6 sity, pcf: ntent, %:	2 11.0 119.4 120.0 12.4 t ASTM D2216	3 14.4 118.8	18.1
Plastic Limit: Plasticity Index Expansion Index Expansion Pote initial Saturatio	Expansion In ASTM D482 ex: ential: on, %:	47 15 32 dex 29 62 Medium 50 Moisture-Den	Trial # Water Content Dry Density Maximum I Optimum W	ent:   v:   Dry Dens	1 8.0 112.6 sity, pcf: ntent, %:	2 11.0 119.4 120.0 12.4 t ASTM D2216	3 14.4 118.8	18.1
Plastic Limit: Plasticity Index Expansion Index Expansion Pote initial Saturatio	Expansion In ASTM D482 ex: ential: on, %:	47 15 32 dex 29 62 Medium 50 Moisture-Den	Trial # Water Content Dry Density Maximum I Optimum W	ent:   v:   Dry Dens	1 8.0 112.6 sity, pcf: ntent, %:	2 11.0 119.4 120.0 12.4 t ASTM D2216	3 14.4 118.8	18.1
Plastic Limit: Plasticity Index Expansion Index Expansion Pote initial Saturatio	Expansion In ASTM D482 ex: ential: on, %:	47 15 32 dex 29 62 Medium 50 Moisture-Den	Trial # Water Content Dry Density Maximum I Optimum W	ent:   v:   Dry Dens	1 8.0 112.6 sity, pcf: ntent, %:	2 11.0 119.4 120.0 12.4 t ASTM D2216	3 14.4 118.8	18.1
Plastic Limit: Plasticity Index Expansion Index Expansion Pote initial Saturatio	Expansion In ASTM D482 ex: ential: on, %:	47 15 32 dex 29 62 Medium 50 Moisture-Den	Trial # Water Content Dry Density Maximum I Optimum W	ent:   v:   Dry Dens	1 8.0 112.6 sity, pcf: ntent, %:	2 11.0 119.4 120.0 12.4 t ASTM D2216	3 14.4 118.8	18.1


### **DIRECT SHEAR TEST** GeoSolutions, Inc. (805) 543-8539 **SUMMARY REPORT (ASTM D3080)** Project: Parcel 9 North Ocean Project No.: SL11157-1 Client: Date Tested: 2/25/2019 Sample No.: B-1 @ 4' Depth: 4.0 Feet Lab No.: 17742 Checked By: AE B-1 Location:

MATERIAL DESCRIPTION	LL	PL	PI	% passing No. 200	Gs *	Sample Type
Light Olive Brown Sandy CLAY	nm	nm	nm	nm	2.7	in-situ (rings)

<sup>\*</sup> Gs = assumed; nm = not measured







Initial	Specimen No.							
Conditions	1	2	3					
Dry Density	108.7	100.6	111.0					
Water Content (%)	10.9	10.9	10.9					
Diameter (in)	2.42	2.42	2.42					
Sample Height (in)	1.00	1.00	1.00					

Angle of Internal Friction, ø <sub>peak</sub> (degrees):	25.3
Cohesion, C <sub>peak</sub> (psf)	544


Test Data		Specimen No.	
1 est Data	1	2	3
Normal Stress (ksf)	2.00	3.00	4.00
Peak Shear Stress (ksf)	1.46	2.01	2.40
Horiz. Displacement at Peak Shear (in)	0.24	0.24	0.24
Ultimate Shear Stress (ksf)	1.46	2.01	2.40
Horiz. Displ. at Ult. Shear (in)	0.24	0.24	0.24
Rate of Deformation (in/min)	0.004	0.004	0.004


Remarks:

### **DIRECT SHEAR TEST** (805) 543-8539 GeoSolutions, Inc. **SUMMARY REPORT (ASTM D3080)** Project: Parcel 9 North Ocean Project No.: SL11157-1 Date Tested: 2/27/2019 Client: Lab No.: 17742 Sample No.: B-1 @ 9' Depth: 9.0 Feet Checked By: AE B-1 Location:

MATERIAL DESCRIPTION	LL	PL	ΡI	% passing No. 200	Gs *	Sample Type
Light Olive Brown Sandy CLAY	nm	nm	nm	nm	2.7	in-situ (rings)

<sup>\*</sup> Gs = assumed; nm = not measured





	4.0 E	O Peak	
	3.5	O Peak Δ Ultimate	
(st)	3.0	—Linear (Peak)	
l) sse	2.5		
Shear Stress (ksf)	2.0		
Shea	1.5		
	1.0		
	0.5		
	0.0		
	0.0	1.0 2.0 3.0 4.0 Normal Stress (ksf)	)
r			

Initial	Specimen No.							
Conditions	1	2	3					
Dry Density	117.5	119.9	126.5					
Water Content (%)	6.9	6.9	6.9					
Diameter (in)	2.42	2.42	2.42					
Sample Height (in)	1.00	1.00	1.00					

Angle of Internal Friction, Øpeak (degrees):	9.7
Cohesion, C <sub>peak</sub> (psf)	1409

Test Data	Specimen No.				
1 est Data	1	2	3		
Normal Stress (ksf)	2.00	3.00	4.00		
Peak Shear Stress (ksf)	1.74	1.94	2.08		
Horiz. Displacenent at Peak Shear (in)	0.19	0.15	0.18		
Ultimate Shear Stress (ksf)	1.59	1.83	2.03		
Horiz. Displ. at Ult. Shear (in)	0.24	0.24	0.24		
Rate of Deformation (in/min)	0.004	0.004	0.004		

Remarks: Saturated

GeoSol	lutions, Inc.		SOILS	REPORT		(805) 54	43-8539
Project:	Parcel 9 N. Ocean	n Avenue			Date Tested:	February 25, 2019	9
Client:					Project #:	SL11157-1	
ample:	С	Depth:	12.0 Feet		Lab #:	17742	
ocation:	B-1	D T P III	12.0100		Sample Date:	February 22, 2019	
ocation.	D-1				Sampled By:	Л	
	Soil Classifica			Lab	oratory Maximum I	Density	
	ASTM D2487, I				ASTM D1557		
Result:	Light Olive Brow	n Clayey SAND					
Specification:		SC	129	F I			
	Sieve Analy	sis	128				
	ASTM D42		120	E			
Sieve	Percent	Project	127				
Size	Passing	Specifications	<b>5</b> 126				
3"	1 dashing	Specifications	<u>a</u> 120				
			125 €				
2"			- ig 124	F			
1 1/2"			124 ق				
1"			126 125 125 124 123				
3/4"							
No. 4			122				
No. 8			121		/		
No. 16			1				
No. 30	A STATE OF THE PARTY OF THE PAR	Paralle Cartilla	120			1	
No. 50			119	F			
No. 100			1	0 5	10	15	20
No. 200			1				
	Sand Equivalent	Cal 217	1		Water Content, 9	%	
1		SE	1				
2			Mold ID	n/a	Mold Diameter, in	S.	4.00
3	The second seconds		No. of Layers	5	Weight of Rammer		10.00
4			No. of Blows	25		., 100.	10.00
	Plasticity Ind	ex					
	ASTM D431		1				
iquid Limit:	71011112101	35	Estimated Speci	fic Gravity for 100%	Saturation Curve =	2.69	
lastic Limit:		10	Trial #	1	2	3	1 4
asticity Index		25	Water Content:	5.8	8.9	11.7	14.6
aborery index			Dry Density:	120.2	126.8	126.8	119.6
	ASTM D482		Maximum Dry I		127.6	120.0	1 119.0
xpansion Inde			Optimum Water		10.4	1	
xpansion Inde			Optimum water	Coment, 70.	1 10.4	1	
itial Saturatio			1				
mai Saturatio	11, 70.	Moisture Don	sity ASTM D202	7, Moisture Conte	nt ASTM D2216		No. of Concession, Name of Street, or other party of the Concession, Name of Street, or other pa
Sample	Depth (ft)				y Sample Description	n	
Sample	Deptii (it)	Water Content (%)	Dry Delisity (pt	1) Kciauve Delisit	, Dampie Description		
							A STREET OF STREET
						the state of the s	
	A STATE OF THE STA		MARINATAR		E CHARLES SON		
	STATE OF THE PARTY		TO MINISTER				
	THE WALL WAS					The state of the s	
	The second secon			THE PERSON NAMED IN COLUMN TWO IS NOT THE OWNER.			
			The state of the s	the second second	AND RESIDENCE OF THE PARTY OF T		State of the later of the

Project:	Parcel 9 N. Ocean	n Avenue			Date Tested:	February 25, 2019			
Client:					Project #:	SL11157-			
Sample:	D	Depth:	2.0 Feet		Lab #:	17742			
Location:	B-2				Sample Date:	February 22, 2019			
					Sampled By:	J!	P		
	Soil Classifica	ntion		ĭ.al	ooratory Maximum D	Density			
	ASTM D2487, I		ASTM D1557						
Result:	Dark Grayish Bro SAND with Silt	own Poorly Graded							
Specification:		SP-SM	119		- T				
Sieve Analysis		118							
	ASTM D42		116						
Sieve	Percent	Project	117						
Size	Passing	Specifications	₹						
3"			116						
2"			Dd. 116						
1 1/2"			7 5						
1"	-	9	114		/				
3/4"			113						
No. 4	95		] "						
No. 8	91		112						
No. 16	87		111						
No. 30	83		] '''						
No. 50	69		140		1 * 1				
	09		110 +						
No. 100	19		110 +	2	4 6	8 10	12		
	19 9.3		-	2			12		
No. 100	19		-	2	4 6 Water Content, 9		12		
No. 100 No. 200	19 9.3	Cal 217	0		Water Content, 9	%			
No. 100 No. 200	19 9.3		0 Mold ID	n/a	Water Content, 9	% s.	4.00		
No. 100 No. 200	19 9.3		Mold ID No. of Layers	n/a 5	Water Content, 9	% s.			
No. 100 No. 200	19 9.3 Sand Equivalent	SE SE	0 Mold ID	n/a	Water Content, 9	% s.	4.00		
No. 100 No. 200	19 9.3 Sand Equivalent Plasticity Ind	SE	Mold ID No. of Layers	n/a 5	Water Content, 9	% s.	4.00		
No. 100 No. 200 1 2 3 4	19 9.3 Sand Equivalent	SE SE	Mold ID No. of Layers No. of Blows	n/a 5 25	Mold Diameter, ins Weight of Rammer	s. r, Ibs.	4.00		
No. 100 No. 200  1 2 3 4	19 9.3 Sand Equivalent Plasticity Ind	SE  dex  8  N/A	Mold ID No. of Layers No. of Blows  Estimated Specific	n/a 5 25 c Gravity for 1009	Water Content, 9  Mold Diameter, ins Weight of Rammer	s. r, Ibs.	4.00		
No. 100 No. 200  1 2 3 4  siquid Limit:	19 9.3 Sand Equivalent Plasticity Ind ASTM D431	SE  dex  18  N/A  N/A	Mold ID No. of Layers No. of Blows  Estimated Specifi Trial #	n/a 5 25 c Gravity for 1009	Water Content, 9  Mold Diameter, ins Weight of Rammer  % Saturation Curve =	s. r, Ibs.	4.00		
No. 100 No. 200  1 2 3 4	19 9.3 Sand Equivalent Plasticity Ind ASTM D431	SE  lex 18 N/A N/A Non-Plastic	Mold ID No. of Layers No. of Blows  Estimated Specifi Trial # Water Content:	n/a 5 25 c Gravity for 1009 1 5.0	Water Content, 9  Mold Diameter, ins Weight of Rammer  Weight of Curve =  2  8.5	2.38 3 10.9	4.00		
No. 100 No. 200  1 2 3 4  siquid Limit:	19 9.3 Sand Equivalent Plasticity Ind ASTM D431	SE  dex  8  N/A  N/A  Non-Plastic  dex	Mold ID No. of Layers No. of Blows  Estimated Specifi Trial # Water Content: Dry Density:	n/a 5 25 c Gravity for 1009 1 5.0 110.4	Water Content, 9  Mold Diameter, ins Weight of Rammer  % Saturation Curve =  2  8.5  117.4	s. r, Ibs.	4.00		
No. 100 No. 200  1 2 3 4  Liquid Limit: clastic Limit: clasticity Index	9,3 Sand Equivalent Plasticity Ind ASTM D431  Expansion Ind ASTM D482	SE  dex  18  N/A  N/A  Non-Plastic  dex  19	Mold ID No. of Layers No. of Blows  Estimated Specifi Trial # Water Content: Dry Density: Maximum Dry Do	n/a 5 25 c Gravity for 1009 1 5.0 110.4 ensity, pcf:	Water Content, 9  Mold Diameter, ins Weight of Rammer  % Saturation Curve =  2  8.5  117.4  117.8	2.38 3 10.9	4.00		
No. 100 No. 200  1 2 3 4  Liquid Limit: Plastic Limit: Plasticity Index	Plasticity Ind ASTM D431  Expansion Ind ASTM D482	SE  dex  18  N/A  N/A  Non-Plastic  dex  29  0	Mold ID No. of Layers No. of Blows  Estimated Specifi Trial # Water Content: Dry Density:	n/a 5 25 c Gravity for 1009 1 5.0 110.4 ensity, pcf:	Water Content, 9  Mold Diameter, ins Weight of Rammer  % Saturation Curve =  2  8.5  117.4	2.38 3 10.9	4.00		
No. 100 No. 200  1 2 3 4  Liquid Limit: Plastic Limit: Plasticity Index	Plasticity Ind ASTM D431  Expansion Ind ASTM D482  ex: ential:	SE  dex  18  N/A  N/A  Non-Plastic  dex  29  0  Very Low	Mold ID No. of Layers No. of Blows  Estimated Specifi Trial # Water Content: Dry Density: Maximum Dry Do	n/a 5 25 c Gravity for 1009 1 5.0 110.4 ensity, pcf:	Water Content, 9  Mold Diameter, ins Weight of Rammer  % Saturation Curve =  2  8.5  117.4  117.8	2.38 3 10.9	4.00		
No. 100 No. 200  1 2 3 4  Liquid Limit: Clastic Limit: Clasticity Index Expansion Index Expansion Pote	Plasticity Ind ASTM D431  Expansion Ind ASTM D482  ex: ential:	SE  dex  18  N/A  Non-Plastic  dex  29  0  Very Low  50	Mold ID No. of Layers No. of Blows  Estimated Specifi Trial # Water Content: Dry Density: Maximum Dry Do Optimum Water Content	n/a 5 25  c Gravity for 1009 1 5.0 110.4 ensity, pcf: Content, %:	Water Content, 9  Mold Diameter, ins Weight of Rammer  % Saturation Curve =  2  8.5  117.4  117.8  9.2	2.38 3 10.9	4.00		
No. 100 No. 200  1 2 3 4  iquid Limit: lastic Limit: lasticity Index xpansion Index xpansion Potential Saturation	19 9.3  Sand Equivalent  Plasticity Ind ASTM D431  Expansion In ASTM D482 ex: ential: on, %:	SE  dex  18  N/A  Non-Plastic  dex  29  0  Very Low  50  Moisture-Der	Mold ID No. of Layers No. of Blows  Estimated Specifi Trial # Water Content: Dry Density: Maximum Dry Do Optimum Water Contents	n/a 5 25 c Gravity for 1009 1 5.0 110.4 ensity, pcf: Content, %:	Mold Diameter, ins   Weight of Rammer   Weight of Rammer 	2.38 3 10.9 116.6	4.00		
No. 100 No. 200  1 2 3 4  Liquid Limit: Clastic Limit: Clasticity Index Expansion Index Expansion Pote	Plasticity Ind ASTM D431  Expansion Ind ASTM D482  ex: ential:	SE  dex  18  N/A  Non-Plastic  dex  29  0  Very Low  50  Moisture-Der	Mold ID No. of Layers No. of Blows  Estimated Specifi Trial # Water Content: Dry Density: Maximum Dry Do Optimum Water Contents	n/a 5 25 c Gravity for 1009 1 5.0 110.4 ensity, pcf: Content, %:	Water Content, 9  Mold Diameter, ins Weight of Rammer  % Saturation Curve =  2  8.5  117.4  117.8  9.2	2.38 3 10.9 116.6	4.00		
No. 100 No. 200  1 2 3 4  Liquid Limit: Plastic Limit: Plasticity Index Expansion Index Expansion Potential Saturation	19 9.3  Sand Equivalent  Plasticity Ind ASTM D431  Expansion In ASTM D482 ex: ential: on, %:	SE  dex  18  N/A  Non-Plastic  dex  29  0  Very Low  50  Moisture-Der	Mold ID No. of Layers No. of Blows  Estimated Specifi Trial # Water Content: Dry Density: Maximum Dry Do Optimum Water Contents	n/a 5 25 c Gravity for 1009 1 5.0 110.4 ensity, pcf: Content, %:	Mold Diameter, ins   Weight of Rammer   Weight of Rammer 	2.38 3 10.9 116.6	4.00		
No. 100 No. 200  1 2 3 4  Liquid Limit: Plastic Limit: Plasticity Index Expansion Index Expansion Potential Saturation	19 9.3  Sand Equivalent  Plasticity Ind ASTM D431  Expansion In ASTM D482 ex: ential: on, %:	SE  dex  18  N/A  Non-Plastic  dex  29  0  Very Low  50  Moisture-Der	Mold ID No. of Layers No. of Blows  Estimated Specifi Trial # Water Content: Dry Density: Maximum Dry Do Optimum Water Contents	n/a 5 25 c Gravity for 1009 1 5.0 110.4 ensity, pcf: Content, %:	Mold Diameter, ins   Weight of Rammer   Weight of Rammer 	2.38 3 10.9 116.6	4.00		
No. 100 No. 200  1 2 3 4  iquid Limit: lastic Limit: lasticity Index xpansion Index xpansion Potential Saturation	19 9.3  Sand Equivalent  Plasticity Ind ASTM D431  Expansion In ASTM D482 ex: ential: on, %:	SE  dex  18  N/A  Non-Plastic  dex  29  0  Very Low  50  Moisture-Der	Mold ID No. of Layers No. of Blows  Estimated Specifi Trial # Water Content: Dry Density: Maximum Dry Do Optimum Water Contents	n/a 5 25 c Gravity for 1009 1 5.0 110.4 ensity, pcf: Content, %:	Mold Diameter, ins   Weight of Rammer   Weight of Rammer 	2.38 3 10.9 116.6	4.00		
No. 100 No. 200  1 2 3 4  Liquid Limit: Plastic Limit: Plasticity Index Expansion Index Expansion Potential Saturation	19 9.3  Sand Equivalent  Plasticity Ind ASTM D431  Expansion In ASTM D482 ex: ential: on, %:	SE  dex  18  N/A  Non-Plastic  dex  29  0  Very Low  50  Moisture-Der	Mold ID No. of Layers No. of Blows  Estimated Specifi Trial # Water Content: Dry Density: Maximum Dry Do Optimum Water Contents	n/a 5 25 c Gravity for 1009 1 5.0 110.4 ensity, pcf: Content, %:	Mold Diameter, ins   Weight of Rammer   Weight of Rammer 	2.38 3 10.9 116.6	4.00		
No. 100 No. 200  1 2 3 4  Liquid Limit: Plastic Limit: Plasticity Index Expansion Index Expansion Potential Saturation	19 9.3  Sand Equivalent  Plasticity Ind ASTM D431  Expansion In ASTM D482 ex: ential: on, %:	SE  dex  18  N/A  Non-Plastic  dex  29  0  Very Low  50  Moisture-Der	Mold ID No. of Layers No. of Blows  Estimated Specifi Trial # Water Content: Dry Density: Maximum Dry Do Optimum Water Contents	n/a 5 25 c Gravity for 1009 1 5.0 110.4 ensity, pcf: Content, %:	Mold Diameter, ins   Weight of Rammer   Weight of Rammer 	2.38 3 10.9 116.6	4.00		
No. 100 No. 200  1 2 3 4  Liquid Limit: Plastic Limit: Plasticity Index Expansion Index Expansion Potential Saturation	19 9.3  Sand Equivalent  Plasticity Ind ASTM D431  Expansion In ASTM D482 ex: ential: on, %:	SE  dex  18  N/A  Non-Plastic  dex  29  0  Very Low  50  Moisture-Der	Mold ID No. of Layers No. of Blows  Estimated Specifi Trial # Water Content: Dry Density: Maximum Dry Do Optimum Water Contents	n/a 5 25 c Gravity for 1009 1 5.0 110.4 ensity, pcf: Content, %:	Mold Diameter, ins   Weight of Rammer   Weight of Rammer 	2.38 3 10.9 116.6	4.00		
No. 100 No. 200  1 2 3 4  iquid Limit: lastic Limit: lasticity Index xpansion Index xpansion Potential Saturation	19 9.3  Sand Equivalent  Plasticity Ind ASTM D431  Expansion In ASTM D482 ex: ential: on, %:	SE  dex  18  N/A  Non-Plastic  dex  29  0  Very Low  50  Moisture-Der	Mold ID No. of Layers No. of Blows  Estimated Specifi Trial # Water Content: Dry Density: Maximum Dry Do Optimum Water Contents	n/a 5 25 c Gravity for 1009 1 5.0 110.4 ensity, pcf: Content, %:	Mold Diameter, ins   Weight of Rammer   Weight of Rammer 	2.38 3 10.9 116.6	4.00		
No. 100 No. 200  1 2 3 4  Liquid Limit: Plastic Limit: Plasticity Index Expansion Index Expansion Potential Saturation	19 9.3  Sand Equivalent  Plasticity Ind ASTM D431  Expansion In ASTM D482 ex: ential: on, %:	SE  dex  18  N/A  Non-Plastic  dex  29  0  Very Low  50  Moisture-Der	Mold ID No. of Layers No. of Blows  Estimated Specifi Trial # Water Content: Dry Density: Maximum Dry Do Optimum Water Contents	n/a 5 25 c Gravity for 1009 1 5.0 110.4 ensity, pcf: Content, %:	Mold Diameter, ins   Weight of Rammer   Weight of Rammer 	2.38 3 10.9 116.6	4.00		

### **DIRECT SHEAR TEST** (805) 543-8539 GeoSolutions, Inc. **SUMMARY REPORT (ASTM D3080)** Parcel 9 N. Ocean Avenue Project No.: SL11157-1 Project: Date Tested: 2/26/2019 Client: Sample No.: B-3 @ 4' Depth: 4.0 Feet Lab No.: 17742 Location: B-3 Checked By: AE % passing MATERIAL DESCRIPTION PΙ Gs \* Sample Type LL PLNo. 200 Olive Brown Poorly Graded SAND with Silt 2.7 in-situ (rings) $\mathbf{n}\mathbf{n}$ nmnm \* Gs = assumed; nm = not measured $\sigma = 1 \text{ ksf} - \sigma = 2 \text{ ksf}$ $-\sigma = 3 \text{ ksf } - \cdots \sigma = 4 \text{ ksf}$ $\sigma = 1 \text{ ksf}$ $\sigma = 2 \text{ ksf}$ $\sigma = 3 \text{ ksf}$ $-\cdots \sigma = 4 \text{ ksf}$ O Peak △ Ultimate 0.000 3.0 0.002 Vertical Displacement (in) 2.5 Shear Stress (ksf) 0.004 2.0 0.006 1.5 0.008 1.0 0.010 0.012 0.5 0.014 0.0 0.00 0.10 0.20 0.00 0.05 0.10 0.15 0.20 Horizontal Displacement (in) Horizontal Displacement (in) 4.0 Initial Specimen No. O Peak Conditions 3.5 △ Ultimate 94.7 101.4 100.2 Dry Density 100.2 5.7 Water Content (%) 5.7 5.7 -Linear (Peak) 3.0 Shear Stress (ksf) 2.42 Diameter (in) 2.42 2.42 2.42 2.5 Sample Height (in) 1.00 1.00 1.00 1.00 2.0 Specimen No. Test Data 1.5 Normal Stress (ksf) 1.00 2.00 3.00 4.00 1.0 Peak Shear Stress (ksf) 0.62 1.36 1.75 2.61 Horiz. Displacement at 0.5 0.22 0.17 0.13 0.15 Peak Shear (in) 0.0 Ultimate Shear Stress (ksf) 0.55 1.56 2.43 0.0 2.0 3.0 4.0 Horiz. Displ. at Ult. Shear Normal Stress (ksf) 0.24 0.24 0.24 0.24 (in) Angle of Internal Friction, $\phi_{peak}$ (degrees): 32.4 Rate of Deformation 0.024 0.024 0.024 0.024 (in/min) Cohesion, Cpeak (psf) 0 Remarks:

B 6

# APPENDIX C

Seismic Hazard Analysis

Design Map Summary (SEAOC, 2018)

### SEISMIC HAZARD ANALYSIS

According to section 1613 of the 2016 CBC (CBSC, 2016), all structures and portions of structures should be designed to resist the effects of seismic loadings caused by earthquake ground motions in accordance with the ASCE 7: Minimum Design Loads for Buildings and Other Structures, hereafter referred to as ASCE7-10 (ASCE, 2013). Estimating the design ground motions at the Site depends on many factors including the distance from the Site to known active faults; the expected magnitude and rate of recurrence of seismic events produced on such faults; the source-to-site ground motion attenuation characteristics; and the Site soil profile characteristics. As per section 1613.3.2 of the 2016 CBC, the Site soil profile classification is determined by the average soil properties in the upper 100 feet of the Site profile and can be determined based on the criteria provided in Table 20.3-1 of ASCE7-10.

ASCE7-10 provides recommendations for estimating site-specific ground motion parameters for seismic design considering a Risk-targeted Maximum Considered Earthquake (MCE<sub>R</sub>) in order to determine design spectral response accelerations and a Maximum Considered Earthquake Geometric Mean (MCE<sub>G</sub>) in order to determine probabilistic geometric mean peak ground accelerations.

Spectral accelerations from the MCE<sub>R</sub> are based on a 5% damped acceleration response spectrum and a 1% exceedance in 50 years (4975-year return period). *Maximum* short period ( $S_s$ ) and 1-second period ( $S_1$ ) spectral accelerations are interpolated from the MCE<sub>R</sub>-based ground motion parameter maps for bedrock, provided in ASCE7-10. These spectral accelerations are then multiplied by site-specific coefficients ( $F_a$ ,  $F_v$ ), based on the Site soil profile classification and the maximum spectral accelerations determined for bedrock, to yield the *maximum* short period ( $S_{MS}$ ) and 1-second period ( $S_{M1}$ ) spectral response accelerations at the Site. According to section 11.2 of ASCE7-10 and section 1613 of the 2016 CBC, buildings and structures should be specifically proportioned to resist *design* earthquake ground motions. Section 1613.3.4 of the 2016 CBC indicates the site-specific *design* spectral response accelerations for short ( $S_{DS}$ ) and 1-second ( $S_{D1}$ ) periods can be taken as two-thirds of *maximum* ( $S_{DS} = 2/3*S_{MS}$  and  $S_{D1} = 2/3*S_{M1}$ ).

Per ASCE7-10, Section 21.5, the probabilistic maximum mean peak ground acceleration (PGA) corresponding to the MCE<sub>G</sub> can be computed assuming a 2% probability of exceedance in 50 years (2475-year return period) and is initially determined from mapped ground accelerations for bedrock conditions. The site-specific peak ground acceleration (PGA<sub>M</sub>) is then determined by multiplying the PGA by the site-specific coefficient  $F_h$  (where  $F_h$  is a function of Site Class and PGA).

Spectral response accelerations, peak ground accelerations, and site coefficients provided in this report were obtained using the web-based Seismic Design Maps tool available from the Structural Engineers Association of California (SEAOC, 2018). This program utilizes the methods developed in ASCE 7-10 in conjunction with user-inputted Site location to calculate seismic design parameters and response spectra (both for period and displacement) for soil profile Site Classifications A through E. Output from the web-based program are included in this Appendix.


GEO





# Parcel 9, North Ocean

Latitude, Longitude: 35.449703, -120.908094

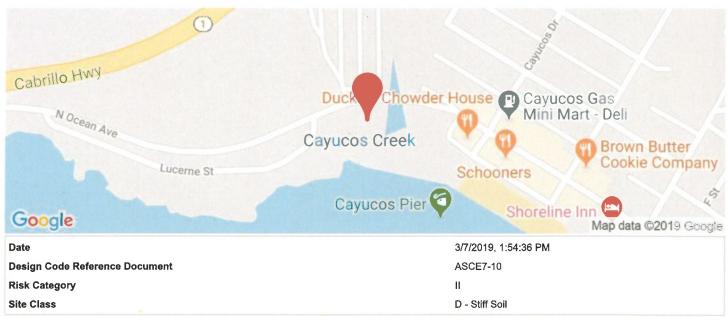


Type	Value	Description
SS	1.15	MCE <sub>R</sub> ground motion. (for 0.2 second period)
S <sub>1</sub>	0.421	MCE <sub>R</sub> ground motion. (for 1.0s period)
S <sub>MS</sub>	1.196	Site-modified spectral acceleration value
S <sub>M1</sub>	0.664	Site-modified spectral acceleration value
S <sub>DS</sub>	0.797	Numeric seismic design value at 0.2 second SA
S <sub>D1</sub>	0.443	Numeric seismic design value at 1.0 second SA


Туре	Value	Description
SDC	D	Seismic design category
$F_a$	1.04	Site amplification factor at 0.2 second
$F_{v}$	1.579	Site amplification factor at 1.0 second
PGA	0.451	MCE <sub>G</sub> peak ground acceleration
$F_{PGA}$	1.049	Site amplification factor at PGA
$PGA_{M}$	0.473	Site modified peak ground acceleration
$T_{L}$	8	Long-period transition period in seconds
SsRT	1.15	Probabilistic risk-targeted ground motion. (0.2 second)
SsUH	1.2	Factored uniform-hazard (2% probability of exceedance in 50 years) spectral acceleration
SsD	1.5	Factored deterministic acceleration value. (0.2 second)
S1RT	0.421	Probabilistic risk-targeted ground motion. (1.0 second)
S1UH	0.431	Factored uniform-hazard (2% probability of exceedance in 50 years) spectral acceleration.
S1D	0.6	Factored deterministic acceleration value. (1.0 second)
PGAd	0.5	Factored deterministic acceleration value, (Peak Ground Acceleration)
$C_{RS}$	0.958	Mapped value of the risk coefficient at short periods
C <sub>R1</sub>	0.976	Mapped value of the risk coefficient at a period of 1 s

https://seismicmaps.org/

### **MCER Response Spectrum**

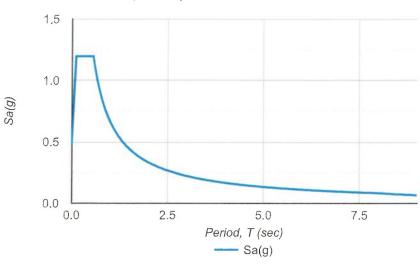

### **Design Response Spectrum**

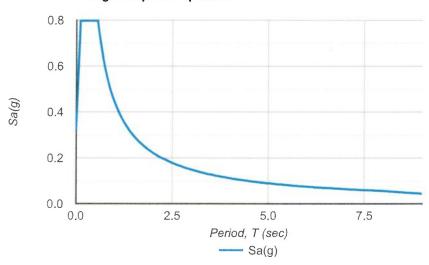

### DISCLAIMER

While the information presented on this website is believed to be correct, <u>SEAOC /OSHPD</u> and its sponsors and contributors assume no responsibility or liability for its accuracy. The material presented in this web application should not be used or relied upon for any specific application without competent examination and verification of its accuracy, suitability and applicability by engineers or other licensed professionals. SEAOC / OSHPD do not intend that the use of this information replace the sound judgment of such competent professionals, having experience and knowledge in the field of practice, nor to substitute for the standard of care required of such professionals in interpreting and applying the results of the seismic data provided by this website. Users of the information from this website assume all liability arising from such use. Use of the output of this website does not imply approval by the governing building code bodies responsible for building code approval and interpretation for the building site described by latitude/longitude location in the search results of this website.

https://seismicmaps.org/

### APPENDIX D

Preliminary Grading Specifications

### PRELIMINARY GRADING SPECIFICATIONS

### A. General

- 1. These preliminary specifications have been prepared for the subject site; GeoSolutions, Inc. should be consulted prior to the commencement of site work associated with site development to ensure compliance with these specifications.
- GeoSolutions, Inc. should be notified at least 72 hours prior to site clearing or grading operations
  on the property in order to observe the stripping of surface materials and to coordinate the work
  with the grading contractor in the field.
- 3. These grading specifications may be modified and/or superseded by recommendations contained in the text of this report and/or subsequent reports.
- 4. If disputes arise out of the interpretation of these grading specifications, the Soils Engineer shall provide the governing interpretation.

### B. Obligation of Parties

- 1. The Soils Engineer should provide observation and testing services and should make evaluations to advise the client on geotechnical matters. The Soils Engineer should report the findings and recommendations to the client or the authorized representative.
- 2. The client should be chiefly responsible for all aspects of the project. The client or authorized representative has the responsibility of reviewing the findings and recommendations of the Soils Engineer. During grading the client or the authorized representative should remain on-site or should remain reasonably accessible to all concerned parties in order to make decisions necessary to maintain the flow of the project.
- 3. The contractor is responsible for the safety of the project and satisfactory completion of all grading and other operations on construction projects, including, but not limited to, earthwork in accordance with project plans, specifications, and controlling agency requirements.

### C. Site Preparation

- 1. The client, prior to any site preparation or grading, should arrange and attend a meeting which includes the grading contractor, the design Structural Engineer, the Soils Engineer, representatives of the local building department, as well as any other concerned parties. All parties should be given at least 72 hours notice.
- All surface and sub-surface deleterious materials should be removed from the proposed building and pavement areas and disposed of off-site or as approved by the Soils Engineer. This includes, but is not limited to, any debris, organic materials, construction spoils, buried utility line, septic systems, building materials, and any other surface and subsurface structures within the proposed building areas. Trees designated for removal on the construction plans should be removed and their primary root systems grubbed under the observations of a representative of GeoSolutions, Inc. Voids left from site clearing should be cleaned and backfilled as recommended for structural fill.
- 3. Once the Site has been cleared, the exposed ground surface should be stripped to remove surface vegetation and organic soil. A representative of GeoSolutions, Inc. should determine the required depth of stripping at the time of work being completed. Strippings may either be disposed of off-site or stockpiled for future use in landscape areas, if approved by the landscape architect.

GEO.

### D. Site Protection

- 1. Protection of the Site during the period of grading and construction should be the responsibility of the contractor.
- 2. The contractor should be responsible for the stability of all temporary excavations.
- 3. During periods of rainfall, plastic sheeting should be kept reasonably accessible to prevent unprotected slopes from becoming saturated. Where necessary during periods of rainfall, the contractor should install check-dams, de-silting basins, sand bags, or other devices or methods necessary to control erosion and provide safe conditions.

### E. Excavations

- 1. Materials that are unsuitable should be excavated under the observation and recommendations of the Soils Engineer. Unsuitable materials include, but may not be limited to: 1) dry, loose, soft, wet, organic, or compressible natural soils; 2) fractured, weathered, or soft bedrock; 3) non-engineered fill; 4) other deleterious materials; and 5) materials identified by the Soils Engineer or Engineering Geologist.
- Unless otherwise recommended by the Soils Engineer and approved by the local building official, permanent cut slopes should not be steeper than 2:1 (horizontal to vertical). Final slope configurations should conform to section 1804 of the 2016 California Building Code unless specifically modified by the Soil Engineer/Engineering Geologist.
- 3. The Soil Engineer/Engineer Geologist should review cut slopes during excavations. The contractor should notify the Soils Engineer/Engineer Geologist prior to beginning slope excavations.

### F. Structural Fill

- 1. Structural fill should not contain rocks larger than 3 inches in greatest dimension, and should have no more than 15 percent larger than 2.5 inches in greatest dimension.
- 2. Imported fill should be free of organic and other deleterious material and should have very low expansion potential, with a plasticity index of 12 or less. Before delivery to the Site, a sample of the proposed import should be tested in our laboratory to determine its suitability for use as structural fill.

### G. Compacted Fill

- 1. Structural fill using approved import or native should be placed in horizontal layers, each approximately 8 inches in thickness before compaction. On-site inorganic soil or approved imported fill should be conditioned with water to produce a soil water content near optimum moisture and compacted to a minimum relative density of 90 percent based on ASTM D1557-12<sub>e1</sub>.
- 2. Fill slopes should not be constructed at gradients greater than 2-to-1 (horizontal to vertical). The contractor should notify the Soils Engineer/Engineer Geologist prior to beginning slope excavations.
- 3. If fill areas are constructed on slopes greater than 10-to-1 (horizontal to vertical), we recommend that benches be cut every 4 feet as fill is placed. Each bench shall be a minimum of 10 feet wide with a minimum of 2 percent gradient into the slope.

GEO

4. If fill areas are constructed on slopes greater than 5-to-1, we recommend that the toe of all areas to receive fill be keyed a minimum of 24 inches into underlying dense material. Key depths are to be observed and approved by a representative of GeoSolutions, Inc. Sub-drains shall be placed in the keyway and benches as required.

### H. Drainage

- During grading, a representative of GeoSolutions, Inc. should evaluate the need for a sub-drain or back-drain system. Areas of observed seepage should be provided with sub-surface drains to release the hydrostatic pressures. Sub-surface drainage facilities may include gravel blankets, rock filled trenches or Multi-Flow systems or equal. The drain system should discharge in a nonerosive manner into an approved drainage area.
- 2. All final grades should be provided with a positive drainage gradient away from foundations. Final grades should provide for rapid removal of surface water runoff. Ponding of water should not be allowed on building pads or adjacent to foundations. Final grading should be the responsibility of the contractor, general Civil Engineer, or architect.
- 3. The ground immediately adjacent to the foundation shall be sloped away from the building at a slope of not less than one unit vertical in 20 units horizontal (5 percent slope) for a minimum distance of 10 feet (3048 mm) measured perpendicular to the face of the wall perc Section 1804.4 of the 2016 CBC.
- 4. Concentrated surface water runoff within or immediately adjacent to the Site should be conveyed in pipes or in lined channels to discharge areas that are relatively level or that are adequately protected against erosion.
- 5. Water from roof downspouts should be conveyed in solid pipes that discharge in controlled drainage localities. Surface drainage gradients should be planned to prevent ponding and promote drainage of surface water away from building foundations, edges of pavements and sidewalks. For soil areas we recommend that a minimum of 2 percent gradient be maintained.
- 6. Attention should be paid by the contractor to erosion protection of soil surfaces adjacent to the edges of roads, curbs and sidewalks, and in other areas where hard edges of structures may cause concentrated flow of surface water runoff. Erosion resistant matting such as Miramat, or other similar products, may be considered for lining drainage channels.
- 7. Sub-drains should be placed in established drainage courses and potential seepage areas. The location of sub-drains should be determined after a review of the grading plan. The sub-drain outlets should extend into suitable facilities or connect to the proposed storm drain system or existing drainage control facilities. The outlet pipe should consist of a non-perforated pipe the same diameter as the perforated pipe.

### I. Maintenance

- 1. Maintenance of slopes is important to their long-term performance. Precautions that can be taken include planting with appropriate drought-resistant vegetation as recommended by a landscape architect, and not over-irrigating, a primary source of surficial failures.
- 2. Property owners should be made aware that over-watering of slopes is detrimental to long term stability of slopes.

GEO

### J. Underground Facilities Construction

- 1. The attention of contractors, particularly the underground contractors, should be drawn to the State of California Construction Safety Orders for "Excavations, Trenches, Earthwork." Trenches or excavations greater than 5 feet in depth should be shored or sloped back in accordance with OSHA Regulations prior to entry.
- 2. Bedding is defined as material placed in a trench up to 1 foot above a utility pipe and backfill is all material placed in the trench above the bedding. Unless concrete bedding is required around utility pipes, free-draining sand should be used as bedding. Sand to be used as bedding should be tested in our laboratory to verify its suitability and to measure its compaction characteristics. Sand bedding should be compacted by mechanical means to achieve at least 90 percent relative density based on ASTM D1557-12<sub>e1</sub>.
- 3. On-site inorganic soils, or approved import, may be used as utility trench backfill. Proper compaction of trench backfill will be necessary under and adjacent to structural fill, building foundations, concrete slabs, and vehicle pavements. In these areas, backfill should be conditioned with water (or allowed to dry), to produce a soil water content of about 2 to 3 percent above the optimum value and placed in horizontal layers, each not exceeding 8 inches in thickness before compaction. Each layer should be compacted to at least 90 percent relative density based on ASTM D1557-12<sub>e1</sub>. The top lift of trench backfill under vehicle pavements should be compacted to the requirements given in report under Preparation of Paved Areas for vehicle pavement sub-grades. Trench walls must be kept moist prior to and during backfill placement.

### K. Completion of Work

- 1. After the completion of work, a report should be prepared by the Soils Engineer retained to provide such services. The report should including locations and elevations of field density tests, summaries of field and laboratory tests, other substantiating data, and comments on any changes made during grading and their effect on the recommendations made in the approved Soils Engineering Report.
- 2. Soils Engineers shall submit a statement that, to the best of their knowledge, the work within their area of responsibilities is in accordance with the approved soils engineering report and applicable provisions within Chapter 18 of the 2016 CBC.